




CONSTRUCTION OF BACK-UP AREA AND RC PIER

PORT OF TAGBILARAN, BOHOL
(LFP BHL No. 016-2021)

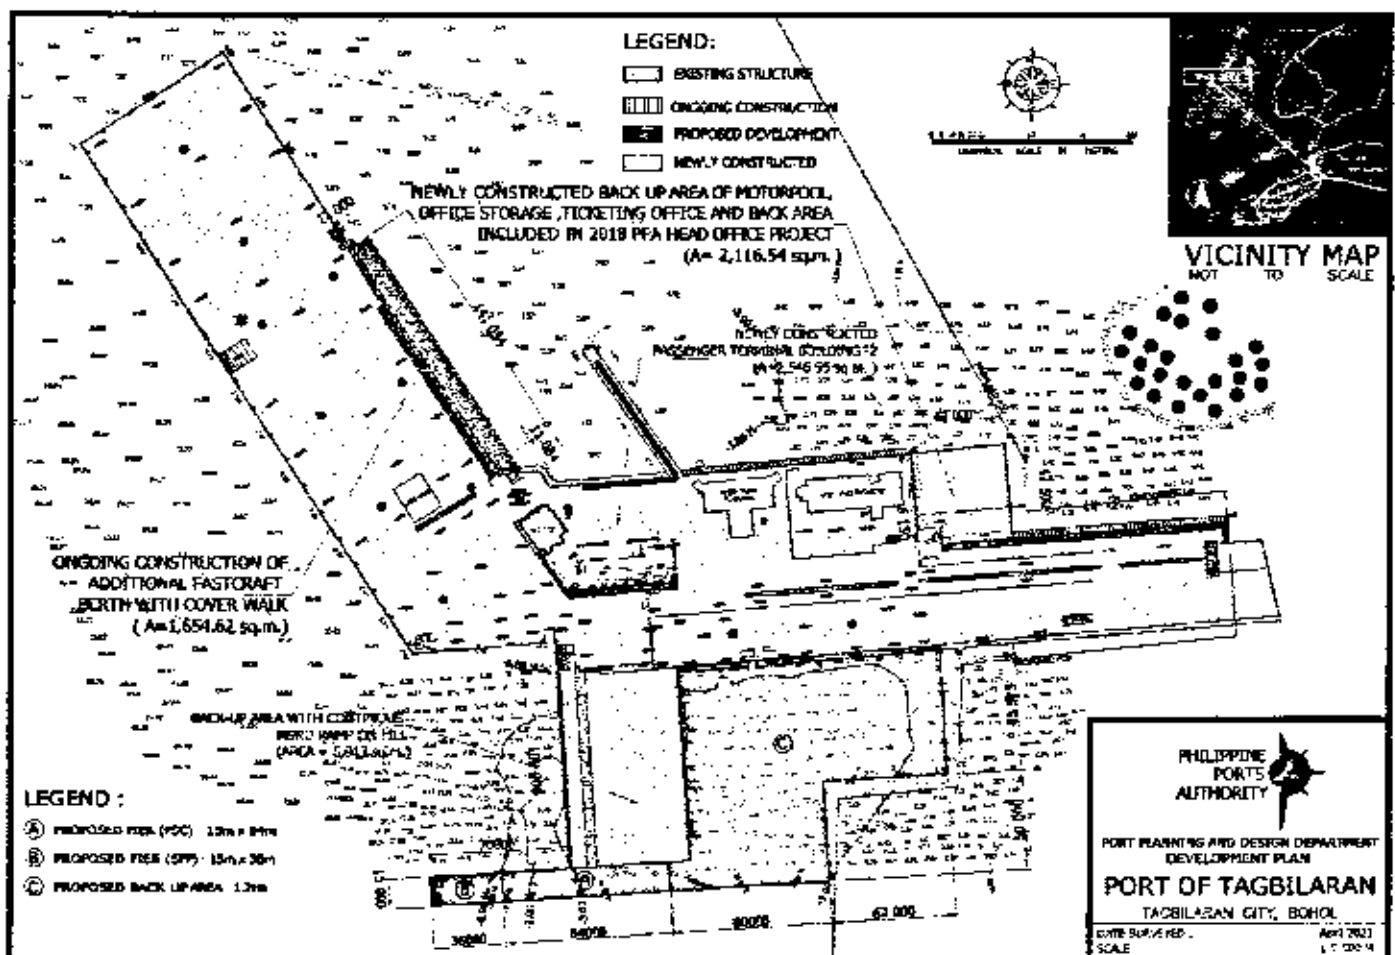

BID DOCUMENTS

June 2021

TABLE OF CONTENTS

Glossary of Terms, Abbreviations, and Acronyms	v-vi
SECTION I INVITATION TO BID	1-2
SECTION II INSTRUCTIONS TO BIDDERS	ITB 1-6
1. Scope of Bid	1
2. Funding Information	1
3. Bidding Requirements	1
4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices	1
5. Eligible Bidders	2
6. Origin of Associated Goods	2
7. Subcontracts	2
8. Pre-Bid Conference	2
9. Clarification and Amendment of Bidding Documents	3
10. Documents Comprising the Bid: Eligibility and Technical Components	3
11. Documents Comprising the Bid: Financial Component	3
12. Alternative Bids	4
13. Bid Prices	4
14. Bid and Payment Currencies	4
15. Bid Security	4
16. Sealing and Marking of Bids	4
17. Deadline for Submission of Bids	5
18. Opening and Preliminary Examination of Bids	5
19. Detailed Evaluation and Comparison of Bids	5
20. Post Qualification	5
21. Signing of Contract	6
SECTION III BID DATA SHEET	BDS 1-2
SECTION IV GENERAL CONDITIONS OF CONTRACT	GCC 1-4
1. Scope of Contract	1
2. Sectional Completion of Works	1
3. Possession of Site	1
4. The Contractor's Obligations	1
5. Performance Security	2
6. Site Investigation Reports	2
7. Warranty	2
8. Liability of the Contractor	2
9. Termination for Other Causes	2
10. Dayworks	3
11. Program of Work	3
12. Instructions, Inspections and Audits	3
13. Advance Payment	3
14. Progress Payment	3
15. Operating and Maintenance Manuals	4
SECTION V SPECIAL CONDITIONS OF CONTRACT	SCC 1
SECTION VI TECHNICAL SPECIFICATIONS	TS 1-109
Item 1: Demolition and Removal Works	
1. Description	1
2. General Provision	1
3. Execution	2

Item 2: Piling Works (Steel Pipe Pile)	
1. Scope of Work	3
2. Material Requirements	3
3. Execution	6
Item 3: Piling Works (Pre-Stressed Concrete Pile)	
1. Scope of Work	9
2. Material Requirements	9
3. Execution	10
Item 4: Reinforced Concrete	
1. Scope of Work	14
2. General Provisions	14
3. Material Requirements	20
3. Execution	26
Item 5: Mooring and Fender System	
1. Scope of Work	38
2. Material Requirements	38
3. Execution	42
Item 6: Piling Works (Pre-Stressed Concrete Sheet Pile)	
1. Scope of Work	43
2. Material Requirements	43
3. Execution	44
Item 7: Piling Works (RC Sheet Pile and Corner Sheet Pile)	
1. Scope of Work	47
2. Material Requirements	47
3. Execution	48
Item 8: Rockworks	
1. Scope of Work	50
2. Material Requirements	50
3. Execution	50
Item 9: Geotextile Fabric	
1. Scope of Work	52
2. Material Requirements	52
3. Materials	53
Item 10: Reclamation and Fill	
1. Scope of Work	54
2. Material Requirement	54
3. Execution	56
Item 11: Aggregate Sub Base Course	
1. Description	59
2. Material Requirements	59
3. Construction Requirements	59
4. Method of Measurements	61
Item 12: Aggregate Base Course	
1. Description	62
2. Material Requirements	62
3. Construction Requirements	63
4. Method of Measurements	65
Item 13: Cement Treated Base Course	
1. Scope of Work	66
2. Material Requirements	66
3. Construction Method	69

Item 14: Interlocking Concrete Block Pavement (ICBP)	
1. Scope of Work	73
2. Material Requirements	73
3. Execution	73
Item 15: Portland Cement Concrete Pavement (PCCP)	
1. Scope of Work	75
2. Material Requirements	75
3. Execution	76
Item 16: Construction Joints	
1. Scope of Work	81
2. Material Requirements	81
3. Execution	81
Item 17: Steel and Metal Works	
1. General	82
2. Scope of Work	82
3. Materials Requirements	82
4. Execution	83
Item 18: Zinc (Hot-dipped Galvanized)	
1. Scope of Work	92
2. General Requirements	92
3. Materials	92
Item 19: Drainage Works	
1. Scope of Work	99
2. Material Requirements	99
3. Execution	99
Item 20: Electrical Works	
1. Scope of Work	101
2. General Requirements	101
3. Material Requirements	102
4. Execution	103
Item 21: Project Billboard	
1. Specification	105
2. Standard Project Billboard	106
3. Billboard Frame	107
4. DOTr Message	108
Item 22: Safety Signages and Barricades	
1. Description	109
2. Specification	109
SECTION VII DRAWINGS (APPROVED PLANS)	PD 1-2
SECTION VIII BILL OF QUANTITIES AND ATTACHMENTS	BQ 1-51
1. Bill of Quantities	1
2. Annex 1 (Basis of Payments)	8
3. Annex 2 (Facilities to be Provided)	19
4. Annex 2a (Reimbursable Items)	20
4. Annex 3 (Minimum Equipment Requirements)	22
5. Annex 4 (Construction Safety and Health Requirements)	23
6. Annex 5 (Minimum Testing Requirements)	24
7. Annex 6 (Engineering Circular No. 01 2020)	34
8. Annex 7 (Construction Guidelines for Project Implementation during Public Health Emergency)	37
SECTION IX Checklist of Technical and Financial Documents	CL 1-2

SECTION X	BIDDING FORMS	BF 1-22
1.	Bid Form	1
2.	Statement of all On-going Government and Private Contracts, including contracts awarded but not yet started	3
3.	Statement of the Bidder's Single Largest Completed Contracts (SLCC) Similar to the Contract to be Bid	4
4.	Experience Record on Similarly Completed Projects	5
5.	Financial Data	6
6.	List of Contractor's Personnel	7
7.	List of Contractor's Equipment Units	8
8.	Omnibus Sworn Statement for Sole Proprietorship	9
9.	Omnibus Sworn Statement for Partnership or Cooperative	11
10.	Omnibus Sworn Statement for Corporation or Joint Venture	13
11.	Bid-Securing Declaration	15
12.	Construction Methodology	16
13.	Manpower Schedule	18
14.	Equipment Utilization Schedule	19
15.	Cash Flow by Quarter and Payment Schedule	20
16.	Contract Agreement	21

GLOSSARY OF TERMS, ABBREVIATIONS, AND ACRONYMS

Glossary of Terms, Abbreviations, and Acronyms

ABC – Approved Budget for the Contract.

ARCC – Allowable Range of Contract Cost.

BAC – Bids and Awards Committee.

Bid – A signed offer or proposal to undertake a contract submitted by a bidder in response to and in consonance with the requirements of the bidding documents. Also referred to as *Proposal* and *Tender*. (2016 revised IRR, Section 5[c])

Bidder – Refers to a contractor, manufacturer, supplier, distributor and/or consultant who submits a bid in response to the requirements of the Bidding Documents. (2016 revised IRR, Section 5[d])

Bidding Documents – The documents issued by the Procuring Entity as the bases for bids, furnishing all information necessary for a prospective bidder to prepare a bid for the Goods, Infrastructure Projects, and/or Consulting Services required by the Procuring Entity. (2016 revised IRR, Section 5[e])

BIR – Bureau of Internal Revenue.

BSP – Bangko Sentral ng Pilipinas.

CDA – Cooperative Development Authority.

Consulting Services – Refer to services for Infrastructure Projects and other types of projects or activities of the GOP requiring adequate external technical and professional expertise that are beyond the capability and/or capacity of the GOP to undertake such as, but not limited to: (i) advisory and review services; (ii) pre-investment or feasibility studies; (iii) design; (iv) construction supervision; (v) management and related services; and (vi) other technical services or special studies. (2016 revised IRR, Section 5[f])

Contract – Refers to the agreement entered into between the Procuring Entity and the Supplier or Manufacturer or Distributor or Service Provider for procurement of Goods and Services; Contractor for Procurement of Infrastructure Projects; or Consultant or Consulting Firm for Procurement of Consulting Services; as the case may be, as recorded in the Contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.

Contractor – is a natural or juridical entity whose proposal was accepted by the Procuring Entity and to whom the Contract to execute the Work was awarded. Contractor as used in these Bidding Documents may likewise refer to a supplier, distributor, manufacturer, or consultant.

CPI – Consumer Price Index.

DOLE – Department of Labor and Employment.

DTI – Department of Trade and Industry.

Foreign-funded Procurement or Foreign-Assisted Project – Refers to procurement whose funding source is from a foreign government, foreign or international financing institution as

Acronyms

specified in the Treaty or International or Executive Agreement. (2016 revised IRR, Section 5[b]).

GFI – Government Financial Institution.

GOCC – Government-owned and/or --controlled corporation.

Goods – Refer to all items, supplies, materials and general support services, except Consulting Services and Infrastructure Projects, which may be needed in the transaction of public businesses or in the pursuit of any government undertaking, project or activity, whether in the nature of equipment, furniture, stationery, materials for construction, or personal property of any kind, including non-personal or contractual services such as the repair and maintenance of equipment and furniture, as well as trucking, hauling, janitorial, security, and related or analogous services, as well as procurement of materials and supplies provided by the Procuring Entity for such services. The term "related" or "analogous services" shall include, but is not limited to, lease or purchase of office space, media advertisements, health maintenance services, and other services essential to the operation of the Procuring Entity. (2016 revised IRR, Section 5[r])

GOP – Government of the Philippines.

Infrastructure Projects – Include the construction, improvement, rehabilitation, demolition, repair, restoration or maintenance of roads and bridges, railways, airports, seaports, communication facilities, civil works components of information technology projects, irrigation, flood control and drainage, water supply, sanitation, sewerage and solid waste management systems, shore protection, energy/power and electrification facilities, national buildings, school buildings, hospital buildings, and other related construction projects of the government. Also referred to as *civil works or works*. (2016 revised IRR, Section 5[u])

LGUs – Local Government Units.

NFCC – Net Financial Contracting Capacity.

NGA – National Government Agency.

PCAB – Philippine Contractors Accreditation Board.

PhilGEPS - Philippine Government Electronic Procurement System.

Procurement Project – refers to a specific or identified procurement covering goods, infrastructure project or consulting services. A Procurement Project shall be described, detailed, and scheduled in the Project Procurement Management Plan prepared by the agency which shall be consolidated in the procuring entity's Annual Procurement Plan. (GPPB Circular No. 06-2019 dated 17 July 2019)

PSA – Philippine Statistics Authority.

SEC – Securities and Exchange Commission.

SLCC – Single Largest Completed Contract.

UN – United Nations.

SECTION I
INVITATION TO BID



INVITATION TO BID

FOR THE

CONSTRUCTION OF BACK-UP AREA AND RC PIER, PORT OF TAGBILARAN, BOHOL

The Philippine Ports Authority, through the Corporate Budget of the Authority for CY 2021, intends to apply the sum of **P491,652,486.14** being the Approved Budget for the Contract (ABC) to payments under the contract for the **CONSTRUCTION OF BACK-UP AREA AND RC PIER, PORT OF TAGBILARAN, BOHOL (LFP BHL NO. 016-2021)**. Bids received in excess of the ABC shall be automatically rejected at bid opening.

The Philippine Ports Authority now invites bids for the above Procurement Project. Completion of the Works is required in **Six Hundred (600) calendar days** from the receipt by the successful bidder of the Notice to Proceed. Bidders should have completed a contract similar to the Project. The description of an eligible bidder is contained in the Bidding Documents, particularly, in Section II (Instructions to Bidders).

Bidding will be conducted through open competitive bidding procedures using a non-discretionary "pass/fail" criterion as specified in the 2016 Revised Implementing Rules and Regulations (IRR) of Republic Act (RA) 9184.

Interested bidders may obtain further information from the Philippine Ports Authority Bids and Awards Committee (BAC) and inspect the Bidding Documents at the address given below from 8:00 a.m. to 5:00 p.m., Monday to Friday.

A complete set of Bidding Documents may be acquired by interested Bidders on **03 June 2021** from the given address and website(s) below and upon payment of the applicable fee for the Bidding Documents, pursuant to the latest Guidelines issued by the GPPB, in the amount of **FIFTY THOUSAND PESOS (P50,000.00)**. The Procuring Entity shall allow the bidder to present its proof of payment for the fees in person.

The Philippine Ports Authority's Bids and Awards Committee will hold a Pre-Bid Conference on **11 June 2021 at 10:00 a.m.** at the PPA Function Room, 7th Floor, PPA Bldg., Bonifacio Drive, South Harbor, Port Area, Manila, and/or through video conferencing or webcasting via zoom, which shall be open to all prospective bidders.

Bids must be duly received by the BAC Secretariat through manual submission at the office address indicated below on or before **30 June 2021 at 9:00 a.m.** Late bids shall not be accepted.

All bids must be accompanied by a bid security in any of the acceptable forms and in amount stated in ITB Clause 16.

Bid opening shall be on **30 June 2021 at 10:00 a.m.** at the 7th Floor, PPA Building, A. Bonifacio Drive, South Harbor, Port Area, Manila. Bids will be opened in the presence of the bidders' representatives who choose to attend the activity.

The Philippine Ports Authority reserves the right to reject any and all bids, declare a failure of bidding, or not award the contract at any time prior to contract award in accordance with Sections 35.6 and 41 of the 2016 revised Implementing Rules and Regulations of RA No. 9184, without thereby incurring any liability to the affected bidder or bidders.

- Required PCAB Registration: LARGE B – Port, Harbor and Offshore Engineering

For further information, please refer to:

BAC Secretariat, Philippine Ports Authority
5th Floor, PPA Bldg., A. Bonifacio Drive,
South Harbor, Port Area, Manila
Telephone Nos. 527-47-35

527-83-56 to 83 loc. 539

PPA Website: www.ppa.com.ph

PhilGEPS Website: www.philgeps.gov.ph



MARK JON S. PALOMAR
Chairperson, PPA Head Office Bids and Awards
Committee for Engineering Projects (HO-BAC-EP)

SECTION II

INSTRUCTIONS TO BIDDERS

1. Scope of Bid

The Procuring Entity, **Philippine Ports Authority** invites Bids for the **Construction of Back-up Area and RC Pier, Port of Tagbilaran, Bohol** with Project Identification Number **LFP BHL No. 016-2021**.

The **Construction of Back-up Area and RC Pier, Port of Tagbilaran, Bohol** is for the construction of Works, as described in Section VI (Specifications).

2. Funding Information

2.1. The **Philippine Ports Authority** through the source of funding as indicated below for **CY2021** in the amount of **₱ 491,652,486.14**.

2.2. The source of funding is:

Corporate Operating Budget

3. Bidding Requirements

The Bidding for the Project shall be governed by all the provisions of RA No. 9184 and its 2016 revised IRR, including its Generic Procurement Manual and associated policies, rules and regulations as the primary source thereof, while the herein clauses shall serve as the secondary source thereof.

Any amendments made to the IRR and other GPPB issuances shall be applicable only to the ongoing posting, advertisement, or invitation to bid by the BAC through the issuance of a supplemental or bid bulletin.

The Bidder, by the act of submitting its Bid, shall be deemed to have inspected the site, determined the general characteristics of the contracted Works and the conditions for this Project, such as the location and the nature of the work; (b) climatic conditions; (c) transportation facilities; (c) nature and condition of the terrain, geological conditions at the site communication facilities, requirements, location and availability of construction aggregates and other materials, labor, water, electric power and access roads; and (d) other factors that may affect the cost, duration and execution or implementation of the contract, project, or work and examine all instructions, forms, terms, and project requirements in the Bidding Documents.

4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices

The Procuring Entity, as well as the Bidders and Contractors, shall observe the highest standard of ethics during the procurement and execution of the contract. They or through an agent shall not engage in corrupt, fraudulent, collusive, coercive, and obstructive practices defined under Annex "I" of the 2016 revised IRR of RA No. 9184 or other integrity violations in competing for the Project.

5. Eligible Bidders

5.1 Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.

5.2 The Bidder must have an experience of having completed a Single Largest Completed Contract (SLCC) that is similar to this Project, equivalent to at least fifty percent (50%) of the ABC adjusted, if necessary, by the Bidder to current prices using the PSA's CPI, except under conditions provided for in Section 23.4.2.4 of the 2016 revised IRR of RA No. 9184.

A contract is considered to be "similar" to the contract to be bid if it has the major categories of work stated in the BDS.

5.3. For Foreign-funded Procurement, the Procuring Entity and the foreign government/foreign or international financing institution may agree on another track record requirement, as specified in the Bidding Document prepared for this purpose.

5.4. The Bidders shall comply with the eligibility criteria under Section 23.4.2 of the 2016 IRR of RA No. 9184.

6. Origin of Associated Goods

There is no restriction on the origin of Goods other than those prohibited by a decision of the UN Security Council taken under Chapter VII of the Charter of the UN.

7. Subcontracts

7.1. The Bidder may subcontract portions of the Project to the extent allowed by the Procuring Entity as stated herein, but in no case more than fifty percent (50%) of the Project.

The Procuring Entity has prescribed that:

Subcontracting is not allowed.

7.2. Subcontracting of any portion of the Project does not relieve the Contractor of any liability or obligation under the Contract. The Supplier will be responsible for the acts, defaults, and negligence of any subcontractor, its agents, servants, or workmen as fully as if these were the Contractor's own acts, defaults, or negligence, or those of its agents, servants, or workmen.

8. Pre-Bid Conference

The Procuring Entity will hold a pre-bid conference for this Project on the specified date and time and either at its physical address and/or through videoconferencing/webcasting as indicated in paragraph 6 of the IB.

9. Clarification and Amendment of Bidding Documents

Prospective bidders may request for clarification on and/or interpretation of any part of the Bidding Documents. Such requests must be in writing and received by the Procuring Entity, either at its given address or through electronic mail indicated in the IB, at least ten (10) calendar days before the deadline set for the submission and receipt of Bids.

10. Documents Comprising the Bid: Eligibility and Technical Components

10.1 The first envelope shall contain the eligibility and technical documents of the Bid as specified in **Section IX. Checklist of Technical and Financial Documents.**

10.2 If the eligibility requirements or statements, the bids, and all other documents for submission to the BAC are in foreign language other than English, it must be accompanied by a translation in English, which shall be authenticated by the appropriate Philippine foreign service establishment, post, or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. For Contracting Parties to the Apostille Convention, only the translated documents shall be authenticated through an apostille pursuant to GPPB Resolution No. 13-2019 dated 23 May 2019. The English translation shall govern, for purposes of interpretation of the bid.

10.3 A valid PCAB License is required, and in case of joint ventures, a valid special PCAB License, and registration for the type and cost of the contract for this Project. Any additional type of Contractor license or permit shall be indicated in the BDS.

10.4 A List of Contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen) assigned to the contract to be bid, with their complete qualification and experience data shall be provided. These key personnel must meet the required minimum years of experience set in the BDS.

10.5 A List of Contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership, certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be, must meet the minimum requirements for the contract set in the BDS.

11. Documents Comprising the Bid: Financial Component

11.1. The second bid envelope shall contain the financial documents for the Bid as specified in **Section IX. Checklist of Technical and Financial Documents.**

11.2. Any bid exceeding the ABC indicated in paragraph 1 of the IB shall not be accepted.

- 11.3. For Foreign-funded procurement, a ceiling may be applied to bid prices provided the conditions are met under Section 31.2 of the 2016 revised IRR of RA No. 9184.

12. Alternative Bids

Bidders shall submit offers that comply with the requirements of the Bidding Documents, including the basic technical design as indicated in the drawings and specifications. Unless there is a value engineering clause in the BDS, alternative Bids shall not be accepted.

13. Bid Prices

All bid prices for the given scope of work in the Project as awarded shall be considered as fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances as determined by the NEDA and approved by the GPPB pursuant to the revised Guidelines for Contract Price Escalation guidelines.

14. Bid and Payment Currencies

- 14.1. Bid prices may be quoted in the local currency or tradeable currency accepted by the BSP at the discretion of the Bidder. However, for purposes of bid evaluation, Bids denominated in foreign currencies shall be converted to Philippine currency based on the exchange rate as published in the BSP reference rate bulletin on the day of the bid opening.

- 14.2. *Payment of the contract price shall be made in:*
Philippine Pesos.

15. Bid Security

- 15.1. The Bidder shall submit a Bid Securing Declaration or any form of Bid Security in the amount indicated in the BDS, which shall be not less than the percentage of the ABC in accordance with the schedule in the BDS.
- 15.2. The Bid and bid security shall be valid until **One Hundred Twenty (120) days from the date set for Bid Opening**. Any bid not accompanied by an acceptable bid security shall be rejected by the Procuring Entity as non-responsive.

16. Sealing and Marking of Bids

Each Bidder shall submit one copy of the first and second components of its Bid.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

If the Procuring Entity allows the submission of bids through online submission to the given website or any other electronic means, the Bidder shall submit an electronic copy of its Bid, which must be digitally signed. An electronic copy that cannot be opened or is corrupted shall be considered non-responsive and, thus, automatically disqualified.

17. Deadline for Submission of Bids

The Bidders shall submit on the specified date and time and either at its physical address or through online submission as indicated in paragraph 7 of the IB.

18. Opening and Preliminary Examination of Bids

18.1. The BAC shall open the Bids in public at the time, on the date, and at the place specified in paragraph 9 of the IB. The Bidders' representatives who are present shall sign a register evidencing their attendance. In case videoconferencing, webcasting or other similar technologies will be used, attendance of participants shall likewise be recorded by the BAC Secretariat.

In case the Bids cannot be opened as scheduled due to justifiable reasons, the rescheduling requirements under Section 29 of the 2016 revised IRR of RA No. 9184 shall prevail.

18.2. The preliminary examination of Bids shall be governed by Section 30 of the 2016 revised IRR of RA No. 9184.

19. Detailed Evaluation and Comparison of Bids

19.1. The Procuring Entity's BAC shall immediately conduct a detailed evaluation of all Bids rated "passed" using non-discretionary pass/fail criteria. The BAC shall consider the conditions in the evaluation of Bids under Section 32.2 of 2016 revised IRR of RA No. 9184.

19.2. If the Project allows partial bids, all Bids and combinations of Bids as indicated in the BDS shall be received by the same deadline and opened and evaluated simultaneously so as to determine the Bid or combination of Bids offering the lowest calculated cost to the Procuring Entity. Bid Security as required by ITB Clause 16 shall be submitted for each contract (lot) separately.

19.3 In all cases, the NFCC computation pursuant to Section 23.4.2.6 of the 2016 revised IRR of RA No. 9184 must be sufficient for the total of the ABCs for all the lots participated in by the prospective Bidder.

20. Post Qualification

Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit its latest income and business tax returns filed and

paid through the BIR Electronic Filing and Payment System (eFPS), and other appropriate licenses and permits required by law and stated in the **BDS**.

21. Signing of the Contract

The documents required in Section 37.2 of the 2016 revised IRR of RA No. 9184 shall form part of the Contract. Additional Contract documents are indicated in the **BDS**.

SECTION III
BID DATA SHEET

Bid Data Sheet

ITB Clause			
5.2	For this purpose, contracts similar to the Project refer to contracts which have the same Major Categories of Works which shall be:		
	Description/Clarification	Unit of Measure	Quantity (at least)
	1. Offshore Pile Driving Works	l.m.	5,279
	2. Reinforced Concrete Works	cu.m.	1,182
	3. Rockworks (50-100 kg/pc.)	cu.m.	3,994
	4. Placing of Fill materials	cu.m.	43,150
	5. Construction of interlocking concrete paving blocks	sq.m.	4,790
6. Construction of Portland Cement Concrete Pavement	sq.m.	706	
7.1	Portion of Works allowed to be subcontracted: Subcontracting is not allowed	Maximum Percentage allowed to be subcontracted: Subcontracting is not allowed	
10.3	For Joint Venture: Special PCAB License		
10.4	The key personnel must meet the required minimum years of experience set below:		
	Key Personnel	General Experience	Relevant Experience (Minimum)
	a. Project Manager		Five (5) years
	b. Project Engineer		Three (3) years
	c. Materials Engineer II		One (1) year
	d. Construction Safety and Health Officer		One (1) year
e. Foreman	Five (5) years		

10.5	<p><i>The minimum major equipment requirements are the following:</i></p> <p>Please refer to Section 8, Annex 3 Minimum Major Equipment Requirements</p>
12	<p><i>Value Engineering Clause:</i></p> <p>Not Allowed</p>
15.1	<p>The bid security shall be in the form of a Bid Securing Declaration or any of the following forms and amounts:</p> <p>a. The amount of not less than ₱ 9,833,049.72, if bid security is in cash, cashier's/manager's check, bank draft/guarantee or irrevocable letter of credit;</p> <p>b. The amount of not less than ₱ 24,582,624.31, if bid security is in Surety Bond.</p>
16	<p>Each bidder shall submit one (1) original and six (6) copies of the Technical and Financial Proposals, properly labelled, book-bound, with hard cover and corresponding index tab.</p>
19.2	<p><i>Partial bids:</i></p> <p>Not Allowed</p>
20	<p><i>Other appropriate licenses and permits required:</i></p> <p>None</p>
21	<p><i>Other contract documents are as follows:</i></p> <p><i>Construction Schedule and S-Curve, Manpower Schedule, Construction Methods, Equipment Utilization Schedule, Construction Safety and Health Program approved by the Department of Labor and Employment and PERT/CPM or other acceptable tools of project scheduling.</i></p>

SECTION IV

**GENERAL CONDITIONS
OF CONTRACT**

1. Scope of Contract

This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. All the provisions of RA No. 9184 and its 2016 revised IRR, including the Generic Procurement Manual, and associated issuances, constitute the primary source for the terms and conditions of the Contract, and thus, applicable in contract implementation. Herein clauses shall serve as the secondary source for the terms and conditions of the Contract.

This is without prejudice to Sections 74.1 and 74.2 of the 2016 revised IRR of RA No. 9184 allowing the GPPB to amend the IRR, which shall be applied to all procurement activities, the advertisement, posting, or invitation of which were issued after the effectivity of the said amendment.

2. Sectional Completion of Works

If sectional completion is specified in the **Special Conditions of Contract (SCC)**, references in the Conditions of Contract to the Works, the Completion Date, and the Intended Completion Date shall apply to any Section of the Works (other than references to the Completion Date and Intended Completion Date for the whole of the Works).

3. Possession of Site

4.1. The Procuring Entity shall give possession of all or parts of the Site to the Contractor based on the schedule of delivery indicated in the **SCC**, which corresponds to the execution of the Works. If the Contractor suffers delay or incurs cost from failure on the part of the Procuring Entity to give possession in accordance with the terms of this clause, the Procuring Entity's Representative shall give the Contractor a Contract Time Extension and certify such sum as fair to cover the cost incurred, which sum shall be paid by Procuring Entity.

4.2. If possession of a portion is not given by the above date, the Procuring Entity will be deemed to have delayed the start of the relevant activities. The resulting adjustments in contract time to address such delay may be addressed through contract extension provided under Annex "E" of the 2016 revised IRR of RA No. 9184.

4. The Contractor's Obligations

The Contractor shall employ the key personnel named in the Schedule of Key Personnel indicating their designation, in accordance with ITB Clause 10.3 and specified in the **BDS**, to carry out the supervision of the Works.

The Procuring Entity will approve any proposed replacement of key personnel only if their relevant qualifications and abilities are equal to or better than those of the personnel listed in the Schedule.

5. Performance Security

- 5.1. Within ten (10) calendar days from receipt of the Notice of Award from the Procuring Entity but in no case later than the signing of the contract by both parties, the successful Bidder shall furnish the performance security in any of the forms prescribed in Section 39 of the 2016 revised IRR.
- 5.2. The Contractor, by entering into the Contract with the Procuring Entity, acknowledges the right of the Procuring Entity to institute action pursuant to RA No. 3688 against any subcontractor be they an individual, firm, partnership, corporation, or association supplying the Contractor with labor, materials and/or equipment for the performance of this Contract.

6. Site Investigation Reports

The Contractor, in preparing the Bid, shall rely on any Site Investigation Reports referred to in the SCC supplemented by any information obtained by the Contractor.

7. Warranty

- 7.1. In case the Contractor fails to undertake the repair works under Section 62.2.2 of the 2016 revised IRR, the Procuring Entity shall forfeit its performance security, subject its property(ies) to attachment or garnishment proceedings, and perpetually disqualify it from participating in any public bidding. All payables of the GOP in his favor shall be offset to recover the costs.
- 7.2. The warranty against Structural Defects/Failures, except that occasioned on force majeure, shall cover the period from the date of issuance of the Certificate of Final Acceptance by the Procuring Entity. Specific duration of the warranty is found in the SCC.

8. Liability of the Contractor

Subject to additional provisions, if any, set forth in the SCC, the Contractor's liability under this Contract shall be as provided by the laws of the Republic of the Philippines.

If the Contractor is a joint venture, all partners to the joint venture shall be jointly and severally liable to the Procuring Entity.

9. Termination for Other Causes

Contract termination shall be initiated in case it is determined *prima facie* by the Procuring Entity that the Contractor has engaged, before, or during the implementation of the contract, in unlawful deeds and behaviors relative to contract acquisition and implementation, such as, but not limited to corrupt, fraudulent, collusive, coercive, and obstructive practices as stated in ITB Clause 4.

10. Dayworks

Subject to the guidelines on Variation Order in Annex "E" of the 2016 revised IRR of RA No. 9184, and if applicable as indicated in the SCC, the Dayworks rates in the Contractor's Bid shall be used for small additional amounts of work only when the Procuring Entity's Representative has given written instructions in advance for additional work to be paid for in that way.

11. Program of Work

11.1. The Contractor shall submit to the Procuring Entity's Representative for approval the said Program of Work showing the general methods, arrangements, order, and timing for all the activities in the Works. The submissions of the Program of Work are indicated in the SCC.

11.2. The Contractor shall submit to the Procuring Entity's Representative for approval an updated Program of Work at intervals no longer than the period stated in the SCC. If the Contractor does not submit an updated Program of Work within this period, the Procuring Entity's Representative may withhold the amount stated in the SCC from the next payment certificate and continue to withhold this amount until the next payment after the date on which the overdue Program of Work has been submitted.

12. Instructions, Inspections and Audits

The Contractor shall permit the GOP or the Procuring Entity to inspect the Contractor's accounts and records relating to the performance of the Contractor and to have them audited by auditors of the GOP or the Procuring Entity, as may be required.

13. Advance Payment

The Procuring Entity shall, upon a written request of the Contractor which shall be submitted as a Contract document, make an advance payment to the Contractor in an amount not exceeding fifteen percent (15%) of the total contract price, to be made in lump sum, or at the most two installments according to a schedule specified in the SCC, subject to the requirements in Annex "E" of the 2016 revised IRR of RA No. 9184.

14. Progress Payments

The Contractor may submit a request for payment for Work accomplished. Such requests for payment shall be verified and certified by the Procuring Entity's Representative/Project Engineer. Except as otherwise stipulated in the SCC, materials and equipment delivered on the site but not completely put in place shall not be included for payment.

15. Operating and Maintenance Manuals

- 15.1. If required, the Contractor will provide “as built” Drawings and/or operating and maintenance manuals as specified in the SCC.
- 15.2. If the Contractor does not provide the Drawings and/or manuals by the dates stated above, or they do not receive the Procuring Entity's Representative's approval, the Procuring Entity's Representative may withhold the amount stated in the SCC from payments due to the Contractor.

SECTION V

**SPECIAL CONDITIONS
OF CONTRACT**

Special Conditions of Contract

GCC Clause	
2	<i>Sectional Completion:</i> None
4.1	The Procuring Entity shall give possession of all parts of the Site to the Contractor upon commencement of the project.
6	<i>Site Investigation Report:</i> None
7.2	<i>Permanent structures: Fifteen (15) years</i> Buildings of types 4 and 5 as classified under the National Building Code of the Philippines and other structures made of steel, iron, or concrete which comply with relevant structural codes (e.g., DPWH Standard Specifications), such as, but not limited to, steel/concrete bridges, flyovers, aircraft movement areas, ports, dams, tunnels, filtration and treatment plants, sewerage systems, power plants, transmission and communication towers, railway system, and other similar permanent structures
10	No dayworks are applicable to the contract.
11.1	The Contractor shall submit the Program of Work to the Procuring Entity's Representative within ____ days of delivery of the Notice of Award.
11.2	The amount to be withheld for late submission of an updated Program of Work is _____.
13	The provision on advance payments or mobilization fees in the terms and conditions of all contracts/ purchase orders/ job orders for goods, services and infrastructure projects that will be signed or executed shall henceforth be excluded.
14	No further instructions.
15.1	The date by which operating and maintenance manuals are required is _____. The date by which "as built" drawings are required is _____.
15.2	The amount to be withheld for failing to produce "as built" drawings and/or operating and maintenance manuals by the date required is _____.

SECTION VI
TECHNICAL SPECIFICATIONS

ITEM 01 : DEMOLITION AND REMOVAL WORKS

DESCRIPTION

The work includes the furnishing of all labor, materials and equipment required to carry out the demolition and removal of old structures, port accessories and obstructions including demolition of miscellaneous concrete curbs etc., as required for the execution of the Contract.

The Contractor shall submit the proposed methodology or procedure of demolition work with detailed drawings and calculations if necessary, to the Engineer for approval, before the execution of the Works.

The Contractor shall keep all pavements and landing areas to and from the site of the disposal area clean and free of mud, dirt and debris during and after the execution of disposal. Disposal of debris and materials shall be as directed by the Engineer.

GENERAL PROVISIONS

1. The Contractor shall be deemed to have satisfied himself of the site conditions, and to have included in his unit prices provision for all risks that may arise during or in connection with the work.
2. The demolition shall be carried out by approved methods and equipment such as concrete breakers, gas-cutters, hydraulic jacks, compressed air disintegrators, etc., however, no blasting shall be used unless approved in writing by the Engineer and after obtaining the written permission of the concerned authorities.
3. The Contractor shall provide suitable equipment, skilled labor and appropriate temporary works such as scaffoldings to ensure safety in his demolition works as well as in the adjacent area.
4. Contractor shall demolish all the structural members above the level on which the subsequent and permanent works under this Contract will begin. To this end, the temporary construction works such as excavation shall be conducted by the Contractor.
5. Materials coming from the demolition works, except general earth, shall remain the property of the Procuring Entity, the designated part of which shall be stored by the Contractor at places specified by the Engineer/ Accepting authority. Receiving copy of Turn-Over Report shall be provided.
6. In case of demolition of wharf deck and platform, the contractor shall ensure that no debris will be remained/deposited at seabed.

INTERFERENCE WITH PORT OPERATIONS

During the execution of the work, the Contractor shall not interfere with the shipping, navigation and other traffic in the port.

The Contractor shall make arrangements with the operations people on the schedule of demolition and related works to keep port operation activities undisturbed at all times.

Prior to commencement of the demolition works, the Contractor shall inform/announce to port users the schedule of disconnection of utilities.

STORAGE AND DUMPING

Prior to the commencement of the demolition work, the Engineer shall submit to the Contractor a list in which all the materials to be salvaged and overhauled, as property of PPA, and the description of the location of their storage. Materials embedded in concrete units shall not be salvaged.

The Contractor shall separate materials to be salvaged from debris. Salvaged materials shall be loaded, transported and unloaded by the Contractor at the specified locations.

The Contractor may dump debris or extracted rocks on land areas but out of the site, which areas shall be procured and prepared at his own expense. In this case, safety measures shall be undertaken in the transporting, unloading, covering and others as requested by the Engineer.

The approximate distance of the disposal site from the project site is about five (5) kms., as designated by the PMO thru the implementing office.

EXECUTION

1. Prior to the commencement of demolition works, the alignments of the new construction works to existing structure shall be checked.
2. The width and alignment of portion of existing structure to be demolished shall be marked by paint.
3. With these lines as guides, concrete shall be broken and reinforcing bars cut, such that panels or portions of the structure can be lifted out for disposal elsewhere outside of the operational work area.
4. Rocks removed from existing slope protection shall be stored for re-use in new construction.
5. Demolish pavements, curbs, fences, utilities, services, navigation aids and the likes as determined in the field for each project and as shown on the drawings or as directed by the Engineer.
6. Materials coming from the demolition works shall be properly disposed by the Contractor.

SAFETY

During the course of survey and clearing, any obstacles which are recognized and seemed to be explosive or hazardous to workers shall be removed from the site by the proper Authority.

At the end of each day's work, the Contractor shall keep the workplace in safe condition and clean so that no part is in danger of falling or creating hazard to personnel or equipment.

ITEM 02 : PILING WORKS (SPP)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used as containment for the proposed pier.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to the said undertaking.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.
2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.
3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

STEEL PIPE PILES

Steel tubular piles required under this heading may either be fluted or plain, tapered or cylindrical, seamless or welded type or as indicated in the drawing conforming to the requirements of ASTM A 252, equal or better. Minimum shell thickness shall be as indicated in the drawings.

Manufacturing processes, grades and test requirements shall conform to the requirements of ASTM A 252. Other materials, equal or better, than this standard may be allowed upon approval of the implementing agency.

Type of Test	-	Requirements
Chemical Composition	-	ASTM A252, ASTM A751
Mechanical/ Tensile Test	-	ASTM A252, ASTM A370
Physical /Test	-	ASTM A252

REINFORCING BAND AND BACKING CYLINDER PLATE

Manufacturing processes, grades and test requirements shall conform to the requirements of ASTM A 252. Other materials, equal or better, than this standard may be allowed upon approval of the implementing agency.

CONCRETE AND REINFORCEMENT WORKS

Concrete and reinforcement works for filler of steel pipe piles, concrete jacket and pile cap shall be in accordance with the Section "Reinforced Concrete" where the compressive strength of concrete at 28 days and yield strength of reinforcement shall be 24MPa (3,500 psi) and 276MPa (40 000psi) respectively.

PROTECTIVE COATING

Coating System

The corrosion protective coating shall be polyurethane-base.

The protective coating supplier is required to certify that the materials delivered to the fabrication site will be proven to meet or exceed the following properties:

TECHNICAL PROPERTIES	UNIT	MINIMUM	TEST STANDARD
A. Physical Characteristics:			
Thickness	microns	1500	ASTM D1186
B. Mechanical Properties:			
Tensile Strength	N/mm ²	18	DIN 53504
Elongation	%	19	ASTM D2370
Impact	J/mm	8	ASTM 2794-69/14
Bond Strength	kg/cm ²	234	DIN 53232

Application of the protective coating shall be one meter (1) below the design depth up to the pile butt of the steel pipe piles, as illustrated in Figure 1.




Figure 1: Illustration showing the application of Protective Coating System

Surface Preparation

The surface areas of the sections of piles that are intended to be coated are cleaned in accordance with standard ISO 8501-1 "Pictorial Standard of Cleanliness". These standards for surface cleaning outline the visual characteristics of the substrate as viewed by the naked eye. Once the substrate is cleaned, it is compared to reference pictures contained within the standards. The Sa 2½ is to be used for this undertaking, which is defined in ISO 8501-1 as having the following characteristics:

"Very thorough blast cleaning: Near white metal, 85% clean. The surface shall be free from visible oil, dirt and grease, from poorly adhering mill scale, rust, paint coatings and foreign matter. The metal has a greyish color. Any traces of contamination shall be visible only as slight stains in the form of spots or stripes."

Spraying Method

Airless spraying techniques involve paint being "forced out of an orifice at high pressure, 5 to 35 MPa". The paint appears to form a coating "sheet" to ensure a uniform and continuous coating layer. This uniformity is important as even the smallest discrepancy in the coating can lead to accelerated corrosion. Once any small-sized area of the substrate becomes exposed it will begin to corrode. This corrosion continues under the protective layer in the adjoining coated areas in all directions, even if the coating has not been damaged.

Good surface preparation is essential and it profoundly effects the performance of the protective coating. Poor surface preparation invariably develops a poor adhesive bond between the coating and the substrate and causes premature coating failure. Hence, the surface preparation and airless spraying shall be done in an "Enclosed Area" wherein humidity and corrosion may be controlled prior to delivery of the Steel Pipe Piles at the project site.

On-site repairs

A special touch up materials shall be provided by the supplier/contractor and shall be done either by the use of a spray or manual brush with the objective of having a final homogeneous coating. The special touch up materials shall be used in repairing damages caused by handling and transporting of the Steel Pipe Piles.

WELDING REQUIREMENTS

The welding material used for the production of steel piles by circumferential welding of steel pile or in the attachment of accessories shall have a tensile strength not less than the following test standards.

JIS Z 3211	-	Covered Electrodes for Mild Steel
JIS Z 3213	-	Covered Electrodes for High Tensile Strength Steel
JIS Z 3312	-	MAG Welding Solid Wires for Mild
JIS Z 3313	-	Flux Cored Wives for Gas Shielded and self-shielded Metal Arc Welding of Mild Steel, High Strength Steel and Low Temperature Service Steel
JIS Z 3352	-	Submerged Arc Welding Fluxes for Carbon Steel and Low Alloy Steel

EXECUTION

MARKING

The pile shall be marked on with durable paint indicating:

1. Serial Number, marked close to both ends
2. Date of Arrival, marked same as (1)
3. Length of pile, marked same as (1)
4. Meters mark in two faces, throughout the length

DOCUMENTS TO BE SUBMITTED

1. Steel Pipe manufacturing plan (Steel pipe production plan, welding method, welding material, production location, production method, transportation, etc.)
2. Design plan
3. Manufacturing process
4. Shipment method and stacking plan
5. Steel pipe inspection certificate
6. Size inspection record
7. Radiographic Test record

STEEL PIPE PILES

The Contractor shall submit to the Engineer three (3) copies of test reports by the approved steel mill certifying that the steel pipe pile meets the requirements specified in these technical specifications.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.
2. The splice shall be embedded at least 4m from the design depth elevation.
3. Splice welding shall conform to the welding requirements of this section.
4. The welder shall be accredited by TESDA.

REINFORCED CONCRETE

The requirements regarding testing of concrete and reinforcement used in the concrete filler and cage bars of steel pipe piles shall be in accordance with Section "Reinforced Concrete".

STORAGE AND HANDLING

1. Piles may be stored in open air but on wooden sleepers to be placed in a manner so as not to cause excessive bending.
2. Piles shall be stacked on a stable yard and shall not be stacked more than three (3) tiers high.
3. All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A diesel or hydraulic pile hammer shall be used for driving the steel pipe piles.

The required weight of ram for the diesel pile hammer 2.5 tons or at least 25% (1/4) of the weight of longest pile.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

$$\text{For Diesel Pile Hammer : } R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

where : R = allowable bearing capacity of pile (tf)

W = weight of ram (tf)

H = fall of ram (cm)

S = set (cm)

In case of the use of hydraulic pile hammer, the computed minimum bearing power shall be submitted to the Project Development Department (PDD) and shall be evaluated and approved by the Designing Engineer.

DRIVING RECORDS

The Contractor shall keep complete and accurate piling records. Two (2) signed copies of these records shall be submitted to the Engineer not more than 48 hours from the date of works detailed therein. The pile records shall always be submitted with sufficient time for the Engineer's approval.

The records shall contain the following information:

1. Pile reference number
2. Pile type and Steel Grade
3. Pile Length
4. Commencing surface level and final toe level
5. Depth driven, time, date when piles were driven
6. Where required the number of blows to drive each 250 mm over the last 2.5 meter shall be recorded
7. Comments regarding unusual/unexpected driving conditions

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All steel pipe piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:
 - a. Withdrawal of the pile and replacement by a new pile.
 - b. Driving a second pile adjacent to the defective one.
 - c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

ITEM 03 : PILING WORKS (PRE-STRESSED CONCRETE PILES)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used in wharves/piers/platforms/pile anchor.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to foundation piling.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.
2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.
3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

TYPE OF FOUNDATION PILES

Pre-stressed concrete foundation piles to be used shall be in accordance with the design as shown on the Drawings and called for in the proposal.

PRE-STRESSED CONCRETE PILES

Pre-stressed concrete piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. Pre-stressed concrete piles shall be of readymade products of approved fabricator regularly engaged in the production of pre-stressed concrete piles.
2. If an alternative system of pre-stressing to that shown in the Drawings is proposed by the Contractor, full details, procedures and explanations shall be submitted in writing to the Engineer for his approval. When approved for the work, the provisions of this Specification and such other provisions as he may require shall be fully satisfied.
3. Concrete strength, high tension wires/strands, reinforcing bars to be used for pre-stressed concrete work shall be as specified in the Drawings.
4. The Contractor shall submit the casting method including pre-stressing, application of stress and casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.
5. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.

6. Piles shall be cast on a horizontal platform in approved steel moulds and details of the formwork and methods of concreting shall be as specified. The concreting of each pile shall be completed on one continuous operation and no interruption shall be permitted.

The pile butt must be formed truly square to the axis of the pile. Provision for standard splicing shall be provided unless otherwise ordered by the Engineer.

7. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.
8. Application of stress, grouting of pre-stressing cables, protection of pre-stressing cable anchorages and other necessary steps to complete the pre-stressing process shall conform to the standard practice of the pre-stressing system in use or as directed by the Engineer.
9. When the stress has been transferred to the pile, the pile shall exhibit no curvature in its length on any face greater than 3 millimeters deviation along a chord of 15 meters (1 in 500).
10. Pre-cast pre-stressed units shall be lifted only by lifting holes/hook as indicated in the Drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.
11. Each pre-stressed member is to be uniquely and permanently marked to show its type, date of casting, length of pile and any control markings as ordered by the Engineer
12. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.
13. Not less than five (5) cylindrical specimens shall be made for each casting batch of which at least two (2) shall be reserved for 28-day test, one (1) for 7-day, one (1) for 14-day, and one (1) test prior to lifting of pre-stressed concrete piles from the casting bed. Lifting of piles shall only be done if the result of the compressive strength has reached at least 60% of the specified compressive strength.
14. Wires/strands specifications shall be in accordance with ASTM A 416.

EXECUTION

HANDLING OF PILES

All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A hydraulic or diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the hydraulic or diesel pile hammer, ranges from 3.5 to 4.5 tons.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.
2. The splice shall be embedded at least 4m from the design depth elevation.

Surface Preparation

Concrete piles to be bonded must be thoroughly cleaned, free of dirt, paint, grease, oil, curing compound and other contaminants. The concrete surface must be dry. Clean the dowels with steel brush to removed rust and other impurities. Blow compressed air to the dowel holes.

Pile Splicing Epoxy

Piling splicing epoxy is a two components, low viscosity, rapid cure, chemical resistant epoxy with high physical strength.

Preparation and Application of Epoxy Mortar

Mixing and ratio of pile splicing epoxy and dry silica sand, application and curing of epoxy mortar shall refer to product manual.

Compressive Strength

The compressive strength of epoxy mortar (Pile Splicing Epoxy + Dry Silica Sand) shall be at least 1.2 times the design compressive strength of pile or 6,000psi.

Mechanical Properties of Epoxy

Cured state at 27° C (80° F) for 24 hours

Mechanical Properties	Specification (Test Methods)
Ultimate Tensile Strength	ASTM D 638
Ultimate Flexural Strength	ASTM D 790
Hardness	ASTM D 2240
Compressive Strength at 1 hour cure	ASTM D 695
Compressive Strength with Silica Sand	ASTM D 695

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels and strand) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

$$\text{For Diesel Pile Hammer : } R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

$$\frac{1}{1} \times \frac{2WH}{S + 2.54}$$

For Hydraulic Pile Hammer :
$$R = \frac{\quad}{3} \times \frac{\quad}{S + 2.54}$$

- where :
- R = allowable bearing capacity of pile (tf)
 - W = weight of ram (tf)
 - H = fall of ram (cm)
 - S = set (cm)

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:
 - a. Withdrawal of the pile and replacement by a new pile.
 - b. Driving a second pile adjacent to the defective one.
 - c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or piles driven at other suitable location.

RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to penetration depth of 5.0 m., the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

TESTING OF MATERIALS

The requirements regarding testing of concrete and reinforcement used in reinforced concrete piles shall be in accordance with "Reinforced Concrete".

However, the Engineer may conduct the necessary testing at the approved fabricator's casting yard whenever he considers necessary. Tests shall be carried out at the Contractor's expense.

High Tensile Strand shall be tested according to the latest ASTM Standard and PPA Circular

STORAGE AND HANDLING OF PILES

When raising or transporting piles, the Contractor shall provide slings or other equipment to avoid any appreciable bending of the pile or cracking of the concrete. Pile materials damaged in handling or driving shall be removed from the site and replaced by the Contractor at his expense.

Concrete piles shall be so handled at all times as to avoid breaking or chipping of the edges.

ITEM 04 : REINFORCED CONCRETE

SCOPE OF WORK

All works falling under this Section shall include reinforced concrete for all kinds and parts of any reinforced concrete structure.

GENERAL PROVISIONS

1. Full cooperation shall be given to the other trades to install embedded items. Suitable templates or instructions will be provided for setting, items shall have been inspected, and tests for concrete or other materials or for mechanical operations shall have been completed and approved.
2. The following publications of the issues listed below, but referred to thereafter by basic designation only, form as an integral part of this Specification to the extent indicated by the reference thereto:
 - a. American Concrete Institute (ACI) Standards:

ACI 117	Standard Specifications for Tolerances for Concrete Construction and Materials
ACI 121R	Quality Management System for Concrete Construction
ACI 201.2R	Guide to Durable Concrete
ACI 211.1	Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete
ACI 214R	Recommended Practice for Evaluation of Strength Test Results of Concrete
ACI 301	Specifications for Structural Concrete
ACI 304.2R	Placing Concrete by Pumping Methods
ACI 304R	Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	Hot Weather Concreting
ACI 306.1	Standard Specification for Cold Weather Concreting
ACI 308R	Guide to Curing Concrete
ACI 309R	Guide for Consolidation of Concrete
ACI 311.4R	Guide for Concrete Inspection
ACI 318M	Metric Building Code Requirements for Structural Concrete and Commentary

- ACI 347 Guide to Formwork for Concrete

- ACI SP-15 Field Reference Manual: Standard Specifications for Structural
Concrete with Selected ACI and ASTM References

- ACI SP-2 ACI Manual of Concrete Inspection

b. American Society for Testing and Materials (ASTM) Publications:

- ASTM C 150 Standard Specification for Portland Cement

- ASTM C 114 Standard Method for Chemical Analysis of Hydraulic Cement

- ASTM C 185 Standard Method for Air Content of Hydraulic Cement

- ASTM C 115 Standard Test Method for Fineness of Portland Cement by the
Turbidimeter

- ASTM C 204 Standard Test Method for Fineness of Hydraulic Cement by Air-
Permeability Apparatus

- ASTM C 151 Standard Test Method for Autoclave Expansion of Portland Cement

- ASTM C 109 Standard Test Method for Compressive Strength of Hydraulic Cement
Mortars

- ASTM C 266 Standard Test Method for Time of Setting of Hydraulic-Cement Paste
Gilmore Needles

- ASTM C 191 Standard Test Method of Time Setting of Hydraulic Cement by Vicat
Needle

- ASTM C 33 Standard Specification for Concrete Aggregates

- ASTM C 136 Standard Test Method for Sieve Analysis of Fine and Coarse
Aggregates

- ASTM C 117 Standard Test Method for Materials Finer than 75 micron (No. 200)
Sieve in Mineral Aggregates by Washing

- ASTM C 29 Standard Test Method for Bulk Density (Unit Weight) and Voids in
Aggregate

- ASTM C 128 Standard Test Method for Density, Relative Density (Specific Gravity),
and Absorption of Fine Aggregates

- ASTM C 87 Standard Test Method for Effect of Organic Impurities in Fine Aggregate
on Strength of Mortar

- ASTM C 88 Standard Test Method for Soundness of Aggregates by Use of Sodium
Sulfate or Magnesium Sulfate

ASTM C 142	Standard Test Method for Clay Lumps and Friable Particles in Aggregates
ASTM C 97	Standard Test Method for Absorption and Bulk Specific Gravity of Dimension Stone
ASTM C 127	Test Method for Specific Gravity and Absorption of Coarse Aggregate
ASTM C 535	Standard Test Method for Resistance to Degradation of Large-Size Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 88	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
ASTM C 131	Test Method for Resistance to Degradation of Small-size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 94	Standard Specification for Ready-Mixed Concrete
ASTM D 512	Chloride Ion in Water
ASTM D 516	Sulfate Ion in Water
ASTM A 615	Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A 370	Standard Test Methods and Definitions for Mechanical Testing of Steel Products
ASTM A 510	Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel
ASTM A 6	Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM C 31	Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C 39	Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C 172	Standard Practice for Sampling Freshly Mixed Concrete
ASTM C 192	Standard Practice for Making and Curing Concrete Test Specimens in the Laboratory
ASTM C 293	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Center-Point Loading)
ASTM C 78	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C 42	Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete

- ASTM C 174 Standard Test Method for Measuring Thickness of Concrete Elements Using Drilled Concrete Cores
- ASTM C 143 Standard Test Method for Slump of Hydraulic-Cement Concrete
- ASTM C 494 Standard Specification for Chemical Admixtures for Concrete
- ASTM C 1017 Standard Specification for Chemical Admixtures for use in Producing Flowing Concrete
- ASTM C 171 Standard Specification for Sheet Materials for Curing Concrete
- ASTM C 309 Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete
- ASTM 5329 Standard Test Methods for Sealants and Fillers, Hot Applied, For Joints and Cracks in Asphaltic and Portland Cement Concrete Pavements
- ASTM D 5167 Standard Practice for Melting of Hot Applied Joint and Crack Sealant and Filler for Evaluation
- ASTM A 706 Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement
- ASTM A 966 Standard Test Method for Magnetic Particle Examination of Steel Forgings using Alternating Current
- ASTM C 1064 Standard Test Method for Temperature of Freshly Mixed Hydraulic-Cement Concrete
- ASTM C 1077 Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for use in Construction and Criteria for Laboratory Evaluation
- ASTM C 1107 Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Non-shrink)
- ASTM C 1116 Standard Specification for Fiber-Reinforced Concrete
- ASTM C 1157 Standard Specification for Hydraulic Cement
- ASTM C 138 Standard Test Method for Density ("Unit Weight"), Yield, and Air Content (Gravimetric) of Concrete
- ASTM C 173 Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method
- ASTM C 260 Standard Specification for Air-Entraining Admixtures for Concrete
- ASTM C 295 Petrographic Examination of Aggregates for Concrete
- ASTM C 33 Standard Specification for Concrete Aggregates
- ASTM C 42 Standard Test Method for Obtaining and Test Drilled cores and Sawed Beams of Concrete

ASTM C 469 Static Modulus of Elasticity and Poisson's Ratio of Concrete in Compression

ASTM C 595 Standard Specification for Blended Hydraulic Cements

ASTM C1116 Standard Specification for Fiber-Reinforced Concrete and Shotcrete

ASTM C 1751 Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types).

ASTM D 1179 Fluoride Ion in Water

ASTM D 1190 Standard Specification for Concrete Joint Sealer, Hot-Applied Elastic Type

ASTM D 1751 Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types)

ASTM E 329 Standard Specification for Agencies Engaged in the Testing and/ or Inspection of Materials used in Construction

c. American Welding Society (AWS)

D 12 Welding Reinforcing Steel, Metal Inserts and Connections in Reinforced Concrete Construction.

d. Philippine National Standard (PNS)

PNS 49 Steel Bars for Concrete Reinforcement

e. DPWH Standard Specifications

e. All other standards hereinafter indicated.

f. The edition or the revised version of such codes and standards current at the date twenty eight (28) days prior to date of bid submission shall apply. During Contract execution, any changes in such codes and standards shall be applied after approval by the Owner.

SUBMITTALS

1. Test Reports and Certificates shall be furnished and approval received before delivery of certified or tested materials to the Project Sites.

a. Submit Test Reports for the following:

a.1 Concrete mixture proportions

Submit copies of test reports by independent test labs conforming to ASTM C 1077 showing that the mixture has been successfully tested to produce concrete with the properties specified and that mixture will be

suitable for the job conditions. Test reports shall be submitted along with the concrete mixture proportions. Obtain approval before concrete placement. Fully describe the processes and methodology whereby mixture proportions were developed and tested and how proportions will be adjusted during progress of the work to achieve, as closely as possible, the designated levels of relevant properties.

a.2 Aggregates

Submit test results for aggregate quality in accordance with ASTM C 33. Where there is potential for alkali-silica reaction, provide results of tests conducted in accordance with ASTM C 227 or ASTM C 1260. Submit results of all tests during progress of the work in tabular and graphical form as noted above, describing the cumulative combined aggregate grading and the percent of the combined aggregate retained on each sieve.

a.3 Admixtures

Submit test results in accordance with ASTM C 494 and ASTM C 1017 for concrete admixtures, ASTM C 260 for air-entraining agent, and manufacturer's literature and test reports for corrosion inhibitor and anti-washout admixture. Submitted data shall be based upon tests performed within 6 months of submittal.

a.4 Cement

Submit test results in accordance with ASTM C 150 Portland cement. Submit current mil data.

a.5 Water

Submit test results in accordance with ASTM D 512 and ASTM D 516.

b. Submit Certificates for the following:

b.1 Curing concrete elements

Submit proposed materials and methods for curing concrete elements.

b.2 Form removal schedule

Submit proposed materials and methods for curing concrete elements.

b.3 Concrete placement and compaction

Submit technical literature for equipment and methods proposed for use in placing concrete. Include pumping or conveying equipment including type, size and material for pipe, valve characteristics, and the maximum length and height concrete will be pumped. No adjustments shall be made to the mixture design to facilitate pumping.

Submit technical literature for equipment and methods proposed for vibrating and compacting concrete. Submittal shall include technical literature describing the equipment including vibrator diameter, length, frequency, amplitude, centrifugal force, and manufacturer's description of the radius of influence under load. Where flat work is to be cast, provide similar information relative to the proposed compacting screed or other method to ensure dense placement.

b.4 Mixture designs

Provide a detailed report of materials and methods used, test results, and the field test strength (fcr) for marine concrete required to meet durability requirements.

2. The Contractor shall submit shop drawings and erection drawings for formwork and scaffolding at least 14 days prior to commencing the work.

Each shop drawing and erection drawing shall bear the signature of a Contractor's qualified Engineer. Details of all proposed formwork to be prefabricated and formwork to produce special finishes shall be submitted to the Engineer for approval before any materials are ordered. If the Engineer so requires, samples of proposed formworks shall be constructed and concrete placed at the Contractor's expense so that the proposed methods and finished effect can be demonstrated.

The Contractor shall submit shop drawings showing reinforcing bar placing and bar lists for the Engineer's approval. Such shop drawings shall show also supplemental bars for forming, strengthening frames of bars of sufficient rigidity to withstand forces during placing concrete. If necessary, shaped steel may be added to improve rigidity of the frame of bar.

Such shop drawings shall clearly indicate bar sizes, spacing, location and quantities of reinforcement, mesh, chairs, spacers and other details to be as per ACI Manual of Standard Practice for Detailing Reinforced Concrete Structures.

Details shall be prepared for placement of reinforcement where special conditions occur, including most congested areas and connection between pre-cast concrete and concrete in-situ.

All shop drawings shall be reviewed by the Engineer within seven (7) days after receiving them. At least two (2) days prior to pouring concrete, the Contractor shall submit to the Engineer a pouring permit for his inspection and approval.

MATERIAL REQUIREMENTS

CEMENT

Unless otherwise specified in the Drawings, only one (1) brand of cement shall be used for any individual structure. In determining the approved mix, only Portland cement shall be used as the cementitious material.

1. Portland Cement: ASTM C 150

Type I (for general use in construction)

ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	25mm	19mm	10mm
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of fine aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No. 4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

- a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix proportions of concrete are based.
- b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	No marked change No marked change
Appearance	Clear
Color	Colorless

Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration	
Chloride as $Cl^{(-)}$ expressed as a mass percent of cement when added to the $Cl^{(-)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4 , ppm ^A	3,000
Alkalies as $(Na_2O + 0.658 K_2O)$, ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions, and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.
3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.
4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement.
Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or

government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples, and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows evidence of failure during the load test, or fails the load test as evaluated, the deficiency be

corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

- a. 10 kg of joint sealant
- b. 1m length of joint filler
- c. 5 li. of curing compound
- d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from weather by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved

silos of adequate size and numbers to store sufficient cement to ensure continuity of work and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) month after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off metal of design that will not allow form deflection and will not spall concrete upon removal.

Bolts and rods that are to be completely withdrawn shall be coated with a non-staining bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External corners that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to insure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Softlifts of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent, and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

- Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.
- Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.
- Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.

6. Concrete Protection for Reinforcement

- a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.
- b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm

Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

- a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.
- b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.
- c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.
- d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.
- e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.
- f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.
- g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

- a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

- b. When bulk cement is used and the volume of the batch is 0.5 m³ or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

- c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.
- d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.
- e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.
- f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.
- g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are placed therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.
- h. All concrete shall be mixed for a period of not less than 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.
- i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.
- j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.
- k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

- a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.
- b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.
- c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.
- d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. Preformed Expansion Joint Filler

a. Joints with Joint Sealant

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. Finish of concrete at joints

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. Construction Joints

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the

site of work, discharged in the forms within 45 minutes from the time ingredients are discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

b. Pumps shall be operated and maintained so that a continuous stream of concrete

is delivered into the forms without air pockets, segregation or changes in slump. When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.

Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.
2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set

concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance, coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed, the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 05 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.
2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.
3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of RDF.

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

		Test Item	Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	160kg/sq.m minimum	Test piece: Dumbell No. 3	ASTM D412
		Elongation	350% minimum		ASTM D1456
		Hardness	76Hs maximum	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Not less than 80% of original value	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation			ASTM D1456
		Hardness	Not more than original value +8°		ASTM D2240
	Compression Test		30% maximum	Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified (ASTM A36) and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

Sample rubber dock fenders that shall be incorporated in the project shall be subjected to tests. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

All units shall be tested for performance. The fender shall be compressed repeatedly three (3) times to the maximum deflection at the speed from 2 to 8 cm. per minute. The load and deflection values shall be recorded with the precision of 0.1tf and 0.5mm respectively. The results shall be plotted in the form of load-deflection-energy absorption curves. The average data obtained in the second and third test loading shall be considered as performance values.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	$E \geq$ Specified E but not more than 10%
R = Reaction force,	$R \leq$ Specified R but not more than 10%

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project : _____

Year supplied : _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 06 : PILING WORKS (PSCSP)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of the containment structure.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the piling works.

MATERIAL REQUIREMENTS

PRE-STRESSED CONCRETE SHEET PILES

Pre-stressed concrete sheet piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. Pre-stressed concrete sheet piles shall be of readymade products of approved fabricator regularly engaged in the production of pre-stressed concrete piles.
2. If an alternative system of pre-stressing to that shown in the Drawings is proposed by the Contractor, full details, procedures and explanations shall be submitted in writing to the Engineer for his approval. When approved for the work, the provisions of this Specification and such other provisions as he may require shall be fully satisfied.
3. Concrete strength, wires/strands, bars to be used for pre-stressed concrete work shall be as specified in the Drawings.
4. The Contractor shall submit the casting method including pre-stressing, application of stress and casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.
5. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.
6. Casting of pre-stressed concrete piles shall be in a manner that there shall be no leakage of concrete or grout into the space to be occupied by the steel. The ducts shall be of the correct cross-section, the ends being formed out as shown on the Drawings or as required by the pre-stressing system in use. Adequate means, subject to the Engineer's approval, shall be employed to ensure that their location is maintained exactly throughout the concreting operations. Passage shall be provided in the locations indicated on the Drawings for the injection and escape of grout and the release of air.

Piles shall be cast on a horizontal platform in approved steel moulds and details of the formwork and methods of concreting shall be as specified. The concreting of each pile shall be completed on one continuous operation and no interruption shall be permitted.

The pile butt must be formed truly square to the axis of the pile. Provision for standard splicing shall be provided unless otherwise ordered by the Engineer.

7. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.

8. Application of stress, grouting of pre-stressing cables, protection of pre-stressing cable anchorages and other necessary steps to complete the pre-stressing process shall conform to the standard practice of the pre-stressing system in use or as directed by the Engineer.
9. When the stress has been transferred to the pile, the pile shall exhibit no curvature in its length on any face greater than 3 millimeters deviation along a chord of 15 meters (1 in 500).
10. Pre-cast pre-stressed units shall be lifted only by lifting holes as indicated in the Drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.
11. Each pre-stressed member is to be uniquely and permanently marked to show its type, date of casting, length of pile and any control markings as ordered by the Engineer
12. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.
13. Not less than five (5) cylindrical specimens shall be made for each casting batch of which at least two (2) shall be reserved for 28-day test, one (1) for 7-day, one (1) for 14-day, and one (1) test prior to lifting of pre-stressed concrete piles from the casting bed. Lifting of piles shall only be done if the result of the compressive strength has reached at least 60% of the specified compressive strength.

TIE – RODS and FITTINGS

All components of tie-rod assemblies to be supplied, assembled and installed by the Contractor shall be in accordance with the applicable requirements of the ASTM standards. The tie-rods shall have upset threaded ends and the minimum yield point shall be as shown on the drawings.

Bolts for assembly of structural steel and for connections or special sections shall conform to ASTM A325 and ASTM A 307 or as specified on the Drawings.

EXECUTION

Uncapped pile heads shall be protected against damage by the use of appropriate pile driving caps and/or cushions to centralize the driving impact.

The pile headers shall be of sufficient rigidity and fixity to hold the pile firmly in position and true alignment during driving operations.

A hydraulic or diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the hydraulic or diesel pile hammer ranges from 2.5 to 3.5 tons or at least 25% (1/4) of the weight of sheet pile.

The fall of hammer shall not exceed 6m. (19.18 ft.) and shall be of uniform frequency to avoid injury to the piles.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

Piling shall commence from the interior outward as the lateral displacement of soil may influence driving and heaving of already driven piles.

Every effort shall be made to drive continuously without interruption.

The Contractor shall repair all damages to piles during driving. A minimum cut - off allowance, not less than 600 mm shall be provided for all corrections at in-place splices and at all the pile heads for removal after completion of the driving.

The piles which have been uplifted after being driven shall be re-driven to the required penetration after completing other activities in the nearby areas. As heaving is anticipated, survey benchmarks should be established and elevations must be taken of the driven piles adjoining the piles being driven to avoid pile displacement affected by the swell rise of sub-soil structures.

LENGTH OF PILES

The length of piles indicated in the drawings are predetermined lengths considering the actual soil classification and/or behavior based on geotechnical consultancy report.

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected/withdraw/replaced correspondingly at the Contractor's expense.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or diverted the alignment to other suitable location.

PILE DRIVING RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to required penetration depth, the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

TESTING OF MATERIALS

The requirements regarding testing of concrete and reinforcement used in reinforced concrete piles and sheet piles shall be in accordance with "Reinforced Concrete".

However, the Engineer may conduct the necessary testing at the approved fabricator's casting yard whenever he considers necessary. Tests shall be carried out at the Contractor's expense.

High Tensile Strand shall be tested according to the latest ASTM Standard and PPA Circular.

STORAGE AND HANDLING OF PILES

When raising or transporting piles, the Contractor shall provide slings or other equipment to avoid any appreciable bending of the pile or cracking of the concrete. Pile materials damaged in handling or driving shall be removed from the site and replaced by the Contractor at his expense.

Concrete piles shall be so handled at all times as to avoid breaking or chipping of the edges.

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels and strand) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

ITEM 07 : PILING WORKS (RC SHEET PILE/CORNER SHEET PILE)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of the containment structure.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the piling works.

MATERIAL REQUIREMENTS

PRE-CAST REINFORCED CONCRETE (RC SHEET PILE/ RC CORNER SHEET PILES)

Pre-cast reinforced concrete sheet piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. The Contractor shall submit the casting method including casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.
2. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.
3. Pre-cast reinforced concrete sheet piles shall be supplied in accordance with the details and sections shown in the drawings. The class of concrete and quality of reinforcing steel shall be in accordance with the provisions of the specification for "Reinforced Concrete" unless otherwise noted in the drawings.
4. Casting of RC sheet piles shall be done with the length lying horizontally. The pile yard must be reasonably level and the ground sufficiently compact or hard, stable and not subject to any settlement, scour or erosion.
5. Pre-cast units shall be lifted only by lifting bars as indicated in the drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.
6. Each pre-cast member is to be uniquely and permanently marked to show its type, date of casting and length of pile.
7. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.
8. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.

TIE – RODS and FITTINGS

All components of tie-rod assemblies to be supplied, assembled and installed by the Contractor shall be in accordance with the applicable requirements of the ASTM standards. The tie-rods shall have upset treaded ends and the minimum yield point shall be as shown on the drawings.

Bolts for assembly of structural steel and for connections or special sections shall conform to ASTM A325 and ASTM A 307 or as specified on the Drawings.

EXECUTION

Uncapped pile heads shall be protected against damage by the use of appropriate pile driving caps and/or cushions to centralize the driving impact.

The pile headers shall be of sufficient rigidity and fixity to hold the pile firmly in position and true alignment during driving operations.

A hydraulic or diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the hydraulic or diesel pile hammer ranges from 2.5 to 3.5 tons or at least 25% (1/4) of the weight of sheet pile.

The fall of hammer shall not exceed 6m. (19.18 ft.) and shall be of uniform frequency to avoid injury to the piles.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

Piling shall commence from the interior outward as the lateral displacement of soil may influence driving and heaving of already driven piles.

Every effort shall be made to drive continuously without interruption.

The Contractor shall repair all damages to piles during driving. A minimum cut - off allowance, not less than 500 mm shall be provided for all corrections at in-place splices and at all the pile heads for removal after completion of the driving.

The piles which have been uplifted after being driven shall be re-driven to the required penetration after completing other activities in the nearby areas. As heaving is anticipated, survey benchmarks should be established and elevations must be taken of the driven piles adjoining the piles being driven to avoid pile displacement affected by the swell rise of sub-soil structures.

LENGTH OF PILES

The length of piles indicated in the drawings are predetermined lengths considering the actual soil classification and/or behavior based on geotechnical consultancy report.

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected/withdraw/replaced correspondingly at the Contractor's expense.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or diverted the alignment to other suitable location.

PILE DRIVING RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to required penetration depth, the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

TESTING OF MATERIALS

The requirements regarding testing of concrete and reinforcement used in reinforced concrete piles and sheet piles shall be in accordance with "Reinforced Concrete".

However, the Engineer may conduct the necessary testing at the approved fabricator's casting yard whenever he considers necessary. Tests shall be carried out at the Contractor's expense.

Concrete piles shall be so handled at all times as to avoid breaking or chipping of the edges.

STORAGE AND HANDLING OF PILES

When raising or transporting piles, the Contractor shall provide slings or other equipment to avoid any appreciable bending of the pile or cracking of the concrete. Pile materials damaged in handling or driving shall be removed from the site and replaced by the Contractor at his expense.

Concrete piles shall be so handled at all times as to avoid breaking or chipping of the edges.

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

ITEM 08 : ROCKWORKS

SCOPE OF WORK

The work includes the furnishing of all labor, materials and equipment required for the rock works including armour rocks, underlayer and rock fill in accordance with the Specifications and as indicated in the drawings or as directed by the Engineer.

SETTING OUT OF WORKS

1. Topographic/Hydrographic Survey

Prior to commencement of Works, the Contractor together with the Engineer shall conduct topographic and hydrographic surveys in order to establish the actual field condition or bathymetry of the project site. The said survey shall be used as the basis of quantity measurement.

2. The Contractor shall set out the Works and shall solely be responsible for the accuracy of such undertaking. Visible construction markers shall be used to clearly define horizontal limits prior to placing of any material.

MATERIAL REQUIREMENTS

1. All rocks to be used shall be angular, hard, durable and not likely to disintegrate in seawater. Rock layers to be installed should more or less be "global in shape", "angular in surface" and should avoid "river run rocks". Rocks that are sub-angular may be subject to the approval of the Engineer. Rounded or well rounded pieces will not be accepted.
2. All rocks shall have a minimum unit weight of 2,650 kg per cubic meter (specific gravity 2.65) of solid materials when measured dry.
3. Rocks with specific gravity higher than the above specified is preferable and will readily be accepted. But no adjustment (increase) in the contract price will be made on this account.
4. Rocks of the primary cover layer shall be sound, durable and hard. It shall be free from laminations, weak cleavages, and undesirable weathering, and shall be of such character that it will not disintegrate from the action of the air, seawater, or in handling and placing. All stone shall be angular quarry stone.
5. All rocks shall conform to the following test designations:

Apparent specific gravity	ASTM C 127
Abrasion	ASTM C 535

EXECUTION

QUARRY SITE AND ROCK QUANTITY

1. It is the Contractor's responsibility to make necessary surveys / investigations on quarry sites applicable to the Works, taking into consideration the nature of the rock works required under the Contract such as required quality, total quantity and daily required quantity, transportation method and route etc.,

2. The Contractor shall submit data on characteristics of proposed quarry sites together with the location of sites, test results of their products and samples for the approval of the Engineer.
3. When the Contractor intends to operate a quarry for the Works, the Contractor shall take all the responsibilities in connection with its operation including, but not limited to, obtaining all necessary permits and approvals, payment of safety measures or like (if any), provisions and maintenance of safety measures and temporary access roads, all of private and public roads and temporary jetties to be used to transport quarried materials and the compliance with all regulations etc. required by the authorities having jurisdiction over any part of the operation.

Should any explosive be used in the quarry operations, the Contractor shall be responsible to meet laws and regulations, wherever applicable, established by the Local Government and Central Government Department concerned.

4. Despite the Engineer's previous approval of the natural rock and borrow pits, the Engineer reserves the right to suspend any operation in connection with the rock, if, in its opinion, such rock is not suitable for the work. In such case, the Contractor shall comply with the Engineer's instructions.
5. The finish bulkhead shall be true to grade and section. The spaces/voids between rocks shall be filled/sealed with 2 kg. to 16 kg. rocks and shall be approved by the Engineer before placing geotextile filter thereon to prevent the filling materials (soil and sand) from escaping to cause scouring and settlement of finished surface.

STORAGE OF MATERIALS

Quarried rock materials shall be stored by weight/class or in a manner approved by the Engineer and in a yard kept clean, free from undesirable materials.

SAMPLING TEST

1. Thirty (30) days prior to commencement of rock works, samples and test results of rock material which conforms to the Specifications called for in the Contract shall be submitted to the Engineer for evaluation and approval.
2. Rock samples from different sources and of different classes shall also be submitted, together with test results and its corresponding certificates, for the Engineer's approval.
3. Rocks accepted at the quarries before shipments or at the site before placement shall not be used as a waiver. The Engineer has the right to reject any inferior rock quality.
4. Samples for each class of approved materials are to be kept in the field for comparison/checking of delivered rock materials. A test shall be required for every 1,500 cu.m.

CROSS-SECTIONS OF COMPLETED ROCKWORK

Cross-sections showing the elevations of the completed rock works and the terrain of the existing seabed prior to construction shall go together with every progress report and request for progress or final payment.

Rock works which was previously paid should be easily identified from sections being requested for payment.

ITEM 09 : GEOTEXTILE FABRIC**SCOPE OF WORK**

This work covers all the following requirements regarding the installation of geotextile (filter fabric) in accordance with the lines, grades, and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

The geotextile fabric shall meet the following requirements in full. If required, a sample of 1.0 sq.m. shall be supplied to the Engineer for approval and retention for purposes of comparative testing against materials randomly sampled from the site.

1. PHYSICAL PROPERTIES

- a. The geotextile material shall be a nonwoven needle punched type comprising of needle punched polypropylene fibers or its equivalent.
- b. The geotextile material shall be UV stabilized to ensure retention of minimum 70% original tensile strength after 90 days exposure to sunlight. The manufacturer shall submit test results to the Engineer for approval.
- c. The geotextile must be highly resistant to long term contact with damp cementitious substances or acid or alkali solutions in the pH range 2-13. The manufacturer shall submit test data to ensure resistance of the polymer.

2. MECHANICAL AND HYDRAULIC PROPERTIES

The geotextile supplier is required to certify that the materials delivered to site will be proven to meet or exceed the following properties:

TECHNICAL PROPERTIES	UNIT	MINIMUM	TEST STANDARD
A. Physical Characteristics:			
Minimum Mass (per unit area)	(g/m ²)	540	ASTM D5261
Thickness (F=2 kpa)	mm	4.5	ASTM D5199
B. Mechanical Properties:			
Tensile Strength (md/cd)	kN/m	13/22	ASTM D4595
Tensile elongation (md/cd)	%	90/40	ASTM D4595
CBR Puncture Resistance	N	3000	ASTM D6241
C. Hydraulic Properties:			
Effective Opening Size (O ₉₀ Wet Sieving)	(mm)	0.08	ASTM D4751
Water Permeability: Permittivity	(s ⁻¹)	0.5	ASTM D4491

EXECUTION

1. The geotextile shall be delivered to site with an outer wrapper to protect it from exposure to the elements.
2. Prior to laying of geotextile filter, stone filler shall be placed between gaps or voids of armour / core rocks as likewise mentioned in the requirements of Item "Rock Works".
3. The non-woven geotextile filter shall be installed and lay manually at site as per design drawings. The filter shall be laid lengthwise down slopes and appropriately anchored along the top edge.
4. The Engineer reserves the right to sample geotextile delivered to site for individual quality control testing at the contractor's expense. A material not meeting the manufacturer's certified values will be rejected from the site.
5. The geotextile shall be proven to resist dynamic puncture damage when subject to impact stress from stone armour (200-400 kg.) dropped from a minimum height of 2.0 m. and should be laid on at least 1-foot sand and gravel bedding. Geotextile failing to resist puncture shall not be accepted.
6. To facilitate site Quality Assurance, each roll of geotextile delivered to site shall be clearly labeled with brand name, grade, and production batch number.
7. Geotextile overlaps shall be at least 1.0 m unless otherwise stated on the drawings. Alternatively, geotextile overlaps are to be heat-welded or sewn using appropriate polypropylene or other synthetic thread and portable hand sewing equipment.

ITEM 10 : RECLAMATION AND FILL

SCOPE OF WORK

This item shall consist of the construction of back-up area in accordance with the Specifications and in conformity with the lines, grades, and dimensions shown on the Plans or established by the Engineer.

The area to be upgraded shall be as indicated on the Drawings.

The works includes furnishing of all labor, materials and equipment required to complete/finish the upgrading of the area in accordance with the Drawings and the Specifications.

The following major items of works are included:

1. Supply and fill of suitable materials to places required to upgrade elevation of areas as shown in the drawings.
 - a. Compaction of fill materials
 - b. Supply and placing of filter fabric
2. The work may also include the construction of temporary dike or structure to enclose the reclamation material before the completion of a permanent waterfront containment structure.

MATERIAL REQUIREMENTS

1. Filling Materials

a. General

All sources of filling materials shall be approved by the Engineer.

Appropriate quantities of sample of all materials to be used in the Works shall be submitted for acceptance and approval by the Engineer thirty (30) days before the commencement of work.

General filling shall consist of approved material from approved sources of suitable grading obtained from excavation, quarries or borrow pits, without excess fines, clay or silt, free from vegetation and organic matter.

Sample of approved materials shall be kept/stored in the field for ready reference/comparison of the delivered materials.

The Contractor shall ensure that adequate quantities of required materials that comply with the specifications and quality approved by the engineer are available at all times.

b. Fill Materials other than Dredged/Excavated Materials

Fill materials for reclamation purposes other than dredged materials shall be pit sand, quarry run, gravel or mine tailings. The fill material shall be of the same quality or better as approved by the Engineer.

c. Type of Fill Materials

c.1 Sand and Gravel Fill (Offshore/Reclamation)

The materials shall be composed of at least 50% sand and 50% gravel in terms of volume and shall be free from rock boulders, wood, scrap, vegetables, and refuse. The materials shall not have organic content and the maximum particle size shall not exceed 100mm diameter. Source of materials shall be river or mountain quarry or manufactured.

c.2 Excavated Materials from Seabed (Offshore/Reclamation)

The excavated materials shall be used for backfilling as directed by the Engineer.

c.3 Select Materials (General Embankment)

All materials used for fill shall be free of rock boulders, wood, scrap materials, organic matters and refuse.

The material shall not have high organic content and shall meet the following requirements:

- i. Not more than 10 percent by weight shall pass the No. 200 sieve (75 microns).
- ii. Maximum particles size shall not exceed 75 mm.
- iii. The fill materials shall be capable of being compacted in the manner and to the density of not less than 95%.
- iv. The material shall have a plasticity index of not more than 6 as determined by AASHTO T 90.
- v. The material shall have a soaked CBR value of not less than 25% as determined by AASHTO T 193.

2. Unsuitable Material – Material other than suitable materials such as:

- (a) Materials containing detrimental quantities of organic materials, such as grass, roots and sewerage.
- (b) Organic soils such as peat and muck.
- (c) Soils with liquid limit exceeding 80 and/or plasticity index exceeding 55.
- (d) Soils with a natural water content exceeding 100%.
- (e) Soils with very low natural density, 800 kg/m³ or lower.
- (f) Soils that cannot be properly compacted as determined by the Engineer.

will not be accepted by the Engineer.

EXECUTION

Reclamation and Fill

a. General

The Contractor shall be responsible for all ancillary earthworks that are necessary for the reception of the fill material and including, all spout handling, temporary dike or shoring construction where necessary, temporary protection to dikes in the sea and drainage of excess water.

The arrangements of these ancillary earthworks shall be laid out in consultation with the Engineer and to the Engineer's satisfaction and care shall be taken to minimize the loss of fill.

- b. Replacement, backfilling and reclamation may be done by any method acceptable to the Engineer. Prior to start of Work, the Contractor shall submit his method and sequence of performing the works to the Engineer for approval. However, the Engineer's approval of the method and sequence of construction shall not release the Contractor from the responsibility for the adequacy of labor and equipment.
- c. The Engineer shall approve the type of material to be used as fill prior to its placement. If the material is rejected, such material shall be deposited into areas designated or as directed by the Engineer.
- d. Reclamation of fill material shall be placed in horizontal layers not exceeding 200mm (8 inches), loose measurement, and shall be compacted as specified before the next layer is placed. Effective spreading equipment shall be used on each lift to obtain uniform thickness prior to compacting. As the compaction of each layer progresses, continuous leveling and manipulating will be required to assure uniform density. Water shall be added or removed, if necessary, in order to obtain the required density. Removal of water shall be accomplished through aeration by plowing, blading, dicing, or other methods satisfactory to the Engineer.

Dumping and rolling areas shall be kept separate, and no lift shall be covered by another until the necessary compaction is obtained.

Hauling and leveling equipment shall be so routed and distributed over each layer of the fill in such a manner as to make use of compaction effort afforded thereby and to minimize rutting and uneven compaction.

TRIAL SECTION

Before finish grade construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for sub-base, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

CROSS-SECTIONS OF COMPLETED RECLAMATION

Cross-sections showing the elevations of the completed reclamation and the terrain of the existing seabed prior to construction shall go together with every progress report and request for progress or final payment.


FIELD COMPACTION TEST

Field Density tests to determine the percent of compaction of the compactable material shall be conducted. Compaction of each layer thereafter shall continue until the required field density in accordance with AASHTO T/180 Method D has been achieved. In place density determination shall be made in accordance with AASHTO T191/ ASTM D 1556.

TOLERANCE

Elevation : plus 5 cm.

Page RV-8

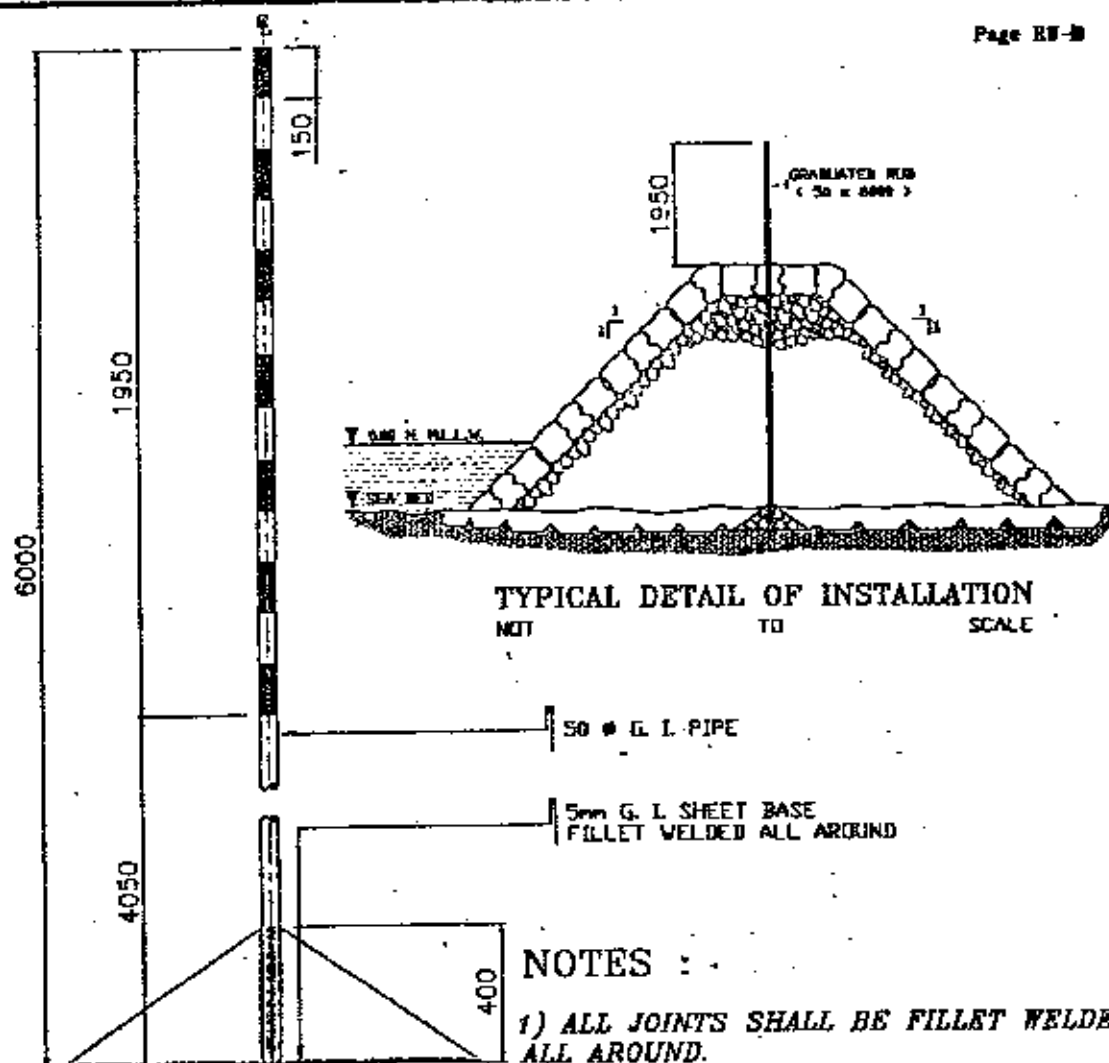


ELEVATION

SCALE 1:20

NOTES :

- 1) ALL JOINTS SHALL BE FILLET WELDED ALL AROUND.
- 2) THE GRADUATED SETTLEMENT ROD INCLUDING THE BASE SHALL BE PAINTED WITH TWO (2) COATS OF ANTI-RUST PAINT AND THE 1.95 M. PAINTED WITH ALTERNATIVE BANDS OF RED AND WHITE ENAMEL, 0.15 M. LONG ALL AROUND.



PLAN

SCALE 1:20

DETAILS OF STANDARD GRADUATED SETTLEMENT ROD

ITEM 11 : AGGREGATE SUB BASE COURSE

DESCRIPTION

This item shall consist of furnishing, placing and compacting an aggregate subbase course on a prepared subgrade in accordance with this Specification and the lines, grades and cross-sections shown on the Plans, or as directed by the Engineer.

MATERIAL REQUIREMENTS

Aggregate for subbase shall consist of hard, durable particles or fragments of crushed stone, crushed slag, or crushed or natural gravel and filler of natural or crushed sand or other finely divided mineral matter. The composite material shall be free from vegetable matter and lumps or balls of clay, and shall be of such nature that it can be compacted readily to form a firm, stable subbase.

The subbase material shall conform to the following Grading Requirements

Grading Requirements

Sieve Designation		Mass Percent Passing
Standard, mm	Alternate US Standard	
50	2"	100
25	1"	55 - 85
9.5	3/8"	40 - 75
0.075	No. 200	0 - 12

The fraction passing the 0.075 mm (No. 200) sieve shall not be greater than 0.66 (two thirds) of the fraction passing the 0.425 mm (No. 40) sieve.

The fraction passing the 0.425 mm (No. 40) sieve shall have a liquid limit not greater than 35 and plasticity index not greater than 12 as determined by AASHTO T 89 and T 90, respectively.

The coarse portion, retained on a 2.00 mm (No. 10) sieve, shall have a mass percent of wear not exceeding 50 by the Los Angeles Abrasion Tests as determined by AASHTO T 96.

The material shall have a soaked CBR value of not less than 25% as determined by AASHTO T 193. The CBR value shall be obtained at the maximum dry density and determined by AASHTO T 180, Method D.

CONSTRUCTION REQUIREMENTS

PLACING

The aggregate subbase material shall be placed at a uniform mixture on a prepared subgrade in a quantity which will provide the required compacted thickness. When more than one layer is required, each layer shall be shaped and compacted before the succeeding layer is placed.

The placing of material shall begin at the point designated by the Engineer. Placing shall be from vehicles especially equipped to distribute the material in a continuous uniform layer or windrow. The layer or windrow shall be of such size that when spread and compacted the finished layer be in reasonably close conformity to the nominal thickness shown on the Plans.

When hauling is done over previously placed material, hauling equipment shall be dispersed uniformly over the entire surface of the previously constructed layer, to minimize rutting or uneven compaction.

SPREADING AND COMPACTING

When uniformly mixed, the mixture shall be spread to the plan thickness, for compaction.

Where the required thickness is 150mm or less, the material may be spread and compacted in one layer. Where the required thickness is more than 150 mm, the aggregate base shall be spread and compacted in two or more layers of approximately equal thickness, and the maximum compacted thickness of any layer shall not exceed 150 mm. All subsequent layers shall be spread and compacted in a similar manner.

The moisture content of sub-base material shall, if necessary, be adjusted prior to compaction by watering with approved sprinklers mounted on trucks or by drying out, as required in order to obtain the required compaction.

Immediately following final spreading and smoothing, each layer shall be compacted to the full width by means of approved compaction equipment. Rolling shall progress gradually from the sides to the center, parallel to the centerline of the road and shall continue until the whole surface has been rolled. Any irregularities or depressions that develop shall be corrected by loosening the material at these places and adding or removing material until surface is smooth and uniform. Along curbs, headers, and walls, and at all places not accessible to the roller, the base material shall be compacted thoroughly with approved tampers or compactors.

If the layer of base material, or part thereof, does not conform to the required finish, the Contractor shall, at his own expense, make the necessary corrections.

Compaction of each layer shall continue until a field density of at least 100 percent of the maximum dry density determined in accordance with AASHTO T 180, Method D has been achieved. In-place density determination shall be made in accordance with AASHTO T 191/ASTM D 1556.

TRIAL SECTION

Before subbase construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for subbase, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

TOLERANCES

The aggregate base course shall be laid to the designed level and transverse slopes shown on the Plans. The allowable tolerances shall be in accordance with following:

Permitted variation from design THICKNESS OF LAYER	± 20 mm
Permitted variation from design LEVEL OF SURFACE	+ 10 mm -20 mm
Permitted SURFACE IRREGULARITY Measured by 3-m straight-edge	20 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.3%
Permitted variation from design LONGITUDINAL GRADE over 25 m in length	± 0.1%

METHOD OF MEASUREMENT

Aggregate Subbase Course will be measured by the cubic meter (m3). The quantity to be paid for shall be the design volume compacted in-place as shown on the Plans, and accepted in the completed course. No allowance will be given for materials placed outside the design limits shown on the cross-sections. Trial sections shall not be measured separately but shall be included in the quantity of subbase herein measured.

ITEM 12 : AGGREGATE BASE COURSE

DESCRIPTION

This item shall consist of furnishing, placing and compacting an aggregate base course on a prepared subgrade/subbase in accordance with this Specification and the lines, grades, thickness and typical cross-sections shown on the Plans, or as established by the Engineer.

MATERIAL REQUIREMENTS

Aggregate for base course shall consist of hard, durable particles or fragments of crushed stone, crushed slag or crushed or natural gravel and filler of natural or crushed sand or other finely divided mineral matter. The composite material shall be free from vegetable matter and lumps or balls of clay, and shall be of such nature that it can be compacted readily to form a firm, stable base.

In some areas where the conventional base course materials are scarce or non-available, the use of 40% weathered limestone blended with 60% crushed stones or gravel shall be allowed, provided that the blended materials meet the requirements of this item.

The base course material shall conform to the following Grading Requirements

Grading Requirements

Sieve Designation		Mass Percent Passing	
Standard mm	Alternate US Standard	Grading A	Grading B
50	2"	100	
37.5	1 - 1/2"	-	100
25.0	1"	60 - 85	-
19.0	3/4"	-	60 - 85
12.5	1/2"	35 - 65	-
4.75	No. 4	20 - 50	30 - 55
0.425	No. 40	5 - 20	8 - 25
0.075	No. 200	0 - 12	2 - 14

The fraction passing the 0.075 mm (No. 200) sieve shall not be greater than 0.66 (two thirds) of the fraction passing the 0.425 mm (No. 40) sieve.

The fraction passing the 0.425 mm (No. 40) sieve shall have a liquid limit not greater than 25 and plasticity index not greater than 6 as determined by AASHTO T 89 and T 90, respectively.

The coarse portion, retained on a 2.00 mm (No. 10) sieve shall have a mass percent of wear not exceeding 50 by the Los Angeles Abrasion test determined by AASHTO T 96.

The material passing the 19 mm (3/4 inch) sieve shall have a soaked CBR value of not less than 80% as determined by AASHTO T 193. The CBR value shall be obtained at the maximum dry density (MDD) as determined by AASHTO T 180, Method D.

If filler, in addition to that naturally present, is necessary for meeting the grading requirements or for satisfactory bonding, it shall be uniformly blended with the base course material on the road or in a pug mill unless otherwise specified or approved. Filler shall be taken from sources approved by the Engineer, shall be free from hard lumps and shall not contain more than 15 percent of material retained on the 4.75 mm (No. 4) sieve.

CONSTRUCTION REQUIREMENTS

PLACING

The aggregate base material shall be placed at a uniform mixture on a prepared sub-base/subgrade in a quantity which will provide the required compacted thickness. When more than one layer is required, each layer shall be shaped and compacted before the succeeding layer is placed.

The placing of material shall begin at the point designated by the Engineer. Placing shall be from vehicles especially equipped to distribute the material in a continuous uniform layer or windrow.

The layer or windrow shall be of such size that when spread and compacted the finished layer be in reasonably close conformity to the nominal thickness shown on the Plans.

When hauling is done over previously placed material, hauling equipment shall be dispersed uniformly over the entire surface of the previously constructed layer, to minimize rutting or uneven compaction.

SPREADING AND COMPACTING

When uniformly mixed, the mixture shall be spread to the plan thickness, for compaction.

Where the required thickness is 150mm or less, the material may be spread and compacted in one layer. Where the required thickness is more than 150 mm, the aggregate base shall be spread and compacted in two or more layers of approximately equal thickness, and the maximum compacted thickness of any layer shall not exceed 150 mm. All subsequent layers shall be spread and compacted in a similar manner.

The moisture content of sub-base material shall, if necessary, be adjusted prior to compaction by watering with approved sprinklers mounted on trucks or by drying out, as required in order to obtain the required compaction.

Immediately following final spreading and smoothening, each layer shall be compacted to the full width by means of approved compaction equipment. Rolling shall progress gradually from the sides to the center, parallel to the centerline of the road and shall continue until the whole surface has been rolled. Any irregularities or depressions that develop shall be corrected by loosening the material at these places and adding or removing material until surface is smooth and uniform. Along curbs, headers, and walls, and at all places not accessible to the roller, the base material shall be compacted thoroughly with approved tampers or compactors.

If the layer of base material, or part thereof, does not conform to the required finish, the Contractor shall, at his own expense, make the necessary corrections.

Compaction of each layer shall continue until a field density of at least 100 percent of the maximum dry density determined in accordance with AASHTO T 180, Method D has been achieved. In-place density determination shall be made in accordance with AASHTO T 191/ASTM D 1556.

TRIAL SECTION

Before base construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for subbase, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

TOLERANCES

The aggregate base course shall be laid to the designed level and transverse slopes shown on the Plans. The allowable tolerances shall be in accordance with following:

Permitted variation from design THICKNESS OF LAYER	± 10 mm
Permitted variation from design LEVEL OF SURFACE	+ 5 mm -10 mm
Permitted SURFACE IRREGULARITY Measured by 3-m straight-edge	5 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.2%
Permitted variation from design LONGITUDINAL GRADE over 25 m in length	± 0.1%

METHOD OF MEASUREMENT

Aggregate Base Course will be measured by the cubic meter (m³). The quantity to be paid for shall be the design volume compacted in-place as shown on the Plans, and accepted in the completed base course. No allowance shall be given for materials placed outside the design limits shown on the cross-sections. Trial sections shall not be measured separately but shall be included in the quantity of aggregate base course.

ITEM 13 : CEMENT TREATED BASE COURSE

1.0 SCOPE OF WORK

- 1.1. The work under this Section to be carried out by the Contractor, consists of the construction of Cement Treated Base Course for the pavement composed of aggregate, Portland cement and water in proper proportions, plant-mixed and constructed on prepared subbase in accordance with the specifications herein and in conformity with the lines, levels, grades, thickness and typical cross-sections indicated on the Drawings, and as specified herein.
- 1.2. The Contractor shall, before any work on the cement treated base course is started, design the material proportions in accordance with the requirements of this Section and the Drawings, and secure the Engineer's approval of the materials to be used, and the method of work execution.
- 1.3. Before commencement of the work under this Section, the Contractor shall submit Method Statement stating work plan, materials, design the material proportions, schedule, quality control plan, safety control plan and personnel to be engaged in this work for approval of the Engineer.
- 1.4. The Contractor shall also prepare the finishing elevation drawing of the area for this work in accordance with the design drawings for approval of the Engineer.

2.0 MATERIALS REQUIREMENTS

2.1. Cement

- (1) The cement shall conform to the requirements in Reinforced Concrete Specification.
- (2) All bags showing initial setting or lumps of caked cement, as well as half used bags, shall be rejected.

2.2. Aggregates

- (1) Aggregates shall consist of natural sand, crushed stone or other inert materials with similar characteristics, or combinations thereof, having hard, strong and durable particles approved by the Engineer.
- (2) The Aggregate shall not contain more than 3 percent of material passing the 0.075 mm (no. 200 sieve) by washing nor more than 1 percent each of clay lumps or shale. The use of beach sand will not be allowed.
- (3) If the fine aggregate is subjected to 5 cycles of the sodium sulfate soundness test, the weighed loss shall not exceed 10 percent.

2.3. Portland Cement

- (1) Only Type I Portland Cement conforming to ASTM C 150 shall be used unless otherwise provided for. Different brands or the same brand from different mills shall not be mixed nor shall they be used alternately unless the mix is approved by the Engineer.
- (2) Cement which for any reason has become partially set or which contains lumps of caked cement will be rejected. Cement salvaged from discarded or used bags shall not be used.

- (3) Samples of cement shall be obtained in accordance with AASHTO T127.

2.4. Water

- (1) Water used in mixing, curing or other designated applications shall be reasonably clean and free of oil, salt, acid, alkali, grass or other substances injurious to the finished product. Water will be tested in accordance with Reinforced Concrete Specifications.
- (2) Water which is drinkable may be used without test. Where the source of water is shallow, the intake shall be so enclosed as to exclude silt, mud, grass or other foreign materials.

2.5. Proportioning of Mixture

- (1) The amount of cement to be added to the soil-aggregate shall be from 6 to 10 mass percent of the dry soil. The exact percentage to be added shall be fixed by the Engineer on the basis of preliminary laboratory tests and trial mixes of the materials furnished by the Contractor.
- (2) The mixture shall have the following grading characteristics:

Table 1 – Mixture Gradation (CTBC)

Sieve Designation	Percent passing cement/aggregate mix	
	Minimum	Maximum
2" (19 mm)	85	100
3/8" (9.50 mm)	55	80
1/4" (6.35 mm)	42	66
No. 4 (4.75 mm)	32	56
No. 10 (2 mm)	23	43
No. 40 (0.50 mm)	11	26
No. 80 (0.20 mm)	7	17
No. 200 (0.075 mm)	4	10

2.6. Strength Requirements

- (1) The cement content for construction shall be that at which the mix develops a 7-day compressive strength of at least 5.20 MPa (53 kgs/cm², 750 psi).
- (2) The testing procedure shall be as follows: mold and cure specimens in accordance with ASTM D 560; soak specimens in water for 4 hours; cap and break specimens in compression in accordance with ASTM D 1633.
- (3) CBR Test for Gravelly Soils. The mixture passing the 19 mm (3/4 inch) sieve shall have a minimum soaked CBR-value of 100% tested according to AASHTO T 193. The CBR-value shall be obtained at the maximum dry density determined according to AASHTO T 180, Method D.
- (4) Unconfined Compression Test for Finer Textured Soils. The 7-day compressive strength of laboratory specimen molded and compacted in accordance with ASTM D 1632 to a density of 100% of maximum dry density

determined according to AASHTO T 134, Method B, shall not be less than 2.1 MPa (300 psi) when tested in accordance with ASTM D 1633.

2.7. Mix Design

- (1) The mix design shall be submitted to the Engineer for approval and shall be accompanied by test data. A change in the source of materials during the progress of work may necessitate a new design mix.
- (2) The mix design shall determine with accuracy the aggregate grading, the cement content and the required water content.

3.0 STORAGE OF MATERIALS

3.1. Storage of Portland Cement

- (1) Cement shall be stored in a cement silo or damp proof warehouses, and used on first in/ first out basis.
- (2) The Contractor shall, when storing cement in a cement silo, exercise care not to cause lump of cement sticking to the bottom of silo. Bagged cement shall be stacked on the warehouse floor which has been raised by not less than 30 cm above the surrounding ground in such a way to afford easy inspection and handling. Bags of cement shall not be stacked more than 13 bags in height.
- (3) Cement which has been stored for a long period and has not passed a pertinent quality test carried out before use or which contains caked lumps, shall not be used.
- (4) The Contractor shall cool cement before use if it has been warmed, having been stored in a hot place. Prior to construction, laboratory tests of the approved soil material shall be made to determine the quantity of cement required in the mix.

3.2. Storage of Aggregate

- (1) The Contractor shall stockpile coarse and fine aggregate according to their sizes with proper partitions in between.
- (2) The Contractor shall take measures to maintain skin moisture content of stockpiled aggregate uniform in the entire mass by providing shade over the aggregate, water sprinkling or other means.
- (3) Care shall be exercised when receiving, storing and handling the aggregate not to cause segregation of sizes or allow mixture of dirt, mud or other foreign materials into the aggregate.
- (4) The Contractor when stockpiling aggregate under hot climate shall take measure to prevent direct exposure to the sunlight such as a shade not to excessively heat or dry the aggregate.

4.0 CONTRACTOR'S EQUIPMENT AND PLANT

- 4.1. Equipment and tools necessary for handling materials and performing all parts of the work shall be approved by the Engineer as to design, capacity and mechanical condition.

- 4.2. The equipment shall be at the site sufficiently ahead of the start of construction operations to be examined thoroughly and approved.

5.0 CONSTRUCTION METHOD

5.1. Central Batching Plant Method

- (1) The aggregate shall be proportioned and mixed with cement and water in a central mixing plant. The plant shall be equipped with feeding and metering devices which will introduce the cement, aggregate and water into the mixer in the quantities specified. Mixing shall continue until a uniform mixture has been obtained.

5.2. Spreading, Compacting and Finishing

- (1) The material shall be spread by a mechanical spreader of approved type or asphalt paver. In spreading from the wind row, care shall be taken to avoid cutting into the underlying course.
- (2) Initial rolling shall be performed with pneumatic tire roller and final rolling with a 3 wheel or tandem-type steel wheel roller. Rolling shall be discontinued whenever it begins to produce excessive pulverizing of the aggregate or displacement of the mixture.
- (3) When the compacted thickness of the cement treated base course is to be more than 150 mm, the mixture shall be spread from the wind row and compacted in 2 approximately equal layers, the first layer to be bladed and rolled before the second layer is spread.
- (4) Compaction shall continue until field density of not less than 98% of the compacted maximum dry density determined in accordance with AASHTO T 180 Method D has been attained. Field Density test shall be in accordance with AASHTO T 191.
- (5) Where cement treated base is required under asphalt concrete pavement, the compacted cement treated base surface shall be scarified to produce corrugation and allow good bonding between layer of asphalt pavement and the cement treated base course.

5.3. Weather Limitations

- (1) The cement treated base shall not be applied during windy, rainy or impending bad weather. In the event rain occurs, work shall be promptly stopped and the entire section if damaged shall be reconstructed in accordance with the Specification.

5.4. Protection, Curing and Maintenance

After the cement treated base course has been finished as specified herein, the surface shall be protected against rapid drying for a period of at least five (5) days by either of the following curing methods:

- (1) Maintain in a thorough and continuously moist condition by sprinkling with water.
- (2) Cover the completed surface with a 50 mm layer of sand and maintain in moist condition.
- (3) Apply on the surface an asphalt membrane of the type and quantity approved by the Engineer.
- (4) Apply on the surface a liquid membrane curing compound of the type and quantity approved by the Engineer.

The Contractor shall be required to maintain at his own expense the entire work within the limits of his Contract in good condition satisfactory to the Engineer from the time he first started work until all work shall have been completed. Maintenance shall include immediate repairs of any defects that may occur before and after the lime-stabilized base course has been compacted and finished, which work shall be done by the Contractor at his own expense and repeated as may be necessary to keep the base continuously intact.

5.5. Trial Sections

- (1) Before construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor.
- (2) Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.
- (3) After final compaction of each trial section the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.
- (4) If a trial shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable, the materials shall be removed at the Contractor's expense and a new trial section shall be constructed.
- (5) If the basic conditions regarding the type of material or procedures change during the execution of the work, new trial section shall be constructed.

6.0 QUALITY CONTROL

- 6.1. The quality shall satisfy the standard values shown in Table 6.1

Table 6.1 – MATERIALS (CTBC)

WORK ITEM	TEST FORM	TEST METHOD	FREQUENCY	STANDARD VALUE
-----------	-----------	-------------	-----------	----------------

Cement Treated Base Course	Portland cement	As approved by the Engineer	Once for every 500 tons at receiving materials	To meet the requirements of Type 1 Portland Cement conforming to ASTM C 150 Manufacturer test data may be substituted as directed by the Engineer
	Gradation of aggregate	AASHTO T 11 and T 27 or equivalent	Once for every quarry	To meet the requirements of Table 20370.1
	Abrasion of aggregate	AASHTO T 96 or equivalent	- ditto -	Not more than 30%
	Soundness of aggregate	AASHTO T 104 or equivalent	- ditto -	Not more than 5%
	Water Absorption of aggregate	AASHTO T 84 and T 85 or equivalent	- ditto -	Not more than 3% (Dry specific gravity)
	Plasticity index	AASHTO T 90 or equivalent	- ditto -	Not more than 6 Aggregate passing No.40 sieve including mineral filler
	Moisture-density Relation	AASHTO T 180	Once for every 500 m ² at Point designated by the Engineer	-
	Density of Soil in Place by the Sand Cone Method	AASHTO T 191	Once for every 2,000 m ²	98 % or more
	Compressive Strength	ASTM D 560 and ASTM D 1633	Once for every 500 tons	More than 5.20 MPa (53 kgs/cm ² : 754 psi)

Table 6.2 – WORKMANSHIP (CTBC)

WORK ITEM	TEST FORM	TEST METHOD	FREQUENCY	TOLERANCE
Cement Treated Base Course	Finish elevation	As approved by the Engineer	Once for every 400 m ² at points designated by the Engineer	+ 5 mm/-10 mm
	Thickness	As approved by the Engineer	- ditto -	+0/- 5 mm
	Width	- ditto -	At point designated by the Engineer	+ Not specified - 15 mm
	Evenness of surface	By 3 meters straight edge	- ditto -	Within 5 mm of variation on 2 contacts

6.2. The workmanship shall be controlled in the manner shown in Table 6.2

6.3. Tolerances

- (1) The cement treated base course shall be laid to the designed level and transverse slopes shown on the Drawings. The allowable tolerances shall be in accordance with the following:

- (a) Permitted variation from design: Thickness of Layer : + 0/-10 mm
- (b) Permitted variation from design: Level of Surface : + 5/-10 mm
- (c) Permitted Surface Irregularity: measured by 3 m straight edge: 5 mm
- (d) Permitted variation from design: Cross-fall of Camber : $\pm 0.2\%$
- (e) Permitted variation from design: Longitudinal Grade over 25 m length: $\pm 0.1\%$

6.4. Traffic

- (1) The Contractor shall not be permitted to drive heavy equipment over completed portions prior to the end of 5 days curing period except pneumatic tired equipment required for constructing adjoining sections.

ITEM 14 : INTERLOCKING CONCRETE BLOCK PAVEMENT**SCOPE OF WORK**

This specification covers the construction of interlocking concrete block pavement on a prepared base courses and the laying of leveling course sand bedding all in accordance with the Specifications and Drawings.

MATERIAL REQUIREMENTS**CONCRETE**

Concrete for the interlocking concrete block shall be 41.4 MPa (6,000 psi). Mixing and casting shall be in accordance with the Section "Reinforced Concrete" and the form and dimensions shall be as shown on the Drawings.

Additional requirements shall be as follows:

Minimum 28 day compressive strength	-	41.4 MPa
Minimum aggregate	-	19 mm
Minimum water-cement ratio	-	0.47
Minimum cement content	-	470 kg/m ³

SAND LEVELLING COURSE (Sand Cushion)

Materials for sand cushion shall consist of sand with uncoated grains, free from injurious amount of dust, lumps of clay, soft or flaky particles, shale, alkali, organic matter, loam or other deleterious substances. Beach sand shall not be allowed for use.

EXECUTION**LAYING OF INTERLOCKING CONCRETE BLOCKS**

Concrete blocks shall be laid dry and shall have attained the minimum 28 day compressive strength of 41.4 MPa (6,000 psi). No block with chipped surface, cracks or fabricated not to the dimension and truly square as shown on the drawings shall be used in the block work.

Block work shall be done in uniform manner such that the lines along the length or across the length formed by the edges of the blocks shall remain parallel all throughout the length and width of the pavement and the corners of the pavement forced by the lines of the edge between blocks for all sides shall be 4mm. The top of blocks forming the surface of the pavement shall be kept to the line, grade, slope and elevation as shown on the drawings.

The placing pattern of Interlocking concrete blocks shall be 45 degrees herringbone.

JOINTING AND COMPACTION

After laying the edges, the Interlocking concrete blocks shall be initially compacted into the sand bedding by means of a five (5) Horse Power (HP) vibratory plate compactor for at least two (2) passes.

Spread jointing sand over the block surface and swept into the joints using a soft brush. A second compaction with the vibrating plate compactor shall be performed for at least two (2) passes. The Interlocking concrete block surface shall be proof rolled or compacted with an approved roller not less than 10 tons for at least two (2) passes to further seat the units in to the sand bedding. Lastly, excess jointing sand shall be swept off the surface.

SAND LEVELLING CUSHION

The sand shall be laid in thickness shown in the drawings spread out uniformly over the cement treated base (CTB) and in accordance with the lines and grades as directed by the Engineer.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

ITEM 15 : PORTLAND CEMENT CONCRETE PAVEMENT

SCOPE OF WORK

The works include the furnishing of all labor, materials and equipment required for the construction of gravel base course and concrete pavement. The works shall be in accordance with the lines and grades shown on the Drawings and in conformity with the Specifications.

MATERIAL REQUIREMENTS

Cement

Portland cement shall conform to the requirements of the Section "Reinforced Concrete".

Fine Aggregate

The fine aggregate shall be well-graded from coarse to fine and shall conform to the requirements of the Section "Reinforced Concrete".

Coarse Aggregate

Coarse aggregate shall conform to the requirements of the Section "Reinforced Concrete".

Water

Clean, fresh, potable water shall be used for the mixing of all concrete and mortar and shall be from a source approved by the Engineer. Sea water or brackish water shall not be used.

Admixture

Admixture shall only be used with the written permission of the Engineer. If air-entraining agents, water reducing agents, set retarders or strength accelerators are permitted to be used, they shall not be used in greater dosages than those recommended by the manufacturer, or as permitted by the Engineer. The cost shall be considered as already in the Contractor's unit cost bid for concrete.

TIE BARS AND SLIP BARS

Tie bars shall be deformed bars conforming to the requirements specified in AASHTO M 31 or M 42, except that rail steel shall not be used for tie bars that are to be bent and re-straightened during construction, sizes as indicated on the Drawings. The deformed bars shall be Grade 40 and shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard practice of the Concrete Reinforcement Steel Institute.

Slip bars shall be smooth round steel bars conforming to the requirements specified in AASHTO M 31 or plain M 42.

Joint Filler

Poured filler for joint shall conform to the requirements of AASHTO M173.

EXECUTION

Concrete Class

The concrete for pavement shall satisfy the following requirements:

Minimum 28-day comprehensive strength	:	24 MPa
Minimum Flexural Strength	:	3.8 MPa
Maximum Aggregate size	:	25 mm
Maximum water cement ratio	:	0.52

Proportioning, Consistency and Mixing of Concrete

The proportioning, consistency and mixing of concrete shall conform to the requirements of the Section "Reinforced Concrete".

Preparation

The base shall be watered and thoroughly moistened prior to placing of the concrete.

Formwork Construction

Formwork shall comply with the requirements of the Section "Reinforced Concrete". Forms shall be of steel, of an approved section and shall be straight and of a depth equal to thickness of the pavement at the edge. The base of the forms shall be of sufficient width to provide necessary stability in all directions. The flange braces must extend outward on the base not less than 2/3 the height of the form.

All forms shall be rigidly supported on a bed of thoroughly compacted material during the entire operation of placing and finishing the concrete. They shall be set with their faces vertical so as to produce a surface complying with the required tolerance.

Adjacent lanes may be used in lieu of forms for supporting finishing equipment provided that proper protection is afforded to the concrete of the adjacent lanes to prevent damage, and provided further that the surface of the concrete carrying the finishing equipment does not vary by more than 3mm in each meter length. Adjacent lanes in lieu of forms may not be used until the concrete is at least seven (7) days old. Flanged wheels of the finishing equipment shall not be operated on the concrete surface. The inside edge of supporting wheels of the finishing machine shall not operate closer than 100mm from the edge of the concrete lane.

Alternative to placing forms, slip-forming may be used. Slip-form paving equipment shall be equipped with the traveling side forms of sufficient dimensions, shape and strength to support the concrete laterally for a sufficient length of time during placement to produce pavement of the required cross section. No abrupt changes in longitudinal alignment of the pavement will be permitted. The horizontal deviation shall not exceed 20mm from the proper alignment established by the Engineer.