

#### **5.4. Protection, Curing and Maintenance**

After the cement treated base course has been finished as specified herein, the surface shall be protected against rapid drying for a period of at least five (5) days by either of the following curing methods:

- (1) Maintain in a thorough and continuously moist condition by sprinkling with water.
- (2) Cover the completed surface with a 50 mm layer of sand and maintain in moist condition.
- (3) Apply on the surface an asphalt membrane of the type and quantity approved by the Engineer.
- (4) Apply on the surface a liquid membrane curing compound of the type and quantity approved by the Engineer.

The Contractor shall be required to maintain at his own expense the entire work within the limits of his Contract in good condition satisfactory to the Engineer from the time he first started work until all work shall have been completed. Maintenance shall include immediate repairs of any defects that may occur before and after the lime-stabilized base course has been compacted and finished, which work shall be done by the Contractor at his own expense and repeated as may be necessary to keep the base continuously intact.

#### **5.5. Trial Sections**

- (1) Before construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor.
- (2) Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m<sup>2</sup> shall be made for every type of material and/or construction equipment/procedure proposed for use.
- (3) After final compaction of each trial section the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.
- (4) If a trial shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable, the materials shall be removed at the Contractor's expense and a new trial section shall be constructed.
- (5) If the basic conditions regarding the type of material or procedures change during the execution of the work, new trial section shall be constructed.

## 6.0 QUALITY CONTROL

6.1. The quality shall satisfy the standard values shown in Table 6.1

Table 6.1 – MATERIALS (CTBC)

WORK ITEM	TEST FORM	TEST METHOD	FREQUENCY	STANDARD VALUE
Cement Treated Base Course	Portland cement	As approved by the Engineer	Once for every 500 tons at receiving materials	To meet the requirements of Type I Portland Cement conforming to ASTM C 150 Manufacturer test data may be substituted as directed by the Engineer
	Gradation of aggregate	AASHTO T 11 and T 27 or equivalent	Once for every quarry	To meet the requirements of Table 20370.1
	Abrasion of aggregate	AASHTO T 96 or equivalent	- ditto -	Not more than 30%
	Soundness of aggregate	AASHTO T 104 or equivalent	- ditto -	Not more than 5%
	Water Absorption of aggregate	AASHTO T 84 and T 85 or equivalent	- ditto -	Not more than 3% (Dry specific gravity)
	Plasticity index	AASHTO T 90 or equivalent	- ditto -	Not more than 6 Aggregate passing No.40 sieve including mineral filler
	Moisture-density Relation	AASHTO T 180	Once for every 500 m <sup>2</sup> at Point designated by the Engineer	-
	Density of Soil in Place by the Sand Cone Method	AASHTO T 191	Once for every 2,000 m <sup>2</sup>	98 % or more
	Compressive Strength	ASTM D 560 and ASTM D 1633	Once for every 500 tons	More than 5.20 MPa (53 kgs/cm <sup>2</sup> : 754 psi )

**Table 6.2 – WORKMANSHIP (CTBC)**

<b>WORK ITEM</b>	<b>TEST FORM</b>	<b>TEST METHOD</b>	<b>FREQUENCY</b>	<b>TOLERANCE</b>
<b>Cement Treated Base Course</b>	Finish elevation	As approved by the Engineer	Once for every 400 m <sup>2</sup> at points designated by the Engineer	+ 5 mm/-10 mm
	Thickness	As approved by the Engineer	- ditto -	+0/- 5 mm
	Width	- ditto -	At point designated by the Engineer	+ Not specified - 15 mm
	Evenness of surface	By 3 meters straight edge	- ditto -	Within 5 mm of variation on 2 contacts

**6.2. The workmanship shall be controlled in the manner shown in Table 6.2**

**6.3. Tolerances**

(1) The cement treated base course shall be laid to the designed level and transverse slopes shown on the Drawings. The allowable tolerances shall be in accordance with the following:

- (a) Permitted variation from design: Thickness of Layer : + 0/-10 mm
- (b) Permitted variation from design: Level of Surface : + 5/-10 mm
- (c) Permitted Surface Irregularity: measured by 3 m straight edge: 5 mm
- (d) Permitted variation from design: Cross-fall of Camber : ± 0.2%
- (e) Permitted variation from design: Longitudinal Grade over 25 m length: ± 0.1%

**6.4. Traffic**

(1) The Contractor shall not be permitted to drive heavy equipment over completed portions prior to the end of 5 days curing period except pneumatic tired equipment required for constructing adjoining sections.

## ITEM 14 : INTERLOCKING CONCRETE BLOCK PAVEMENT

### SCOPE OF WORK

This specification covers the construction of interlocking concrete block pavement on a prepared base courses and the laying of leveling course sand bedding all in accordance with the Specifications and Drawings.

### MATERIAL REQUIREMENTS

#### CONCRETE

Concrete for the interlocking concrete block shall be 41.4 MPa (6,000 psi). Mixing and casting shall be in accordance with the Section "Reinforced Concrete" and the form and dimensions shall be as shown on the Drawings.

Additional requirements shall be as follows:

Minimum 28 day compressive strength	-	41.4 MPa
Minimum aggregate	-	19 mm
Minimum water-cement ratio	-	0.47
Minimum cement content	-	470 kg/m <sup>3</sup>

#### SAND LEVELLING COURSE (Sand Cushion)

Materials for sand cushion shall consist of sand with uncoated grains, free from injurious amount of dust, lumps of clay, soft or flaky particles, shale, alkali, organic matter, loam or other deleterious substances. Beach sand shall not be allowed for use.

### EXECUTION

#### LAYING OF INTERLOCKING CONCRETE BLOCKS

Concrete blocks shall be laid dry and shall have attained the minimum 28 day compressive strength of 41.4 MPa (6,000 psi). No block with chipped surface, cracks or fabricated not to the dimension and truly square as shown on the drawings shall be used in the block work.

Block work shall be done in uniform manner such that the lines along the length or across the length formed by the edges of the blocks shall remain parallel all throughout the length and width of the pavement and the corners of the pavement forced by the lines of the edge between blocks for all sides shall be 4mm. The top of blocks forming the surface of the pavement shall be kept to the line, grade, slope and elevation as shown on the drawings.

The placing pattern of Interlocking concrete blocks shall be 45 degrees herringbone.

## **JOINTING AND COMPACTION**

After laying the edges, the Interlocking concrete blocks shall be initially compacted into the sand bedding by means of a five (5) Horse Power (HP) vibratory plate compactor for at least two (2) passes.

Spread jointing sand over the block surface and swept into the joints using a soft brush. A second compaction with the vibrating plate compactor shall be performed for at least two (2) passes. The Interlocking concrete block surface shall be proof rolled or compacted with an approved roller not less than 10 tons for at least two (2) passes to further seat the units in to the sand bedding. Lastly, excess jointing sand shall be swept off the surface.

## **SAND LEVELLING CUSHION**

The sand shall be laid in thickness shown in the drawings spread out uniformly over the cement treated base (CTB) and in accordance with the lines and grades as directed by the Engineer.

## **SURVEYS AND SETTING OUT WORKS**

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

## ITEM 15 : PORTLAND CEMENT CONCRETE PAVEMENT

### SCOPE OF WORK

The works include the furnishing of all labor, materials and equipment required for the construction of gravel base course and concrete pavement. The works shall be in accordance with the lines and grades shown on the Drawings and in conformity with the Specifications.

### MATERIAL REQUIREMENTS

#### Cement

Portland cement shall conform to the requirements of the Section "Reinforced Concrete".

#### Fine Aggregate

The fine aggregate shall be well-graded from coarse to fine and shall conform to the requirements of the Section "Reinforced Concrete".

#### Coarse Aggregate

Coarse aggregate shall conform to the requirements of the Section "Reinforced Concrete".

#### Water

Clean, fresh, potable water shall be used for the mixing of all concrete and mortar and shall be from a source approved by the Engineer. Sea water or brackish water shall not be used.

#### Admixture

Admixture shall only be used with the written permission of the Engineer. If air-entraining agents, water reducing agents, set retarders or strength accelerators are permitted to be used, they shall not be used in greater dosages than those recommended by the manufacturer, or as permitted by the Engineer. The cost shall be considered as already in the Contractor's unit cost bid for concrete.

### TIE BARS AND SLIP BARS

Tie bars shall be deformed bars conforming to the requirements specified in AASHTO M 31 or M 42, except that rail steel shall not be used for tie bars that are to be bent and re-straightened during construction, sizes as indicated on the Drawings. The deformed bars shall be Grade 40 and shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard practice of the Concrete Reinforcement Steel Institute.

Slip bars shall be smooth round steel bars conforming to the requirements specified in AASHTO M 31 or plain M 42.

#### Joint Filler

Poured filler for joint shall conform to the requirements of AASHTO M173.

## EXECUTION

### Concrete Class

The concrete for pavement shall satisfy the following requirements:

Minimum 28-day comprehensive strength	:	24 MPa
Minimum Flexural Strength	:	3.8 MPa
Maximum Aggregate size	:	25 mm
Maximum water cement ratio	:	0.52

### Proportioning, Consistency and Mixing of Concrete

The proportioning, consistency and mixing of concrete shall conform to the requirements of the Section "Reinforced Concrete".

### Preparation

The base shall be watered and thoroughly moistened prior to placing of the concrete.

### Formwork Construction

Formwork shall comply with the requirements of the Section "Reinforced Concrete". Forms shall be of steel, of an approved section and shall be straight and of a depth equal to thickness of the pavement at the edge. The base of the forms shall be of sufficient width to provide necessary stability in all directions. The flange braces must extend outward on the base not less than 2/3 the height of the form.

All forms shall be rigidly supported on a bed of thoroughly compacted material during the entire operation of placing and finishing the concrete. They shall be set with their faces vertical so as to produce a surface complying with the required tolerance.

Adjacent lanes may be used in lieu of forms for supporting finishing equipment provided that proper protection is afforded to the concrete of the adjacent lanes to prevent damage, and provided further that the surface of the concrete carrying the finishing equipment does not vary by more than 3mm in each meter length. Adjacent lanes in lieu of forms may not be used until the concrete is at least seven (7) days old. Flanged wheels of the finishing equipment shall not be operated on the concrete surface. The inside edge of supporting wheels of the finishing machine shall not operate closer than 100mm from the edge of the concrete lane.

Alternative to placing forms, slip-forming may be used. Slip-form paving equipment shall be equipped with the traveling side forms of sufficient dimensions, shape and strength to support the concrete laterally for a sufficient length of time during placement to produce pavement of the required cross section. No abrupt changes in longitudinal alignment of the pavement will be permitted. The horizontal deviation shall not exceed 20mm from the proper alignment established by the Engineer.

## Joints

All joints, longitudinal, transverse, etc., shall be constructed as shown on the Drawings and shall be clean and free of all foreign material after completion of shoulder work prior to acceptance of the work and in accordance with the following provisions:

### Longitudinal and Transverse Contact Joints:

Longitudinal contact joints are joints formed between lanes that are poured separately. Transverse contact joints are joints formed between segments of a lane that are poured separately. Transverse contact joints shall be formed perpendicular to pavement centerline at the end of each day of concrete placing, or where concreting has been stopped for 30 minutes or longer but not nearer than 1.5 meters from sawed contraction joints. All contact joints shall have faces perpendicular to the surface of the pavement. Tie bars of the size, length and spacing shown on the Drawings shall be placed across longitudinal and transverse contact joints.

## Placing Concrete

The concrete shall be deposited and spread in order that segregation will not occur and place a uniform layer of concrete whose thickness is approximately 20 mm greater than that required for the finished pavement is placed. Rakes shall not be used for handling concrete.

In order to prevent the introduction into the concrete of earth and other foreign materials, the men whose duties require them to work in the concrete, shall in general, confine their movements to the area already covered with fresh concrete. Whenever it becomes necessary for these men to step out of the concrete, their footwear shall be washed or otherwise thoroughly cleaned before returning to the concrete. Repeated carelessness with regard to this detail will be deemed sufficient cause for removing and replacing such worker.

During the operation of striking off the concrete, a uniform ridge of concrete at least 70 mm in height shall be maintained ahead of the strike-off screed for its entire length. Except when making a construction joint, the finishing machine shall at no time be operated beyond that point where this surplus can be maintained in front of the strike-off screed.

After the first operation of the finishing machine, additional concrete shall be added to all low places and honeycombed spots and the concrete rescreeded. In any rescreeding, a uniform head of concrete shall be maintained ahead of the strike-off for its entire length. Honeycombed spots shall not be eliminated by tamping or grouting.

Workers on the job shall have mobile footbridges at their disposal so that they need not walk on the wet concrete.

In conjunction with the placing and spreading, the concrete shall be thoroughly spaded and vibrated along the forms, bulkhead, and joints.

The internal vibrators shall be of pneumatic, gas-driven, or electric type, and shall operate at a frequency of not less than 3,200 pulsations per minute.

Whenever the placing of the concrete is stopped or suspended for any reason, for a period of 30 minutes or longer, a suitable bulkhead shall be placed so as to produce a vertical transverse joint. If an emergency stop occurs within 2.5 meters of the contraction or an expansion joint the concrete shall be removed back to the joint. When the placing of the concrete is resumed, the bulkhead shall be removed and a new concrete placed and vibrated evenly and solidly against the face of previously deposited concrete. Any concrete



in excess of the amount needed to complete a given section or that has been deposited outside the forms shall not be used in the work.

The Contractor shall provide suitable equipment for protecting the fresh concrete in case of rain, such as screens which will cause the rain water to run off beyond the edges of the paving, rain proof tarpaulins or other methods approved by the Engineer. The equipment shall be sufficient to shelter from rain all areas equal to that paved in two hours of work.

### Finishing Concrete

The concrete shall be compacted and finished by a mechanical, self-propelled finishing machine of approved type, having two independently operated screeds. If a machine possessing only one screed is approved, the screed will not be less than 450 mm wide and shall be equipped with compensating springs to minimize the effect of the momentum of the screed on the side forms. The number of driving wheels, the weight of the machine and the power of the motor shall be so coordinated as to prevent slippage. The top of the forms and the surface of the finishing machine wheels shall be kept free from concrete or dirt.

The machine shall at all times be in first-class mechanical condition and shall be capable of compacting and finishing the concrete as herein described. Any machine which causes displacement of the side forms from the line or grade to which they have been properly set, or causes undue delay due to mechanical difficulties, shall be removed from the work and replaced by a machine meeting the Specifications.

The finishing machine shall be operated over each section of pavement two or more times and at such intervals as will produce the desired results. Generally, two passes of the finishing machine are considered the maximum desirable.

The concrete shall be vibrated, compacted, and finished by a vibratory finishing machine. The vibratory machine shall meet the requirements for ordinary finishing, and shall be one of the following type:

1. The machine shall have two independently operated screeds; the front screed shall be equipped with vibratory units with a frequency of not less than 3,500 pulsations per minute. There shall be not less than one vibratory unit for each 2.5 meters length or portion thereof, of vibratory screed surface. The front screed shall not be less than 300mm wide and shall be equipped with a "bull nose" front edge built on a radius of not less than 50mm. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass, but not more than two passes, unless otherwise directed, or ;
2. The machine shall be equipped with an independently operated vibratory "pan" (or pans) and two (2) independently operated screeds, the "pan" shall be mounted in a manner that will permit it to come in contact with the forms and will permit vibration of the full width of lane simultaneously.

There shall be not less than one vibratory unit for each 2 m. length or portion thereof, of vibrating pan surface. The vibratory units in any individual pan shall be synchronized and have a frequency of not less than 3,500 pulsations per minute. The front screed shall be capable of operating in a position that will strike off the concrete at a sufficient height above the top of the forms to allow for proper compaction with the vibrating pan. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass but not more than two passes, unless otherwise directed.

After the final pass of the finishing machine and when the concrete has started to dry, the surface of the pavement shall be finished with an approved longitudinal float. The float may be operated either manually or by mechanical means. The float may be either of wood or metal shall be straight and smooth and light in weight so as not to displace or sink into the concrete surface.

To be effective, the float shall be at least 300mm wide and 3m long. When manually operated, the float shall be moved from edge to edge with a wiping motion and advance one (1) meter or more.

The succeeding trip shall overlap the previous trip. A light smoothing lute at least 3 meters long may be used provided approved by the Engineer.

The surface of the pavement shall be tested by the Contractor, before the final belting, with an approved standard straightedge 3 meter in length. Irregularities so detected shall be corrected immediately. Special attention shall be given to the concrete adjacent to transverse joints to insure that the edges thereof are not above the grade specified or the adjacent concrete below grade. All depressions or projections shall be corrected before any initial set has developed in the concrete.

After the concrete has been brought to the required grade, contour and smoothness, it shall be finished by passing over the concrete a drag of one or two burlap clothes, which give the surface the required roughness. The vehicles used to carry these cloths may be independent of the concrete-laying machine or may be incorporated with it and may be operated either by hand or mechanically.

Hand finishing will be permitted only on variable width sections of the pavement and other places where the use of the finishing machine would be impractical. Hand finishing shall be accomplished by means of the hand-operated strike-off template of either steel or steel-shod wood construction. The striking template shall be operated forward with a combined longitudinal and transverse motion and shall be so manipulated that neither end will be raised off the side forms. A similar tamper shall be used for tamping the concrete.

As soon as the concrete has attained its initial set, the edges of the pavement, the longitudinal joints, the construction dummy and expansion joints not sawn shall be carefully finished with an edging tool having radius of at least 5mm. The tools, the special accessories for cutting impressed joints and methods of workmanship shall be such as will produce a joint whose edges are of the same quality of concrete as the other portion of the pavement. Methods and workmanship which make use of excess mortar or grout in this area shall be eliminated. Unnecessary tool marks shall be eliminated during work, and the edges left smooth and true to line.

### Striking Forms

Forms shall remain in place at least 12 hours after the concrete has been placed. When working conditions are such that the early strength gain of the concrete is delayed, the forms shall remain in place for a longer period, as directed by the Engineer. Bars or heavy load shall not be used against the concrete when still in the forms. Any damage to concrete resulting from form removal shall be repaired promptly by the Contractor as directed by the Engineer without any additional payment to the Contractor.

## Curing Concrete

Unless otherwise ordered by the Engineer, curing of concrete shall be done by any method specified in the Section "Reinforced Concrete".

## Cleaning and Sealing Joints

After completion of the required curing and before opening of the pavement to traffic, all joints shall be thoroughly cleaned of all concrete aggregate fragments or other materials.

After removal of side forms, the ends at transverse expansion joints at the edges of the pavement shall be carefully cleaned of any concrete within the expansion spaces for the entire depth of slab, care being taken not to injure the ends of the joints. Expansion and contraction joints shall then be poured with a hot joint sealer to the depth as indicated on the Drawings. Joint sealer shall be poured using approved hand pouring pots, with liquid at a temperature not less than that recommended by the approved manufacturer.

## Opening to Traffic

The pavement shall be closed to traffic, including the vehicles of the Contractor, for a period of 10 days after the concrete is placed or longer if in the opinion of the Engineer, the weather conditions make it necessary to extend this time. The Contractor shall furnish, place and maintain satisfactory barricades and lights as directed, to exclude all traffic from the pavement.

Any damage to the pavement due to traffic shall be repaired or replaced at the expense of the Contractor. Paving mixers, mechanical concrete spreaders and finishers and other heavy paving equipment shall not be operated on completed concrete lanes in order to construct alternate lanes until after the regular curing period is completed. Even then, planks shall be laid on the finished pavement or other precautions taken to prevent damage to the concrete pavement.

## Pavement Smoothness, Thickness and Tolerance

Portland cement concrete pavement shall be constructed to the designed level and transverse slope shown on the Drawing. The allowable tolerance shall be as listed hereunder:

- |    |  |         |
|----|--|---------|
| 1. | Permitted variation from design thickness of layer | + - 5mm |
| 2. | Permitted variation from design level of surface   | + - 5mm |

The thickness of the pavement will be determined by measurement of cores from the completed pavement in accordance with AASHTO T 148.

The completed pavement shall be accepted on a lot basis. A lot shall be considered as 2,500 sq.m of pavement. The last unit in each slab constitutes a lot in itself when its length is at least  $\frac{1}{2}$  of the normal lot length. If the length of the last unit is shorter than  $\frac{1}{2}$  of the normal lot length, it shall be included in the previous lot.

Other areas such as intersections, entrances, crossovers, ramp, etc., will be grouped together to form a lot. Small irregular areas may be included with other unit areas to form a lot.

**ITEM 16 : STEEL AND METAL WORKS****GENERAL**

General Requirements contain provisions and requirements essential to these specifications; and apply to this Section, whether or not referred to herein.

**SCOPE OF WORK**

The work includes the furnishing of all labor, materials, equipment and other incidentals necessary for the fabrication and installation of structural steel and miscellaneous metal works as specified in relevant items of these specifications and as indicated on the drawings.

**SUBMITTAL**

1. Before placing orders for materials for the steel and metal works, the Contractor shall submit to the Engineer for approval shop drawings for all steelwork. All project shop drawings shall show the dimension of all parts, method of construction, bolts, welding sectional areas and other details.
2. The detail of connections shown on the shop drawings shall be such as to minimize formation of pockets to hold condensation, water or dirt. A minimum gap between abutting angles and the like shall be provided wherever possible to eliminate any traps and facilitate maintenance painting.
3. No materials shall be ordered nor fabrication commenced until the shop drawings are approved by the Engineer.

**STORAGE OF MATERIALS**

Structural materials, either plain or fabricated, shall be stored above the ground upon platforms, skids, or other supports. Materials shall be kept free from dirt, grease, and other foreign matter and shall be protected from corrosion.

**MATERIAL REQUIREMENTS**

1. Unless specified herein all steel structures and metals shall conform with the requirements of "Steel and Metal Works." Connections where details are not specified or indicated herein, shall be designed in accordance with the American Institute of Steel Construction (AISC), Manual of Steel Construction, latest edition.
2. Structural steel works consisting of channels, gusset plates and other structural steel shape shall be as indicated on the drawings and shall be structural carbon steel conforming to ASTM A 36. Shapes shall be as given in AISC, Manual of Steel Construction.
3. High strength structural bolts, shall conform to ASTM A 325, Types 1 or 2. Nuts shall conform to ASTM A 560, Grade A, heavy hex style, except nuts 38 mm (1-1/2 inch) may be provided in hex style. Washers shall conform to ANSI B 18.22.1, Type B.
4. Electrodes for arc welding shall be E70 series conforming to American Welding Society Specifications A5.1.

5. Tests are required under the ASTM Standards for steel to be used in the Works and shall be carried out in the presence of the Engineer and at least four (4) days notice must be given to him of the dates proposed for such tests. Four (4) calendar days notice on which fabricated steelwork will be ready for inspection in the Contractor's yard.
6. Standard bolt shall conform to ASTM A 307 Carbon Steel Externally Threaded Standard Fasteners.

## **EXECUTION**

### **QUALIFICATION**

Qualification of steel fabricators, erectors and welders shall comply with the requirements.

### **FABRICATION REQUIREMENTS**

#### **1. Workmanship**

Fabrication shall be performed within the permissible tolerance by the approved fabricator. All workmanship shall be of the best quality with respect to internationally recognized standards of practice.

#### **2. Cutting**

Low-carbon structural steel may be cut by machine-guided torch instead of by shears or saw. Harmful notches, burrs, irregularities, etc., shall not be developed at the cut surface.

#### **3. Contact Faces**

Contact surfaces between bases or other elements bearing directly upon bearing plates shall be ground or milled as necessary for full effective bearing. Edges for welding shall likewise be properly prepared.

#### **4. Bolt Holes**

Bolt holes shall be according to engineering practice and as specified in these specifications. Gas burning of holes will not be permitted.

#### **5. High Strength Bolt Assembly Preparation**

Surfaces of high strength bolted parts in contact with bolt heads and nuts shall not have a slope of more than 1:20 with respect to a plane normal to the bolt axis.

Where the surface of a high strength bolted part has a slope of more than 1:20, a beveled washer shall be used to compensate for lack of parallelism.

High strength bolted parts shall fit solidly together when assembled and shall not be separated by gaskets or any other interposed compressible materials.

When assembled, all joint surfaces including those adjacent to washers shall be free of scale except tight mill scale, and shall be free from dirt, loose scale, burrs, and other defects that would prevent solid seating of parts.

Contact surfaces of friction-type joints shall be free from oil, paint, lacquer or galvanizing.

## 6. Welding

All welding shall be done only by welders certified as to their ability to perform in accordance with accepted testing requirement.

Welding of parts shall be in accordance with structural standards and the Standard Code for Arc and Gas Welding in Building Construction of AWS, and shall only be done where shown, specified, or permitted by the Engineer.

Damage to galvanized areas by welding shall be thoroughly cleaned with wire brushing and all traces of welding flux and loose or cracked zinc coating shall be removed prior to painting. The cleaned area shall be painted with two coats of zinc oxide-zinc dust paint. The paint shall be properly compounded with a suitable vehicle in the ratio of one part zinc oxide to four parts zinc dust by weight. As an alternative to the above, the Contractor may submit for approval the use of a galvanizing rod or galvanizing solder to repair damaged areas.

The welding machine shall be a stable welder, and have suitable functions for the dimension of materials to be welded. The auxiliary tools used for welding shall perform sufficiently and adequately.

The welding machine used for field welding shall be of readily adjustable for electric current.

## 7. Shop Assembly

Structural units furnished shall be assembled in the shop. An inspection shall be made to determine that the fabrication and the matching of the component parts are correct.

Jigs shall be used for the assembly of units as much as possible to maintain appropriate position of mutual materials.

Approval of the Engineer shall be required when drilling temporary bolt holes or welding temporary support to the assembled structure.

The tolerances shall not exceed those allowed by codes and each unit assembled shall be closely checked to insure that all necessary clearances have been provided and that binding does not occur in any moving part.

In order to maintain accurate finished dimensions and shape, appropriate reverse strain or restraint shall be provided as required. Assembly and disassembly work shall be performed in the presence of the Engineer, unless waived in writing by the Engineer any errors or defects disclosed shall be immediately remedied by the Contractor.

Before disassembly for shipment, component parts of the structures shall be match marked to facilitate erection in the field.

## FABRICATION TOLERANCES

### 1. Dimensional Tolerances for Structural Work

Dimensions shall be measured by means of an approved calibrated steel tape at the time of inspection. Unevenness of plate work shall not exceed the limitation of the standard mill practice as specified in the American Institute of Steel Construction, "Manual of Steel Construction".

### 2. Camber

Reverse camber in any structural steel members in excess of 1/1,000 of the span length shall cause rejection. The minimum dead load camber for any structural steel member shall be as allowed by Code, or otherwise specified.

## INSPECTION AND TEST OF WELDING

### 1. Inspection of Welding

Inspection of welding shall be executed for the following work phases.

#### a. Before Welding

Scum, angle of bevel, root clearance, cleaning of surface to be welded, quality of end tab, drying of welding rod.

#### b. During Welding

Welding procedure, diameter of coil and wire, type of flux, welding current and voltage, welding speed, welding rod position, length of arc, melting, cleaning of slag of each level under surface chapping, supervision of welding rod.

#### c. After Execution of Welding

Assurance of bead surface, existence of harmful defects, treatment of crater, quality of slag removal, size of fillet, dimension of extra fill of butt welding, treatment of end tab.

### 2. Testing of Welding

Twenty percent (20%) of welds contributing in the overall strength of the structure and which will be inaccessible for the inspection in service shall be tested.

Welding shall be tested by ultrasonic test to the extent specified herein or as directed by the Engineer.

Where partial inspection is required, the ultrasonic test shall be located at random on the welds so as to indicate typical welding quality.

If ten percent (10%) of the random ultrasonic tested indicate unacceptable defect, the remaining eighty percent (80%) of the welding shall be tested. Repair welding required shall be ultrasonic tested after the repairs are made.

## CORRECTIONS

In lieu of the rejection of an entire piece or member containing welding which is unsatisfactory or which indicates inferior workmanship, corrective measures may be permitted by the Engineer whose specific approval shall be obtained for making each correction. Defective or unsound welds or base steel shall be corrected either by removing and replacing the entire weld, or as follows.

1. Excessive convexity or overlap shall be reduced by grinding.
2. Undercuts, lack of weld shall be repaired with necessary reinforcement of weld after removal of any foreign materials such as slag, dust, oil, etc.
3. Any defects such as slag inclusions, incomplete fusion, or inadequate joint penetration, shall be completely removed, cleaned and re-welded.
4. Cracks in welds or base steel, shall be removed to sound steel throughout their length and 5cm beyond each end of the crack, followed by welding. The extent of the crack, depth and length, shall be ascertained by the use of acid etching, magnetic particle inspection or other equally positive means.

The removal of welded steel shall be done by chipping, grinding, oxygen cutting, oxygen gouging, or air carbon arc gouging and in such a manner that the remaining welded steel or base steel is not nicked or undercut. Defective portions of the welding shall be removed without substantial removal of the base steel.

## INSTALLATION

### 1. Installation Program

#### a. Prerequisite Condition

Prior to executing steel fabrication and field installation, the Contractor shall prepare a comprehensive installation program including engineering supervision organization, fabrication procedures, field installation procedures, material application, machinery applications, inspection procedure, scope and standard of quality judgment, and submit to the Engineer for approval.

#### b. Special Technical Engineering

Special technical engineering different from contract specifications can be applied upon receiving approval of the Engineer.

### 2. Installation Requirement

#### a. Setting of Anchor Bolt and Others

- a. 1. Anchor bolts shall be set in accurate position by using templates.
- a. 2. The setting method shall be proposed to the Engineer for his approval before setting starts.
- a. 3. The threads of bolt shall be cured with an appropriate method against rust and/or any damage before tightening.



- a. 4. Non-shrink mortar shall be placed under base plates, well cured to obtain the sufficient strength before bearing loads are applied to base plates.
- b. Temporary Bracing
  - b. 1. Temporary bracing shall be installed as necessary to stay assemblies and assume loads against forces due to transport, erection operations or other work.
  - b. 2. Temporary bracing shall be maintained in place until permanent work is properly connected and other construction installed as necessary for support, bracing or staying of permanent work.
  - b. 3. Extent and quality of temporary bracing shall be as necessary against wind and other loads, including seismic loads not less than those for which the permanent structure is designed to resist.
- c. Adequacy of Temporary Connections

During erection, temporary connection work shall be securely made by bolting and/or welding for all dead load, wind and erection stresses.
- d. Alignment

No permanent bolting or welding shall be done until the alignment of all parts with respect to each other shall be true within the respective tolerances required.
- e. Field Welding
  - e. 1. Any shop paint or surfaces adjacent to joints where field welding is to be executed shall be wire brushed to remove paint/primer.
  - e. 2. Field welding shall conform to the requirements specified herein, except as approved by the Engineer.
- f. High Strength Bolts

Final tightening of high strength bolts shall be done by using manufacturer's power operated equipment without any overstress to the threads.
- g. Correction of Errors
  - g. 1. Corrections of minor misfits by use of drift pins, and reaming, chipping or cutting will be permitted and shall be provided as part of erection work.
  - g. 2. Any errors to be corrected or adjusted, preventing proper assembly, shall be immediately reported to the Engineer, and such corrections or adjustments shall be made as necessary and approved by the Engineer.
  - g. 3. Cutting or alterations other than as approved will not be permitted.

#### **h. Erection**

- h. 1. Erection and installation shall be as per approved shop drawings.**
- h. 2. Each structural unit shall be accurately aligned by the use of steel shims, or other approved methods so that no binding in any moving parts or distortion of any members occurs before it is finally fastened in place.**
- h. 3. Operations, procedures of erection and bracing shall not cause any damage to works previously placed nor make overstress to any of the building parts or components. Damage caused by such operations shall be repaired as directed by the Engineer at no extra cost to the Employer.**

### **GALVANIZING**

#### **PREPARATION**

All mild steel parts exposed to weather shall be hot-dipped galvanized after fabrication in accordance with the requirements of ASTM A 123 or ASTM A 153. Prior to galvanizing, the surfaces shall be cleaned of dirt, weld splatter, grease, slag, oil, paint or other deleterious matters. The steel surfaces shall be chemically de-scaled and cleaned with the same abrasive blast or other suitable method as approved by the Engineer.

#### **COATING**

The zinc coating shall consist of uniform layers of commercially pure zinc free from abrasions, cracks blisters, chemical spots or other imperfections, and shall adhere firmly to the surface of the steel. The weight of zinc coating per square meter of actual surface shall not be less than 550 grams. Any surface damaged subsequent to galvanizing shall be given two coats of approved zinc rich paints.

#### **PAINTING**

This work shall consist of the preparation of the metal surfaces, the application, protection and drying of the painted surfaces, and supplying of all tools, tackle, scaffolding, labor and materials necessary for the entire work. Painting shall be applied in the field or shop as approved by the Engineer.

Unless otherwise specified or approved, all painting work for structural steel shall comply with the requirements of this Section.

#### **SHOP PAINTING**

All structural steel shall be given a shop primer after fabrication and cleaning before delivery to the site.

All steel work shall be thoroughly dried and cleaned of all loose mill scale, rust and foreign matters by means of sand blasting or other suitable methods approved by the Engineer before shop painting shall be applied. Each individual piece shall be painted prior to assembly. Portions where field welding or field contact with concrete is required shall not be painted.

Except for galvanized surfaces and items to be encased in concrete, clean ferrous metal surfaces shall be given one coat of Amerlock 400 Epoxy Primer at 100 Microns or approved equal. Additional coat shall be applied to surfaces that will be concealed or inaccessible for finish painting by Amerlock 400, Top Coat at 150 Microns with color or equivalent.

## FIELD PAINTING

After erection, the Contractor shall thoroughly prepare and clean the entire surface of all structural steel from all dirt, grease, rust or other foreign matters. The entire surface of all members shall then be field painted.

## MATERIALS

### 1. Structural Steel Work

- a. After surface preparation, steelwork shall be given one coat of approved prefabricating primer.
- b. Before final assembly of steelwork at the fabricator's shop, two shop coats of special red lead primer shall be applied to the surface of sections to be in permanent contact, meeting faces and all other concealed surfaces. After final assembly, but before delivery to the project site, the steelwork shall likewise be given two shop coats of special red lead primer.

### 2. Galvanized Steelwork

All galvanized steelwork shall be treated with zinc chromate two-pack etch primer followed by one coat of non-etch zinc chromate primer.

### 3. Miscellaneous Metal Work

Unless otherwise specified in other Sections of the Specifications or shown on the drawing, miscellaneous metal works such as ladders, structural steel ladder rungs, etc. shall be given two shop coats of epoxy primer and two coats of epoxy enamel.

## CONSTRUCTION METHODS

### 1. Cleaning of Surfaces

Surfaces of metal to be painted shall be thoroughly cleaned; removing rust, loose mill scale, dirt, oil or grease, and other foreign substances. Unless cleaning is to be done by sand blasting, all weld areas, before cleaning is started, shall be neutralized with a proper chemical, after which they shall be thoroughly rinsed with water.

Three methods of cleaning are provided herein. The particular method to be used shall be as directed by the Engineer.

### 2. Hand Cleaning

The removal of rust, scale, and dirt shall be done by the use of metal brushes, scrapers, chisels, hammers or other effective means. Oil and grease shall be removed by the use of gasoline or benzene.

Bristle or wood fiber brushes shall be used for removing loose dirt.

### **3. Sandblasting**

All steel shall be cleaned by sandblasting. The sandblasting shall remove all loose mill scale and other substances. Special attention shall be given to cleaning of corners and re-entrant angles. Before painting, sand adhering to the steel in corners and elsewhere shall be removed. The cleaning shall be approved by the Engineer prior to any painting which shall be done as soon as possible before rust forms.

### **4. Flame Cleaning**

All metal, except surface inside boxed members and other surfaces which shall be inaccessible to the flame cleaning operation after the member is assembled, shall be flame cleaned in accordance with the following operations.

- a. Oil, grease, and similar adherent matter shall be removed by washing with a suitable solvent. Excess solvent shall be wiped from the work before processing with subsequent operations.
- b. The surface to be painted shall be cleaned and dehydrated (free from occluded moisture) by the passage of oxyacetylene flames which have an oxygen to acetylene ratio of at least 1.0. The oxyacetylene flames shall be applied to the surfaces of the steel in such a manner and at such speed that the surfaces are dehydrated; dirt, rust loose scale in the form of blisters or scabs, and similar foreign matters are freed by the rapid, intense heating by the flames. The number arrangement and manipulation of the flames shall be such that all parts of the surfaces to be painted are adequately cleaned and dehydrated.
- c. Promptly after the application of the flames, the surfaces of the steel shall be wire brushed, hand scraped wherever necessary, and then swept and dusted to remove all free materials and foreign particles.
- d. Paint shall be applied promptly after the steel has been cleaned and while the temperature of the steel is still above that of the surrounding atmosphere.

### **5. Weather Conditions**

#### **a. Exterior Coatings**

Coatings to surface shall not be applied during foggy or rainy weather, or under the following surface temperature conditions: below 4°C, or over 35°C, unless approved by the Engineer.

#### **b. Interior Coatings**

Coatings shall be applied when surfaces to be painted are dry and the following surface temperatures can be maintained: between 18 to 35°C during the application.

**6. Application**

- a. Paint shall be factory tinted and mixed. All paint shall be field mixed before applying in order to keep the pigments in uniform suspension.
- b. Field Painting

When the erection work is complete, including all bolting and straightening of bent metal, all adhering rust, scale, dirt, grease or other foreign materials shall be removed as specified above.

As soon as the Engineer has examined and approved each steel and metal works structures, all field bolts, all welds, and any surfaces from which the top or first coat of paint has become worn off, or has otherwise come defective shall be cleaned and thoroughly covered with one coat of paint.

Surfaces to be bolted and surfaces which shall be in contact with concrete, shall not be painted. Surfaces which shall be inaccessible after erection shall be painted with such field coats as are required. When the paint applied for retouching the shop coat has thoroughly dried, and the field cleaning has been satisfactorily completed, such field coats as are required shall be applied. In no case shall a succeeding coat be applied until the previous coat is dry throughout the full thickness of the paint film. All small cracks and cavities which were not sealed in a watertight manner by the first field coat shall be filled with a pasty mixture of red lead and linseed oil before the second coat is applied.

The following provision shall apply to the application of both coats. To secure a maximum coating on edges of plates or shapes, bolt heads and other parts subjected to special wear and attack, the edges shall first be striped with a longitudinal motion and the bolt heads with a rotary motion of the brush, followed immediately by the general painting of the whole surface, including the edges and bolt heads.

The application of the second field coat shall be deferred until adjoining concrete work has been placed and finished. If concreting operations have damaged the paint, the surface shall be re-cleaned and repainted.

- c. General Manners

Painting shall be done in a neat and workmanlike manner. Paint may be applied with hand brushes or be spraying, except aluminum paint which preferably shall be applied by spraying. By either method the coating of paint applied shall be smoothly and uniformly spread so that no excess paint shall collect at any point. If the work done by spraying is not satisfactory to the Engineer hand brushing shall be required.

- d. Brushing

When brushes are used, the paint shall be so manipulated under the brush as to produce a smooth, uniform, even coating in close contact with the metal or with previously applied paint, and shall be worked into all corners and crevices.

**e. Spraying**

Power spraying equipment shall be used to apply the paint in a fine spray. Without the addition of any paint, the sprayed area shall be immediately followed by brushing, when necessary, to secure uniform coverage and to eliminate wrinkling, blistering and air holes.

**f. Removal of Paint**

If the painting is unsatisfactory to the Engineer the paint shall be removed and the metal thoroughly cleaned and repainted.

## **ITEM 17 : MOORING AND FENDERING SYSTEM**

### **SCOPE OF WORK**

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.
2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.
3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

### **MATERIAL REQUIREMENTS**

#### **MOORING SYSTEM**

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

#### **Base Steel:**

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

**Concrete Foundation :**

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

**Visual Inspection :**

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

**Mill Test Certificates:**

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

**Test Inspection:**

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.



## FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of Rubber Dock Fenders (RDF).

### PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

**Physical Properties and Test Method**

Test Item		Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	Test piece: Dumbell No. 3	ASTM D412
		Elongation		ASTM D1456
		Hardness	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation		ASTM D1456
		Hardness		ASTM D2240
	Compression Test		Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

### FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified and to the required shapes and sizes shown on the approved plan/drawings.

### TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

#### Testing

All rubber dock fenders shall be tested for performance. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

The standard performance testing methodology shall be Method B, to wit:

1. Fender temperature shall be stabilized at 23 degrees plus or minus 5 degrees centigrade for at least 24 hours before compression testing.
2. Break-in of fender by deflecting 3 times to rated deflection.
3. Removed load from the RDF and allow recovering for a minimum of 1 hour.
4. Deflect RDF at speed of 2-8 cm/min once to rated deflection.

The testing apparatus shall be calibrated and certified within plus or minus 1% in accordance with ISO or equivalent JIS or ASTM requirements. Calibration shall be traceable to a national/international standard and shall be performed annually by an accredited third party organization. The RDF performance testing center shall be subjected to accreditation by PPA and notation and /or certification by DPWH-BRS prior to acceptance.

### Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected by the Engineer for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

All RDF items/units shall be clearly numbered and marked indicated the following:

### Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%
2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,       $E \geq$  Specified E but not less than  
10% of the specified E

R = Reaction force,       $R \leq$  Specified R but not more than  
10% of the specified R

### Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project: \_\_\_\_\_

Year supplied      \_\_\_\_\_

### Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

## EXECUTION

### MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

## **ITEM 18 : ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL**

### **SCOPE OF WORK**

This specification covers the requirements for zinc coating (galvanizing) by the hot-dip process on iron and steel products made from rolled pressed and forged shapes, casting, plates, bars and strips.

This specification covers both fabricated and un-fabricated products, for example, assembled steel products, structural steel fabrications, large tubes already bent or welded before galvanizing, and wire work fabricated from uncoated steel wire. It also covers steel forgings and iron castings incorporated into pieces fabricated before galvanizing or which are too large to be centrifuged (or otherwise handled to remove excess galvanizing bath metal).

### **MATERIAL REQUIREMENTS**

#### **STEEL OR IRON**

The specification, grade or designation, and type and degree of surface contamination of the iron or steel in articles to be galvanized shall be supplied by the purchaser to the hot-dip galvanizer prior to galvanizing.

The presence in steels and weld metal, in certain percentages, of some elements such as silicon, carbon and phosphorus tends to accelerate the growth of the zinc-iron alloy layer so that the coating may have a matte finish with a little or no outer zinc layer.

### **EXECUTION**

#### **FABRICATION**

The design and fabrication of the product to be galvanized shall be in accordance to the plans and specifications. ASTM Practices A 143, A 384 and A 385 provide guidance for steel fabrication for optimum hot-dip galvanizing and shall be complied with in both design and fabrication.

#### **CASTINGS**

The composition of heat treatment of iron and steel castings shall conform to specifications designated by the purchaser. Some types of castings have been known to show potential problems being embrittled during normal thermal cycle of hot-dip galvanizing. The requirements for malleable iron castings to be galvanized are stipulated in ASTM specification A 47.

#### **ZINC**

The zinc used in the galvanizing bath shall conform to ASTM Specification B 6. If a zinc alloy is used as the primary feed to the galvanizing bath, then the base material used to make that alloy shall conform to ASTM Specification B 6.

#### **BATH COMPOSITION**

The molten metal in the working volume of the galvanizing bath shall contain not less than an average value of 98.0% zinc by weight.

## COATING PROPERTIES

Table 1 – Minimum Average Coating Thickness Grade by Material Category

Material Category	All Specimens Tested Steel Thickness Range (Measured), mm (in.)				
	< 1/16 (<1.6)	1/16 to < 1/8 (1.6 to < 3.2)	1/8 to < 3/16 (3.2 to 4.8)	> 3/16 to < 1/4 (> 4.8 to < 6.4)	≥ 1/4 (≥ 6.4)
Structural Shapes & Plate	45	65	75	85	100
Strip and Bar	45	65	75	85	100
Pipe and Tubing	45	45	75	75	75
Wire	35	50	60	65	80

## COATING THICKNESS

The average thickness of coating for all specimens tested shall conform to the requirements of Table 1 for the categories and thickness of the material being galvanized. Minimum average thickness of coating for any individual specimen is one coating grade less than that required in Table 1. Where products consisting of various material thicknesses or categories are galvanized, the coating thickness grades of each thickness range and material category of material shall be shown in Table 1. The specification of coating thickness heavier than those required by Table 1 shall be subject to mutual agreement between the galvanizer and Engineer.

For articles whose surface area is greater than 100,000 mm<sup>2</sup> (160 in.<sup>2</sup>) (multi-specimen articles), each test article in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. Each specimen coating thickness grade comprising that overall average for each test article shall average not less than one coating grade below that required in Table 1.

For articles whose surface area is equal to or less than 100,000 mm<sup>2</sup> (160 in.<sup>2</sup>) (single-specimen articles), the average of all test articles in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. For each test article, its specimen coating thickness shall not be less than one coating grade below that required in Table 1.

No individual measurement or cluster of measurements at the same general location on a test specimen shall be cause for rejection under this specification provided that when those measurements are averaged with the other dispersed measurements to determine the specimen coating thickness grade for that specimen, the requirements of the above specifications as appropriate are met.

The coating thickness grades in Table 1 represent the minimum value obtainable with a high level of confidence for the ranges typically found in each material category. While most coating thicknesses will be in excess of those values, some materials in each category may be less reactive (for example, because of chemistry or surface condition) than other materials of the steel category spectrum. Therefore, some articles may have a coating grade at or close to the minimum requirements shown in Table 1. In such cases, the precision and accuracy of the coating thickness measuring technique should be taken into consideration when rejecting such articles for coating thickness below that is required by this specification.

## FINISH

The coating shall be continuous (except as provided below), and as reasonably smooth and uniform in thickness as the weight size and shape of the item. Except for local excess coating thickness which would interfere with the use of the product or make it dangerous to handle (edge tears or spikes), rejection for non-uniform coating shall be made only for plainly visible excess coating not related to design factors such as holes, joints, or special drainage problems. Since surface smoothness is a relative term, minor roughness that does not interfere with the intended use of the product, or roughness that is related to the as-received (un-galvanized) surface condition, steel chemistry to zinc shall not be grounds for rejection.

Surfaces that remain uncoated after galvanizing may be renovated in accordance with the methods in ASTM Practice A 780 provided that the following conditions are met:

1. Each area subject to renovation shall be 25mm (1 in.) or less in its narrowest dimension.
2. The total area subject to renovation on each article shall be no more than  $\frac{1}{2}$  of 1% of the accessible surface area to be coated on that article, or 22,500mm<sup>2</sup> (36 in.<sup>2</sup>) per ton of piece weight, whichever is less. Inaccessible surface areas are those which cannot be reached for appropriate surface preparation and application of repair materials as described in ASTM Practice A 780.
3. The thickness of renovation shall be that is required by the thickness grade for the appropriate material category and thickness range in Table 1 in accordance with the coating thickness requirements, except that for renovation using zinc paints, the thickness of renovation shall be 50% higher than that required by table 1, but not greater than 0.0254mm (4.0 mils).
4. When areas requiring renovation exceed the criteria previously provide, or are inaccessible for repair, the coating shall be rejected.

## THREADED COMPONENTS IN ASSEMBLIES

The zinc coating on external threads shall not be subjected to a cutting, rolling or finishing tool operation, unless specifically authorized by the purchaser. Internal threads may be tapped or retapped after galvanizing. Coatings shall conform to the requirements of ASTM Specification A 153/A 153 M.

## APPEARANCE

Upon shipment from the galvanizing facility, galvanized articles shall be free from uncoated areas, blisters, flux deposits and gross dross inclusions. Lumps, projections, globules or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted. Plain holes of 12.5mm (1/2 in.) diameter or more shall be clean and reasonably free from excess zinc. Marks in the zinc coating caused by tongs or other items used in handling the article during the galvanizing operation shall not be cause for rejection unless such marks have exposed the base metal, and the bare metal areas exceed the criteria provided in number 1 and 2 of Subsection "Finish".

Whenever dross is present in a form other than finely dispersed pimples in the coating and is present in such amount as to be susceptible to mechanical damage, it will be considered as "gross".

## ADHERENCE

The zinc coating shall withstand handling consistent with the nature and thickness of the coating and the normal use of the article, without peeling or flaking. Although some material may be formed after galvanizing, in general the zinc coating on the articles covered by this specification is too heavy to permit severe bonding without damaging the coating.

## SAMPLING

A lot is a unit of production or shipment from which a sample may be taken for testing. Unless otherwise agreed upon between the galvanizer and the purchaser, or established within this specification, the lot shall be as follows:

1. For testing at a galvanizer's facility, a lot is one or more articles of the same type and size comprising a single order or a single delivery load, whichever is smaller, or any number of articles identified as a lot by the galvanizer, when these have been galvanized within a single production shift and in the same bath.
2. For test by the purchaser after delivery, the lot consists of the single order or the single delivery load, whichever is smaller, unless the lot identify, established in accordance with the above, is maintained and clearly indicated in the shipment by the galvanizer.

The method of selection and number of test specimens shall be agreed upon between the galvanizer and the purchaser. Otherwise, the test specimens shall be selected random from each lot. In this case, the minimum number of specimens from each lot shall be as follows:

Number of Pieces in Lot	Number of Specimens
3 or less	All
4 to 500	3
501 to 1,200	5
1,201 to 3,200	8
3,201 to 10,000	13
10,001 and over	20

A test specimen which fails to conform to any requirement of this specifications shall not be used to determine the conformance to other requirements.

## TEST REQUIREMENTS

### Magnetic Thickness Measurements:

The thickness of the coating shall be determined by magnetic thickness gauge measurements in accordance with ASTM Practice E 376. For each specimen, five or more measurements shall be made at points widely dispersed throughout the volume occupied by the specimen so as to represent as much as practical, the entire surface area of the test specimen. The average of the five or more measurements thus made for each specimen is the specimen coating thickness.

For articles whose surface area is greater than 100,000 mm<sup>2</sup> (160 in<sup>2</sup>), in the average of the three specimen coating thickness grades comprising each test article is the average coating thickness for that test article. A specimen must be evaluated for each steel category and material thickness within the requirements for each specimen of the test article

For articles whose surface area is equal to or less than 100,000 mm<sup>2</sup> (160 in<sup>2</sup>), the average of all specimen coating thickness grades is the average coating thickness for the sample.

The use of magnetic measurement method is appropriate for larger articles, and may be appropriate for smaller articles when such is practical using ASTM Practice E 376.

### Stripping Method

The average weight of coating may be determined by stripping a test article, a specimen removed from a test article, or group of test articles in the case of very small items such as nails, etc., in accordance with Test method ASTM A 90/A 90m. The weight of coating per unit area thus determined is converted to equivalent coating thickness values in accordance with Table 2, Coating Thickness Grade (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness, or in the case of a specimen removed from a test article, is the specimen average coating thickness.

Table 2 – Coating Thickness Grade <sup>A</sup>

Coating Grade	mils	oz/ft <sup>2</sup>	µm	g/m <sup>2</sup>
35	1.4	0.8	35	245
40	1.4	1.0	45	320
50	2.0	1.2	50	355
55	2.2	1.3	55	390
60	2.4	1.4	60	425
65	2.6	1.5	65	460
75	3.0	1.7	75	530
80	3.1	1.9	80	565
85	3.3	2.0	85	600
100	3.9	2.3	100	705

<sup>A</sup> Conversions in Table 2 are based on the metric thickness value equivalents from the next earlier version, using conversion factors consistent with Table X 2.1 in Specification A 653/A 653M, rounded to the nearest 5 µm (0.0002 in.). The conversion factors used are: mils = µm x 0.03937; oz/ft<sup>2</sup> = µm x 0.002316; g/m<sup>2</sup> = µm x 7.067.

### Weighing Before or After Galvanizing

The average of coating may be determined by weighing articles before and after galvanizing, subtracting the first weigh from the second and dividing the result by the surface area. The first weigh shall be determined after pickling and drying, and the second after cooling to ambient temperature. The weight of coating per unit area thus determined is converted to equivalent coating thickness values according to Table 2 (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness.



## Microscopy

The thickness of coating may be determined by cross-sectional and optical measurement in accordance with ASTM Test Method B 487. The thickness thus determined is a point value. No less than five such measurements shall be made at locations on the test article which are as widely dispersed as practical, so as to be representative of the whole surface of the test article. The average of no less than five such measurement is the specimen coating thickness.

## Adhesion

Determine adhesion of the zinc coating to the surface of the base metal by cutting or prying with the point of a stout knife, applied with considerable pressure in a manner tending to remove a portion of the coating. The adhesion shall be considered inadequate if the coating flakes off in the form of a layer of the coating so as to expose the base metal in advance of the knife point. Do not use testing carried out at edges or corners (points of lowest coating adhesion) to determine adhesion of the coating. Likewise, do not use removal of small particles of the coating by paring or whittling to determine failure.

## Embrittlement

Test for embrittlement may be made in accordance with ASTM Practice A 143

The galvanized article should withstand a degree of bending substantially the same as the ungalvanized article. Flaking or spalling of the galvanized coating is not be constructed as an embrittlement failure.

## Inspection, Rejection and Retest

The material shall be inspected at the galvanizer's plant prior to shipment. However, by agreement the purchaser may make the tests which govern the acceptance or rejection of the materials in his own laboratory or elsewhere.

When inspection of materials to determine conformity with the visual requirements of Subsection "Finish" warrants rejection of a lot, the galvanizer may sort the lot and submit it once again for acceptance after he has removed any nonconforming articles and replace them with conforming articles.

Materials have been rejected for reasons other than embrittlement may be stripped and re-galvanized, and again submitted for inspection and test at which time they shall conform to the requirements of this inspection.

## Transport and Storage

Galvanized components shall, wherever possible, be transported and stored under dry, well-ventilated conditions to prevent the formation of wet storage staining.

Either zinc phosphate or chromate passivation treatment after galvanizing may be used to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

Provided the coating thickness complies with the requirements of Subsection "Coating Thickness", no further remedial action is required to the stained areas.

## **ITEM 19 : CONSTRUCTION JOINTS**

### **SCOPE OF WORK**

This item shall consist of the manufacturing and installation of construction joints / expansion joints in accordance with the details, and at the locations, lines, grades and dimensions shown in the drawings.

### **MATERIAL REQUIREMENTS**

1. All construction joints / expansion joints shall be hot-dipped galvanized inside and out in accordance with international standards for galvanizing BS EN1460.
2. Painted finish shall be rejected.
3. All steel gratings and angle bars for construction joints / expansion joints shall be hot-dipped galvanized except for the nuts, washers and bolts which shall be stainless steel.
4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

The Contractor shall be required to submit test certificates for steel materials for the construction / expansion joints used in its manufacture; and for hot-dip galvanizing which shall meet or exceed the specifications under "Zinc Coating".

### **EXECUTION**

#### **DELIVERY, STORAGE AND INSTALLATION**

1. Upon delivery at site, the hot-dipped galvanized construction joints / expansion joints shall not be subjected to the following activities:
  - a. Re-fabrication
  - b. Cutting
  - c. Grinding
  - d. Welding
  - e. Sawing
  - f. Any hot works or similar activities
2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.
3. The construction joints / expansion joints shall not be exposed to sea water and other corrosive chemicals or substances prior to installation.

## **ITEM 20 : DRAINAGE WORKS**

### **SCOPE OF WORK**

The works shall consist of excavation, backfilling and construction of lateral drains, construction of manholes, reconnection to existing lateral and other related works in accordance with the dimensions, size, elevation and grade as shown on the drawing and shall conform with the Specification.

At least thirty (30) days before the start of any construction related to drainage works, the Contractor shall submit to the Engineer for his approval, shop drawings of the drainage work he intends to construct. The shop drawings shall include the materials and the general method of installation he intends to employ.

### **MATERIAL REQUIREMENTS**

#### **BACK FILL**

Fill shall be in accordance with Item "Reclamation and Fill".

#### **GRAVEL BEDDING**

Gravel Bedding/gravel base shall be in accordance with the specifications of Crushed Course Aggregates in "Reinforced Concrete".

#### **SAND BEDDING**

Sand bedding shall be in accordance with Item "Reinforced Concrete (Fine Aggregates)".

#### **CONCRETE**

Mixing/Casting and steel reinforcements shall be in accordance with Item "Reinforced Concrete" while the dimensions shall be as shown on the Drawings.

#### **CEMENT MORTAR**

Cement mortar shall consist of one part Portland cement to two parts of fine aggregate with water added as necessary to obtain the required consistency.

#### **REINFORCED CONCRETE PIPE**

The fabrication of reinforced concrete pipes shall conform to the Specifications of ASTM C 76 while the testing requirements shall conform to ASTM C 497. The Engineer reserves the right to inspect and test the pipe delivered for intended purpose. Defects that are discovered after acceptance of delivery of the pipe but before installation shall be a cause for rejection.

Standard reinforcement details and concrete strength shall be in accordance with DPWH "Standard Two Meter Concrete Pipe Culvert".

#### **STEEL GRATING**

The fabrication of grating shall conform to requirements of Steel and Metal Works" and "Zinc Coatings on Iron and Steel"

All steel grades and dimensions shall conform with the approved plans.

## **EXECUTION**

### **EARTHWORKS**

All earthworks for concrete pipe culvert shall conform to the lines, grades and elevations shown on the drawings or as directed by the Engineer.

The lateral drain shall be excavated to the depth, grade and width established by the Engineer. The bedding surface shall provide a firm foundation of uniform density throughout the entire length. Soft, spongy, or otherwise unstable material encountered that will not provide a firm foundation for the concrete drainage shall be removed to the full width of the trenches and replaced by suitable material to a depth of not less than 30 cm. 100mm thick gravel bedding shall be used as foundation or otherwise as specified.

### **PIPE LAYING**

The pipe shall be tested for water-tightness of joints before backfilling the trench. Unsatisfactory work shall be corrected without additional cost to the PPA. The collar shall have set sufficiently prior to backfilling.

Methods of installation and typical bedding for pipe conduits if not included in the plans, shall conformed to DPWH "Standard Two Meter Reinforced Concrete Culvert".

### **LATERAL DRAIN**

Concrete cover and the steel gratings shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces and shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

### **CATCH BASIN INLETS, MANHOLES AND OUTLETS**

Lid frames shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces. Lids shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

Where reconstruction of existing catch basin inlets, manholes, outlets, or similar structures are indicated, the work shall be in accordance to the details and elevations as shown on the drawings, including re-installation of existing metal frames, grates and lids, or replacing of concrete covers instead of grates that may have been lost or found lacking. All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

### **FIELD DENSITY TEST**

Field Density tests to determine the percent of compaction of the fill material shall be conducted until a field density of at least 95 percent of the maximum dry density in accordance with AASHTO T180, Method D has been achieved. In place density determination shall be made in accordance with AASHTO T191.

### **CLEARING AND DISPOSAL**

Dumping or disposal of un-used excavated materials shall be coordinated to PMO. If the excavated materials are determined for disposal, the contractor will provide all necessary works and expenses for its completion in concurrence by the Engineer.

## ITEM 21 : ELECTRICAL WORKS

### SCOPE OF WORK

The work to be done shall consist of furnishing, delivering and installing electrical materials/fixtures completed in accordance with all the details of the electrical works as shown on the drawings including materials, labor, tools and equipment and all incidental works as found necessary.

Refer to electrical plans/drawings for location and extent of work involved.

### GENERAL REQUIREMENTS

- a) All works shall be done in accordance with the requirements of the publications and agencies having jurisdiction, as well as the requirements of the approved standards.
  1. National Fire Protection Association - (NFPA)
  2. National Electrical Manufacturer Association - (NEMA)
  3. Underwriter Laboratories, Inc. - (UL)
  4. Philippine Electrical Code - (PEC)  
Philippine National Standard - (PNS)
  5. Federation Specification:  
Circuit Breaker, Molded Case, Branch  
Circuit and Service
  6. American National Standard Institute - (ANSI)
  7. American Society for Testing and Materials - (ASTM)
  8. Illuminating Engineering Society - (IES)
  9. Light Emitting Diode - (LED)
- b) The electrical power of the Port lighting system will be connected to the Main Disconnect Panel (MDP) located on the concrete pedestal post. While the supply voltage should be 230 volts, single phase (1Ø), and 60 hertz.
- c) The Contractor shall employ a licensed Registered Electrical Engineer or Master electrician to perform or to supervise and to conduct the continuous inspection of all electrical work.
- d) The Contractor shall first obtain approval from the Authority before procurement, fabrication or delivery of electrical materials to the site. Partial submittals will not be acceptable and will be returned without review. Submittals shall include the Manufacturer's Name, Trade Name, Place of Manufacture, Catalog Model or Number, Nameplate Data, Size, Layout Dimensions, Capacity, Project Specification and Paragraph Reference, Technical Society Publication References and other information necessary to establish contract compliance of each item to be furnished.
- e) All excavations fill and backfill and concrete works involved herein, shall be carried to the required elevations and shall conform to the provisions of specification under Earthwork and Concrete Construction of this tender document.

- f) The materials and equipment to be furnished shall be standard products of reputable manufacturer engaged in the reproduction of such materials and equipment.
- g) All permits and electrical fees required for this work shall be obtained at the expense of the Contractor. The Contractor shall furnish the Engineer-in-Charge, the final Certificates of Inspections and approval from the proper government authorities after the completion of work. The Contractor shall prepare all as- built plans and all other paper works as required by the enforcing authorities.
- h) The Contractor shall furnish and install electrical materials as shown in the drawings. A licensed Electrical Engineer or Master Electrician is required to implement the installation of the electrical system.
- i) Electrical installation shall conform to the requirements of Philippine Electrical Code (PEC) and the other approved standards.
- j) The contractor shall install all electrical works with the supervision of the qualified Registered Electrical Engineer (REE) or Master Electrician. All electrical installation applications regardless of capacity and voltage whether new, addition or revision shall be accompanied by electrical plans signed and sealed by a duly licensed Professional Electrical Engineer (PEE).

## **MATERIAL REQUIREMENTS**

All materials shall be brand new and shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark.

## **PRODUCTS**

### **WIRES AND CABLES**

The conductor material to be furnished and installed shall be copper wire Heat-Resistant Thermoplastic (THHN/THWN-2). All conductors shall be rated 600 volts insulation and shall be standard for all sizes.

### **CONDUIT AND FITTINGS**

Underground PVC conduit shall be polyvinyl chloride with concrete covered. It shall be manufactured to schedule 40 outside diameter. All fittings and bends shall be solvent bonded using manufacturers recommended product.

### **LED FLOODLIGHT FIXTURE 300 WATT**

#### **Specifications:**

Rated	: 300 watt LED or equivalent
Luminous Flux	: 42000 lm
Light Source	: High Brightness SMD LED
Color Temperature	: 5500K - 6500K / daylight
Color Temperature	: 3000K - 6000K / optional
Input Voltage	: AC 90-305 / 50-60 HZ
Material	: Aluminum Housing + Acrylic Cover
Beam Angle	: 140 degrees
Lifetime	: > 50,000 hours
IP Rating	: IP 65 outdoor

## **LED FLOODLIGHT FIXTURE 200 WATT**

### **Specifications:**

<b>Rated</b>	<b>: 200 watt LED Floodlight Fixture or equivalent</b>
<b>Input Voltage</b>	<b>: AC 85-265 / 50-60 HZ</b>
<b>Luminous Flux</b>	<b>: 20000 LM</b>
<b>Color Temperature</b>	<b>: 5500-6500k / Daylight</b>
<b>Light Source</b>	<b>: 4 layer of High Brightness LED Module</b>
<b>Material</b>	<b>: Die Cast Aluminum Alloy Housing</b>
<b>Beam Angle</b>	<b>: 120 degrees</b>
<b>Lifetime</b>	<b>: &gt; 50,000 hours</b>
<b>IP Rating</b>	<b>: IP 66 outdoor (water resistant, excellent for outdoor use)</b>

## **SINGLE ANGLE BAR FLOODLIGHT STEEL TAPERED LAMP POST**

Lamp Post shall be 10.0 m ht. Single Angle Bar Floodlight steel tapered and 12m.ht. Floodlight steel pole, furnished installed and tested as shown on the approved plans. The post/s shall be dimensioned for a wind velocity of 185 km/hr. It shall be locally fabricated or manufactured. The post shall be Hot -Dipped Galvanized, prime-coated with red lead and shall be painted at site with the final coating preferably aluminum paint to be approved by the Engineer.

## **EXISTING SOLAR LAMP POST**

The solar lamp post shall be installed as shown on the approved plans.

## **CONCRETE DUCT BANK**

The contractor shall construct concrete duct bank as shown in the approved plan.

## **SWITCHES:**

Weatherproof die cast aluminum switches and control panel board for lighting (NEMA-3R) attached to floodlight pole and single angle bar floodlight steel tapered lamp post

## **FLOODLIGHT POLE (12.00 meter height)**

Floodlight pole is to be hot-dip galvanized steel, designated as complete system with anchor bolts, steel ladder, hot-dip galvanized steel frame for mounting the number of floodlight fixtures are indicated on the approved plan.

A maintenance platform complete with safety rail should be provided as shown in the approved plan.

Anchor bolts are made of Stainless Steel to ensure that the floodlight pole assembly capacity can withstand all the stresses composed of wind, luminaires weight and live load of maintenance personnel.

## **LIGHTNING PROTECTION WITH ACCESSORIES**

It consists of air terminals, down conductors, ground connections, grounding electrodes as shown in the plan.

## **PROTECTIVE COATING FOR FLOODLIGHT POLE**

### **Hot Dipped Galvanizing**

All mild steel parts exposed to weather shall be hot-dipped galvanized after fabrication as shown in the approved plan or directed by the Engineer in accordance with the requirements of JIS H8864-1. Prior to hot-dip galvanizing, the surface shall be cleaned of dirt, weld splatter, grease, slag, oil, paint or other deleterious matters. The steel surfaces shall be chemically descaled and cleaned with abrasive blast or other suitable method as approved by the Engineer.

### **PANEL BOARD**

Panel board shall conform as shown on the approved plans with respect to supply characteristics, rating of main lugs or main circuit breaker, number and ratings and capacities of branch circuit breakers.

Panel board shall consist of a factory completed dead front assembly mounted in an enclosing NEMA-3R cabinet consisting of code gauge galvanized sheet steel box with trim and door.

Main and branch circuit breakers for panel board shall have the rating, capacity and number of poles as shown on the approved plans. Breakers shall be thermal magnetic type solid state-type with interrupting capacity of 10,000 amperes symmetrical minimum. Breaker terminal shall be UL listed as suitable for type of conductor provided. Breaker shall be the bolt-in type (that is, bolted to the current carrying bus). Plug-in circuit breakers are not acceptable.

## **EXECUTION**

### **INSTALLATION**

Floodlight Pole, single angle bar floodlight steel pole and solar lamp post shall be installed as shown on the approved plans including the re-location of existing solar lamp post.

**Pole Setting:** Depth as shown on the approved plans.

Construction of floodlight pole, single angle bar floodlight pole and solar lamp post foundation shall be in accordance with the shape and dimensions as shown on the approved plans.

Excavations / backfilling required before /after installation of single angle bar lamp post, solar lamp post and floodlight pole foundation with the trench shall conform to the provisions of Earthwork and Concrete construction.

**Metering:** the local utility company of Port of Dumaguite, Aklan , is responsible for the supply and installation of measuring equipment, and its accessories, but it is part of the contractor responsibility and expense to contact them about this.

### **WORKMANSHIP**

The work throughout shall be executed in the best and most thorough manner under the direction of and at the satisfaction of the Registered Electrical Engineer or Master Electrician, who will interpret the intent meaning of the drawings and specification and shall have the power to reject any work and materials which in his judgment, are not in full accordance therewith.



## **TESTING OPERATIONS**

When the electrical installation is completed, the Contractor shall test the installed electrical materials and equipment in the presence of Registered Electrical Engineer or Master Electrician. The system shall be free from any defects, shorts or grounds. The Contractor at no extra cost shall furnish all necessary instruments and personnel required for the testing.

## **GUARANTEE**

Upon completion and before final acceptance of the work, the Contractor shall furnish the Engineer a written guarantee stating that all works executed are free from defects on materials and workmanship. The guarantee shall be for a period of one year from the date of the final acceptance. Any work that becomes defective during the said period shall be corrected / replaced by the Contractor at his own expense in a manner satisfactory to the Authority.

**ITEM 22 : PROJECT BILLBOARD****SPECIFICATION**


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.



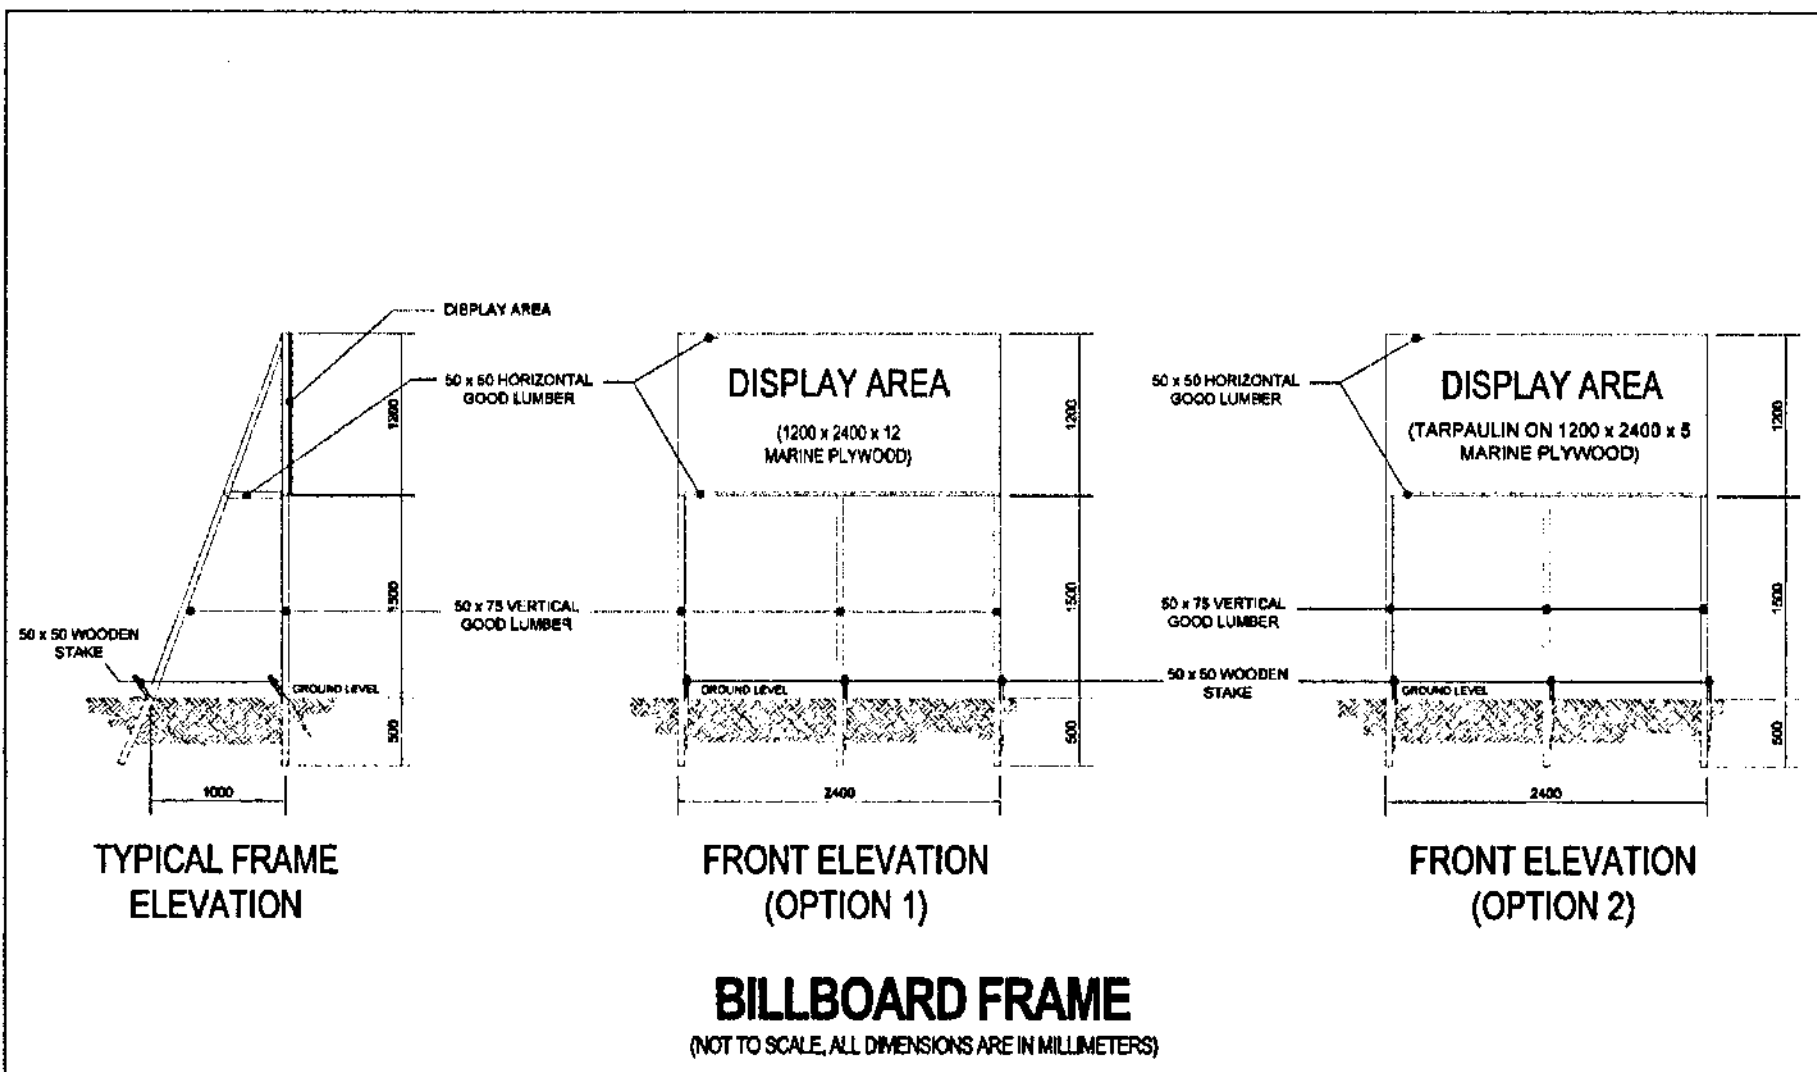

## ITEM 22 : SAFETY SIGNAGES AND BARRICADES

### DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


### SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2-2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



### STANDARD PLAN FOR SIGNAGES AND BARRICADES

***SECTION VII***

***DRAWINGS  
(APPROVED PLANS)***

# SECTION VII

## DRAWINGS AND APPROVED PLANS (SEE ISSUED APPROVED PLANS)

### LIST OF DRAWINGS:

- |            |   |
|------------|---|
| 1 of 35 -  | Development Plan, Vicinity Map, General Notes, List of Drawings   |
| 2 of 35 -  | General Plan  |
| 3 of 35 -  | General Plan of R.C. Wharf Widening, Piling and Framing Plan of R.C. Wharf<br>Schedule of 450mm X 450mm P.S.C. Piles  |
| 4 of 35 -  | Longitudinal Elevation of R.C. Wharf Widening<br>Sectional Elevations of R.C. Wharf Widening  |
| 5 of 35 -  | Typical Detail of Pile Cap for Vertical & Couple-Batter Piles, Typical Section of Beam<br>Typical Transverse & Longitudinal Beam Reinforcement  |
| 6 of 35 -  | Typical Detail of 15.00m Deck, Sectional Details, Detail of Construction Joint  |
| 7 of 35 -  | Detail of 450mm X 450mm Pre-Stressed Concrete Pile, Lifting Points, Detail<br>Typical Pile Splice Detail  |
| 8 of 35 -  | General Plan of Port Operational Area and Continuous Ramp On-Fill   |
| 9 of 35 -  | Piling & Anchorage Plan of Port Operational Area & Continuous Ramp On-Fill  |
| 10 of 35 - | Sectional Elevation - C, Sectional Elevation - D, Sectional Elevation - E<br>Sectional Elevation - F  |
| 11 of 35 - | Sectional Elevation - G, Sectional Elevation - H, Section I-I, Section J-J<br>Sectional Elevation - K   |
| 12 of 35 - | Sectional Elevation @ Sta. 0+000, Sectional Elevation @ Sta. 0.010  |
| 13 of 35 - | Sectional Elevation @ Sta. 0+020, Sectional Elevation @ Sta. 0.030  |
| 14 of 35 - | Sectional Elevation @ Sta. 0+040, Sectional Elevation @ Sta. 0.050  |
| 15 of 35 - | Sectional Elevation @ Sta. 0+060, Sectional Elevation @ Sta. 0.070  |
| 16 of 35 - | Sectional Elevation @ Sta. 0+075, Sectional Elevation - L   |
| 17 of 35 - | Detail of Retaining Wall, Detail of Retaining Wall-1, Detail attachment of Rubber Dock<br>Fender, Detail of Retaining Wall-2, Detail of Retaining Wall @ Ramp Side, Detail of<br>Anchor Wall, Detail of Anchor Wall @ Ramp Side |

- 18 of 35 - Detail of Concrete Block-1, Detail of Concrete Block-2
- 19 of 35 - Typical Detail of Lifting Handle of Concrete Blocks, Detail of Retaining Wall-3  
Detail of R.C. Curb @ Rock Bulkhead, Typical Elevation of Slotted R.C. Curb
- 20 of 35 - Detail of Interlocking Concrete Paving Blocks, Detail of Shear Keys, Detail of R.C. Ditch  
Typical Section of Lateral Drainage, Sectional Plan of I.C.P.B.
- 21 of 35 - Detail of Wing Wall, Detail of Rubber Dock Fender V – 500H X 1500L
- 22 of 35 - Detail of Tie Rod
- 23 of 35 - Detail of Mooring Block for 50-Ton Mooring Bollard  
Detail of 50-Ton Mooring Bollard (Tee-Head)
- 24 of 35 - Plan at Continuous Ro-Ro Ramp, Detail of G.I. Pipe Railing
- 25 of 35 - Detail of Pavement @ Continuous Ro-Ro Ramp  
Detail of Pavement Joint @ Ro-Ro Ramp
- 26 of 35 - Detail of Pre-Stressed Concrete (PSC) Sheet Pile
- 27 of 35 - Detail of R.C. Corner Piles
- 28 of 35 - Storm Drainage Layout
- 29 of 35 - Typical Detail of Lateral Drainage, Detail & Framing of Trench Grate  
Detail of Catch Drain Manhole
- 30 of 35 - Detail of Outfall @ Rock Bulkhead, Detail of Outfall @ Sheet Pile Containment
- 31 to 35 – Electrical Plans



*SECTION VIII*

*BILL OF QUANTITIES*  
*and*  
*ATTACHMENTS*

**BID SUMMARY**  
**DUMAGUIT PORT EXPANSION PROJECT**  
 Port of Dumaguit, New Washington, Aklan



NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1 BILL NO. 2 BILL NO. 3 BILL NO. 4	GENERAL EXPENSES DEMOLITION, REMOVAL AND EXCAVATION WORKS PORT OPERATIONAL AREA AND CONTINUOUS RORO RAMP WIDENING OF EXISTING WHARF	
<b>BID PRICE</b>		

\_\_\_\_\_  
 Name of Firm

\_\_\_\_\_  
 Name of Bidder/Authorized Representative  
 (Signatory's Legal Capacity)

\_\_\_\_\_  
 Date

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
 Port of Dumaguit, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
<b>BILL NO. 1</b>	<b>GENERAL EXPENSES</b>				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	20		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	20		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	20		
<b>TOTAL FOR BILL NO. 1</b>					

Name of Bidder/Authorized Representative  
 (Signatory's Legal Capacity)

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
Port of Dumaguite, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
<b>BILL NO. 2</b>	<b>DEMOLITION, REMOVAL AND EXCAVATION WORKS</b>				
2.01	Demolish and dispose portion of existing pavement	sq.m.	113		
2.02	Remove existing solar lamp post for re-installation	set	5		
2.03	Chip-off existing R.C. Curb, flushed to deck level and smoothened with mortar	l.m.	101		
2.04	Chip-off existing concrete structure for the installation of construction joint	cu.m.	7		
2.05	Demolition of concrete revetment and stairlanding including excavation of portion of existing rock bulkhead prior to the construction of anchor wall and re-install rocks upon completion of anchor wall	cu.m.	378		
2.06	Excavation of existing fill materials for the foundation of existing solar lamp post	cu.m.	5		
<b>TOTAL FOR BILL NO. 2</b>					

Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
Port of Dumaguite, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
<b>BILL NO.</b>	<b>3 PORT OPERATIONAL AREA AND CONTINUOUS RORO RAMP</b>				
3.01	Supply and deliver to site 350mm x 600mm PSC sheet piles	l.m.	3,294		
3.02	Supply and deliver to site R.C. Corner piles				
	a) R.C. Corner pile No. 1	l.m.	12		
	b) R.C. Corner pile No. 2	l.m.	12		
	c) R.C. Corner pile No. 3	l.m.	16		
	d) R.C. Corner pile No. 4	l.m.	12		
3.03	Handle, pitch and drive 350mm x 600mm PSC sheet piles and RC corner piles	l.m.	3,346		
3.04	Supply, deliver and drive 450mm x 450mm x 22m vertical PSC pile for floodlight foundation	no.	1		
3.05	Chip-off/cut and dispose portion of newly driven PSC Piles up to required elevation	no.	234		
3.06	Supply and place 3,500 psi. concrete for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage, catch drain manhole and restoration of chipped concrete structure for installation of construction joint	cu.m.	785		
3.07	Supply and install steel reinforcement for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage and catch drain manhole	kg.	63,676		
3.08	Supply and place concrete blocks				
	a) Concrete block 1	set	1		
	b) Concrete block 2	set	2		
3.09	Supply and place 1,000 kg. armour rocks	cu.m.	787		
3.10	Supply and place 50-100 kg. core rocks and leveling rocks	cu.m.	3,113		
3.11	Supply and place rubble concrete for concrete blocks	cu.m.	3		

Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
Port of Dumaguit, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3.12	Supply and install tie-rod (steel 45) including accessories				
	a) ø 60mm x 16 meters	set.	32		
	b) ø 60mm x 15 meters	set.	14		
	c) ø 60mm x 13 meters	set.	11		
	d) ø 60mm x 12 meters	set.	9		
	e) ø 60mm x 2.20 meters (corner tie-rod)	set.	2		
3.13	Supply and install geotextile fabric	sq.m.	2,749		
3.14	Supply and place sand and gravel fill	cu.m.	12,866		
3.15	Supply, place and compact aggregate sub-base course	cu.m.	2,462		
3.16	Supply, spread and compact aggregate base course	cu.m.	730		
3.17	Supply, place and compact gravel bedding for retaining wall, anchor wall, lateral drainage, duct bank, lamp post foundation and pedestal post	cu.m.	59		
3.18	Supply, spread and compact cement treated base course	cu.m.	454		
3.19	Supply, spread and compact levelling course sand cushion	cu.m.	151		
3.20	Supply, deliver and install interlocking concrete paving blocks	sq.m.	3,026		
3.21	Construct portland cement concrete pavement (300mm thk) including dowel bars and construction joints	sq.m.	377		
3.22	Supply, fabricate and install ø100mm G.I. pipe railing	l.m.	26		
3.23	Supply and deliver to site rubber dock fender (V-type, 500H x 1500L) including accessories	set	11		

Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
Port of Dumaguite, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3.24	Install rubber dock fender and accessories	set	11		
3.25	Supply and deliver to site mooring bollard (50 Tons, T-head) including accessories	set	3		
3.26	Install mooring bollards (50 Tons, T-head type) and accessories	set	3		
3.27	Supply, fabricate and install hot dipped galvanized trench grate cover for lateral drainage including built-up frames, dowels and other miscellaneous items	t.m.	100		
3.28	Supply, fabricate and install hot dipped galvanized trench grate cover for catch drain manhole including built-up frames, dowels and other miscellaneous items	set	9		
3.29	Supply and install reinforced concrete pipe culvert (RCP) Ø 460mm for outfall	t.m.	6		
3.30	Construct port lighting system including appurtenances	lot	1		
3.31	Re-install existing solar lamp post	set	5		
<b>TOTAL FOR BILL NO. 3</b>					

Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

**BILL OF QUANTITIES**  
**DUMAGUIT PORT EXPANSION PROJECT**  
Port of Dumaguite, New Washington, Aklan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
<b>BILL NO. 4</b>	<b>WIDENING OF EXISTING WHARF</b>				
4.01	Supply, deliver and drive PSC test piles, 450mm x 450mm	no.	2		
4.02	Supply and deliver to site 450mm x 450mm PSC piles	l.m.	4,320		
4.03	Handle, pitch and drive vertical 450mm x 450mm PSC piles	l.m.	2,112		
4.04	Handle, pitch and drive batter 450mm x 450mm PSC piles	l.m.	2,208		
4.05	Chip-off/cut and dispose portion of newly driven PSC Piles up to required elevation	no.	194		
4.06	Supply and place 3,500 psi concrete for the superstructure	cu.m.	488		
4.07	Supply and install steel reinforcement for the superstructure	kg.	84,149		
4.08	Supply and install hot-dipped galvanized angle bar, 100mm x 100mm x 10mm for construction including dowel bars	l.m.	279		
<b>TOTAL FOR BILL NO. 4</b>					

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)



## **BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL**

The work items included in the proposal and the basis of payments are as follows:

### **BILL NO. 1**

#### **GENERAL EXPENSES**

**Item 1.01 Mobilization, demobilization, and cleaning**

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

**Item 1.02 Rental of temporary site office and residence for the Engineer and staff**

The quantity to be paid for shall be the actual rental of site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary for the provision of temporary site office and residence for the engineer and staff.

**Item 1.03 Maintain temporary site office and residence for the Engineer and staff**

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

**Item 1.04 Provide construction safety and Health Program in the execution of the project**

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

## **BILL NO. 2**

### **DEMOLITION, REMOVAL AND EXCAVATION WORKS**

**Item 2.01      Demolish and dispose portion of existing pavement**

The quantity to be paid for shall be the actual area in square meter of existing pavement to be demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.02      Remove existing solar lamp post for re-installation**

The quantity to be paid for shall be the actual set of existing solar lamp post to be removed and re-installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.03      Chip-off existing R.C. Curb, flushed to deck level and smoothed with mortar**

The quantity to be paid for shall be the actual length in linear meter of existing RC curb to be chipped off, flushed to deck level, and smoothed with mortar in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.04      Chip-off existing concrete structure for the installation of construction joint**

The quantity to be paid for shall be the actual volume in cubic meter of existing chipped off for the installation of construction joint in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.05      Demolition of concrete revetment and stair landing including excavation of portion of existing rock bulkhead prior to the construction of anchor wall and re-install rocks upon completion of anchor wall**

The quantity to be paid for shall be the actual volume in cubic meter of concrete revetment and stair landing to be demolished and the portion of existing rock bulkhead to be excavated prior to the construction of anchor wall and its re-installation upon completion of anchor wall, all in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.06      Excavation of existing fill materials for the foundation of existing solar lamp post**

The quantity to be paid for shall be the actual volume in cubic meter of existing fill materials to be excavated for the foundation of existing solar lamp post in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**BILL NO. 3**

**PORT OPERATIONAL AREA AND CONTINUOUS RORO RAMP**

**Item 3.01 Supply and deliver to site 350mm x 600mm PSC sheet piles**

The quantity to be paid for shall be the actual length in linear meter of 350mm x 600mm PSC sheet piles to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.02 Supply and deliver to site R.C. Corner piles**

- a) R.C. Corner pile No. 1
- b) R.C. Corner pile No. 2
- c) R.C. Corner pile No. 3
- d) R.C. Corner pile No. 4

The quantity to be paid for shall be the actual length in linear meter of RC corner Piles of various sizes to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.03 Handle, pitch, and drive 350mm x 600mm PSC sheet piles and RC corner piles**

The quantity to be paid for shall be the actual length in linear meter of 350mm x 600mm PSC sheet piles and RC corner piles to be handled, pitched, and driven in accordance with the plans and specifications and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.04 Supply, deliver and drive 450mm x 450mm x 22m vertical PSC pile for floodlight foundation**

The quantity to be paid for shall be the actual number of 450mm x 450mm x 22m vertical PSC pile for floodlight foundation to be supplied, delivered, and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.05 Chip-off/cut and dispose portion of newly driven PSC Piles up to required elevation**

The quantity to be paid for shall be the actual number of newly driven PSC Piles, of which portion is to be chipped/cut off up to required elevation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

- Item 3.06      Supply and place 3,500 psi. concrete for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage, catch drain manhole and restoration of chipped concrete structure for installation of construction joint**

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi. concrete to be supplied and set-in-place for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage, catch drain manhole and restoration of chipped concrete structure for installation of construction joint in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

- Item 3.07      Supply and install steel reinforcements for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage and catch drain manhole**

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars to be supplied and installed for retaining wall, wing wall, anchor wall, mooring block, slotted RC curb, shear key, RC ditch, concrete pedestal post, floodlight and lamp post foundation, duct bank, hand hole, lateral drainage and catch drain manhole in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

- Item 3.08      Supply and place concrete blocks**  
    a) Concrete block 1  
    b) Concrete block 2

The quantity to be paid for shall be the actual set of concrete blocks of various sizes to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

- Item 3.09      Supply and place 1,000 kg. armour rocks**

The quantity to be paid for shall be the actual volume in cubic meter of 1,000 kg. armour rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of armour rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

- Item 3.10      Supply and place 50-100 kg. core rocks and leveling rocks**

The quantity to be paid for shall be the actual volume in cubic meter of 50-100 kg. core rocks and leveling rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of core rocks and leveling rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment.

Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.11      Supply and place rubble concrete for concrete blocks**

The quantity to be paid for shall be the actual volume in cubic meter of rubble concrete for concrete blocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.12      Supply and install tie-rod (steel 45) including accessories**

- a) ø 60mm x 16 meters
- b) ø 60mm x 15 meters
- c) ø 60mm x 13 meters
- d) ø 60mm x 12 meters
- e) ø 60mm x 2.20 meters (corner tie-rod)

The quantity to be paid for shall be the actual set of tie-rod (steel 45) of various sizes including accessories to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.13      Supply and install geotextile fabric**

The quantity to be paid for shall be the actual area in square meter of geotextile fabric, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.14      Supply and place sand and gravel fill**

The quantity to be paid for shall be the actual volume in cubic meter of sand and gravel fill, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.15      Supply, place, and compact aggregate subbase course**

The quantity to be paid for shall be the actual volume in cubic meter of aggregate subbase course to be supplied, set-in-place and compacted in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing and compacting of aggregate subbase course rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.16      Supply, spread and compact aggregate base course**

The quantity to be paid for shall be the actual volume in cubic meter of aggregate base course to be supplied, spread, and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.17      Supply, place, and compact gravel bedding for retaining wall, anchor wall, lateral drainage, duct bank, lamp post foundation and pedestal post**

The quantity to be paid for shall be the actual volume in cubic meter of gravel bedding to be supplied, set-in-place, and compacted for retaining wall, anchor wall, lateral drainage, duct bank, lamp post foundation and pedestal post in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.18      Supply, spread and compact cement treated base course**

The quantity to be paid for shall be the actual volume in cubic meter of cement treated base course to be supplied, spread, and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.19      Supply and spread, and compact leveling course sand cushion**

The quantity to be paid for shall be the actual volume in cubic meter of leveling course sand cushion to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.20      Supply, deliver and install interlocking concrete paving blocks**

The quantity to be paid for shall be the actual area in square meter of interlocking concrete paving blocks, to be supplied, delivered, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.21      Construct portland cement concrete pavement (300mm thick) including dowel bars and construction joints**

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (300mm thick) including dowel bars and construction joints to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.22      Supply, fabricate and install Ø100mm G.I. pipe railing**

The quantity to be paid for shall be the length in linear meter of Ø100mm G.I. pipe railing to be supplied, fabricated, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full

compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.23      Supply and deliver to site rubber dock fender (V500H x 1500L) including accessories**

The quantity to be paid for shall be the actual set of rubber dock fenders (V500H x 1500L) including accessories, supplied, and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.24      Install rubber dock fender and accessories**

The quantity to be paid for shall be the actual set of rubber dock fenders and accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.25      Supply and deliver to site mooring bollard (50 Tons, T-head) including accessories**

The quantity to be paid for shall be the actual set of mooring bollards (50 Tons, T-head) including accessories, supplied, and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.26      Install mooring bollards (50 Tons, T-head type) including accessories**

The quantity to be paid for shall be the actual set of mooring bollards (50 Tons, T-head type) including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.27      Supply, fabricate, and install hot dipped galvanized trench grate cover for lateral drainage including built-up frames, dowels, and other miscellaneous items**

The quantity to be paid for shall be the actual length in linear meter of hot dipped galvanized trench grate cover for lateral drainage including built-up frames, dowels, and other miscellaneous items to be supplied, fabricated, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.28      Supply, fabricate and install hot dipped galvanized trench grate cover for catch drain manhole including built-up frames, dowels, and other miscellaneous items**

The quantity to be paid for shall be the actual set of hot dipped galvanized trench grate cover for catch drain manhole including built-up frames, dowels, and other miscellaneous items to be supplied, fabricated, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.29      Supply and install reinforced concrete pipe culvert (RCP) Ø 460mm for outfall**

The quantity to be paid for shall be the actual length in linear meter of reinforced concrete pipe culvert (RCP) Ø 460mm for outfall, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.30      Construct port lighting system including appurtenances**

The quantity to be paid for shall be the actual lot of port lighting system including appurtenances to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.31      Reinstall existing solar lamp post**

The quantity to be paid for shall be the actual set of existing solar lamp post to be reinstalled in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.



## **BILL NO. 4**

### **WIDENING OF EXISTING WHARF**

**Item 4.01 Supply, deliver & drive PSC test piles, 450mm x 450mm**

The quantity to be paid for shall be the actual number of 450mm x 450mm PSC Test Piles to be supplied, delivered, and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.02 Supply and deliver to site 450mm x 450mm PSC piles**

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm PSC Piles to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.03 Handle, pitch, and drive vertical 450mm x 450mm PSC Piles**

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm Vertical PSC Piles to be handled, pitched, and driven in accordance with the plans and specifications and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.04 Handle, pitch, and drive batter 450mm x 450mm PSC Piles**

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm Batter PSC Piles to be handled, pitched, and driven in accordance with the plans and specifications and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.05 Chip-off/cut and dispose portion of newly driven PSC Piles up to required elevation**

The quantity to be paid for shall be the actual number of newly driven PSC Piles to be chipped/cut off up to required elevation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.06 Supply and place 3,500 psi concrete for the superstructure**

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete to be supplied and set-in-place for the superstructure in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.07      Supply and install steel reinforcements for the superstructure**

The quantity to be paid for shall be the actual weight in kilogram of steel reinforcements to be supplied and installed for the superstructure in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 4.08      Supply and install hot-dipped galvanized angle bar, 100mm x 100mm x 10mm for construction including dowel bars**

The quantity to be paid for shall be the actual length in linear meter of hot-dipped galvanized angle bar, 100mm x 100mm x 10mm for construction including dowel bars to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF**

**RENTAL OF SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF**

The Contractor shall provide a temporary site office and residence (rental) with an area of at least 48 square meters for use of the Engineer and his staff for the whole duration of the project.

**MINIMUM MAJOR EQUIPMENT REQUIREMENTS**

1	unit/s	Air Compressor (250 cfm, minimum), owned
1	unit/s	Backhoe (0.40 cu.m., 94.30hp, minimum), owned
1	unit/s	Clamshell, owned
1	unit/s	Concrete cutter, owned
1	unit/s	Concrete Mixer (1 bagger, minimum), owned
1	unit/s	Concrete bucket, owned
1	unit/s	Concrete Screeder, owned
2	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Crane Barge (319 GW, minimum) with 60T crane, owned
1	unit/s	Crawler Crane (30T, minimum), owned
1	unit/s	Pile Hammer (Diesel, 10,500 kg.m.), 1-owned
1	unit/s	Drop Hammer (2T, minimum), owned
2	unit/s	Dump Truck (8 cu.m., minimum), owned
1	unit/s	Bar Bender (electric, 25mm dia min.), owned
1	unit/s	Bar Cutter (electric, 25mm dia min.), owned
1	unit/s	Forklift (1.36T, minimum), owned/leased
2	unit/s	Jackhammer, owned
2	unit/s	Oxy/Acetylene cutting outfit, owned
1	unit/s	Payloader (80 hp, minimum), owned
2	unit/s	Plate Compactor (5 hp, minimum), owned
1	unit/s	Road Grader (125 hp, minimum), owned
1	unit/s	Road Roller (12.05T, vibratory, minimum), owned
2	unit/s	Transit Mixer (5-6 cu.m. cap., minimum), owned
1	unit/s	Tugboat (500hp, minimum), owned/leased
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
1	unit/s	Welding Machine (400 amp., minimum), owned
1	unit/s	Cargo Truck (5T, minimum), owned
1	unit/s	Backhoe Breaker Attachment, owned

## CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

### LABOR

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

### EQUIPMENT / MATERIALS

#### Personnel Protective Equipment

53	pcs.	Hard Hats
53	pairs	Gloves (rubberized)
53	pcs.	Safety Glasses/Goggles (clear)
106	pcs.	Long sleeve T-shirt
1	pc.	Aprons
1	pc.	Safety Belts
53	pairs	Safety Shoes
1	set	Life Lines

#### Safety Devices

1	lot	Barricades
1	lot	Warning signs
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System	-	Twenty (20) mos.
Temporary shelter for workers	-	1 lot

### NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 1 of 10

### REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
<b>I. Construction of Pier/Wharf, Platform and Ramp</b>		
<b>Structural Concrete (SC)</b>		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mil Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
<b>Piling (P)</b>		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 2 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
4 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
5 Fine Aggregates	Same Test as for SC (B)	Same frequency as SC (B)
B Steel Pipe Piles	Fabrication Report, Mill Certificate and Quality Test for Chemical and Mechanical properties	One per fabrication
1 Steel	Chemical Composition (refer below) <ul style="list-style-type: none"> <li>Under 14" (355 60mm) Outside Diameter</li> <li>14" to 36" (355 6 to 914mm) Outside Dia</li> <li>Over 36" (914mm) Outside Diameter</li> </ul> Mechanical/Tensile	2 from 200 pipe or fraction thereof 2 from 100 pipe or fraction thereof 2 from 3000ft (914m) or fraction thereof One (1) tension test shall be made on one length or fraction thereof of each size, or one piece of skelp representing each lot of 200 lengths or fraction thereof of each size
2 Polyurethane Coating	Mill Certificate and Quality Test	One per fabrication
3 Concrete	Same test as for SC (F)	Same frequency as SC (F)
4 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
6 Steel Bars	Same Test as SC (E)	Same frequency as SC (E)
7 Water	Same Test as SC (D)	Same frequency as SC (D)
Rubber Dock Fenders (RDF)	Physical Test Performance Test for Energy Absorption and Reaction Force	All units All units
Accessories Washer and Fixing Bolt, Anchor Bolt	Physical Test Quality Test for Chemical Composition and Mechanical Properties	All units One per fabrication

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 3 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
Mooring Bollard (MB) and Accessories (Hexagon Nuts, Plain Washer, Anchor Ring and Anchor Bolt)	Physical Test  Quality Test for Chemical Composition and Mechanical Properties	All Units  One per fabrication
<b>II. Construction of Back-Up Area, Causeway and Pavement</b>		
Sheet Piling (SP)		
A Concrete Sheet Piles		
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strands	Same test as for P (A 3)	Same frequency as P (A 3)
4 Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
B Steel Pipe Piles		
1 Steel	Same test as for P (B1)	Same frequency as P (B1)
2 Concrete	Same test as for SC (F)	Same frequency as SC (F)
3 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
4 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)



PPA MEMORANDUM CIRCULAR  
 No. 02  
 Series of 2016  
 Attachment

Page 4 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
Rocks	Test for Apparent Specific Gravity and Abrasion	For every 1,500 cubic meter or fraction thereof
Geotextile Filter	Physical and Mechanical Test Mill Certificate	One per batch One per batch
Sand and Gravel Fill	Quality Test for Organic Impurities and Grading	For every 1,500 cubic meter or fraction thereof
Selected Fill	Quality Test for Grading, Plasticity and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 1,500 cubic meter or fraction thereof For every 2,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three in-situ density test for every 500 sq m or fraction thereof
Aggregate Base Course	Quality Test for Grading and Plasticity Quality Test for Grading, Plasticity, Abrasion and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 300 cubic meter or fraction thereof For every 1,500 cubic meter or fraction thereof Same frequency as Selected Fill Same frequency as Selected Fill
Portland Cement Concrete Pavement (PCCP)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars (Dowels)	Same test as for SC (E)	Same frequency as SC (E)
F Joint Filler	Quality Test	One (1) per shipment

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 5 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
G Admixture and Concrete Curing Material	Same test as for SC (G)	Same frequency as SC (G)
H Concrete	Same test as for SC (F) Flexural Test	Same frequency as SC (F) 3 beam samples for every 330 sq m or fraction thereof
I Completed Pavement	Core Test	1 set (3 specimen) for every 2,500 sq m and fraction thereof
Interlocking Concrete Blocks		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Admixture & Concrete Curing Materials	Same test as for SC (G)	Same frequency as SC (G)
F Completed Blocks	Physical Test and Compressive Strength	6 blocks per day of fabrication
Cement Treated Base Course (CTB)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine & Coarse Aggregates	Quality Test for Grading, Abrasion and Soundness	For every 1,500 cubic meter or fraction thereof
C Water	Same test as for SC (D)	Same frequency as SC (D)
D Completed CTB	Field Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
Retaining Wall/Coping Wall/RC Curb/RC Ditch/Shear Key/Concrete Blocks/Lean Concrete		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 6 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
F Admixture and Concrete Curing	Same test as for SC (G)	Same frequency as SC (G)
G Concrete	Same test as for SC (F)	Same frequency as SC (F)
Tie Rod		
A Steel	Same test as for SC (E)	One per batch
B Assembly	Performance Test (Tension)	One per batch
Tie Bars and Dowels	Same test as for SC (E)	For every 10,000 kg or fraction thereof per Tie bars and Dowels
Pipe Culverts and Storm Drains		
A Pipes	Test for Strength, Absorption and Physical	For every 50 pieces
B Mortar or Joint	Same Test as for SC (A,B and D) Alternative Test Same test as for SC (F) and Inspection Report	For every 25 pieces
Concrete Hollow Blocks		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Water	Same test as for SC (D)	Same frequency as SC (C)
D Concrete	Same test as for SC (F)	Same frequency as SC (F)
E Completed CHB	Quality Test	One for every 500 pieces or fraction thereof
Construction Joints (CJ)		
A Angle Bars	Test for Physical and Mechanical Properties	One per batch
B Steel Bars	Same test as for SC (E)	One per batch
C Zinc (Hot Dip Galvanizing) Coatings	Physical Test for Appearance, Stripping, Weighing, Adherence and Adhesion  Coating Thickness Magnetic Thickness Measurement	All units  1 set (3 specimen) for every 100,000 sq mm or fraction thereof

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Sacked Concrete	A Cement Same test as for SC (A) B Fine Aggregates Same test as for SC (B) C Coarse Aggregates Same test as for SC (C) D Water Same test as for SC (D) E Concrete Same test as for SC (E) F Sack (unit) Physical Test	Same frequency as SC (A) Same frequency as SC (B) Same frequency as SC (C) Same frequency as SC (D) Same frequency as SC (E) Same frequency as SC (F) One for every 50 pieces
Rubble Concrete	A Cement Same test as for SC (A) B Fine Aggregates Same test as for SC (B) C Coarse Aggregates Same test as for SC (C) D Water Same test as for SC (D) E Concrete Same test as for SC (E) F Rocks Same test as for ROCKS	Same frequency as SC (A) Same frequency as SC (B) Same frequency as SC (C) Same frequency as SC (D) Same frequency as SC (E) Same frequency as SC (F) Same frequency as ROCKS
Earthworks	Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test Density Test	For every 1,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
B Structure	If excavated materials shall be used as Backfill Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test Density Test	For every 1,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof

12/21

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 8 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
<b>III Port Operations Building/Passenger Terminal Building/Transit Shed/Warehouse</b>		
<b>STRUCTURAL WORKS</b>		
Refer to Structural Concrete (SC) and Piling Works (P)		
<b>ARCHITECTURAL WORKS</b>		
Ceramic – Filled Liquid Membrane / Water Proofing, Hydrophobic Poreblocking Ingredients with Superplasticizer	Physical Property, Mechanical and Chemical Property, Leak Test / Flood Test	One per shipment
Paint	Quality Test	One 4-L can for every 100 cans or fraction thereof
Ceramic Tile	Inspection and Evaluation Report from the Engineer	One per shipment
Stainless Steel	Inspection and Evaluation Report from the Engineer	One per shipment
Roofing Materials	Inspection and Evaluation Report from the Engineer	One per shipment
Ceiling Materials	Inspection and Evaluation Report from the Engineer	One per shipment
<b>ELECTRICAL AND MECHANICAL WORKS</b>		
Wires / Cables	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Electrical Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Fire Alarm System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Wiring Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 8 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Protective Devices	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per shipment
Telephone System	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
CCTV System	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
CATV System	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
Background Music and Paging System	Inspection and Evaluation Report from the Engineer, Testing and Commissioning	One per item
Air Conditioning Units & Ventilation	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
Conduit Pipes	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
Lighting Fixtures	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
<b>PLUMBING WORKS</b>		
Pipes	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment


Page 10 of 10


Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Fixtures	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
Pipe Culverts	Compression Strength  Inspection and Evaluation Report from the Engineer	For every size not more than 25 pipes cast in the field
<b>IV Miscellaneous Materials</b> Fencing A Barbed Wire, Cyclone Wire Mesh, Chain Link B Concrete Post	Physical Test (Dimensions and Coatings)  Refer to Superstructure (SC)	One per Batch  Refer to Superstructure (SC)
Lamp Post A Structural Steel B Zinc (Hot Dip Galvanizing) Coatings	Physical Test (Dimensions) Same test as for SC (E)  Same test as for CJ (C)	All units  One per batch
Drainage Steel Grating	Same test as for SC (E)  Inspection Report	One (1) batch
Metal Pipe (Cast Iron Galvanized, etc.)	Physical Test (Dimensions and Coatings)	1 per delivery
Welding Works	Destructive and Non Destructive Test	One (1) per lot

**NOTES**

1. Testing of RDF shall be performed only by an independent Testing Laboratory duly accredited by BRS, DOST and PPA
2. Testing of other materials shall be performed only by an independent Testing Laboratory duly accredited by BRS and PPA.
3. All other issuances which are otherwise inconsistent herewith are hereby revoked or otherwise amended.

Approved

  
**RAUL T. SANTOS**  
Officer-in-Charge,  
Office of the General Manager



## ***SECTION IX***

# ***CHECKLIST OF TECHNICAL AND FINANCIAL DOCUMENTS***



# Checklist of Technical and Financial Documents

## I. TECHNICAL COMPONENT ENVELOPE

### *Class "A" Documents*

#### Legal Documents

- ☐ (a) Valid PhilGEPS Registration Certificate (Platinum Membership) (all pages)

#### Technical Documents

- ☐ (b) Statement of the prospective bidder of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid; and
- ☐ (c) Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, except under conditions provided under the rules; and
- ☐ (d) Special PCAB License in case of Joint Ventures; and registration for the type and cost of the contract to be bid; and
- ☐ (e) Original copy of Bid Security. If in the form of a Surety Bond, submit also a certification issued by the Insurance Commission;  
or  
Original copy of Notarized Bid Securing Declaration; and
- ☐ (f) Project Requirements, which shall include the following:
  - ☐ a. Organizational chart for the contract to be bid;
  - ☐ b. List of contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen), to be assigned to the contract to be bid, with their complete qualification and experience data;
  - ☐ c. List of contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership or certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be; and
- ☐ (g) Original duly signed Omnibus Sworn Statement (OSS); and if applicable, Original Notarized Secretary's Certificate in case of a corporation, partnership, or cooperative; or Original Special Power of Attorney of all members of the joint venture giving full power and authority to its officer to sign the OSS and do acts to represent the Bidder.

**Financial Documents**

- ☐ (h) The prospective bidder's computation of Net Financial Contracting Capacity (NFCC).

**Class "B" Documents**

- ☐ (i) If applicable, duly signed joint venture agreement (JVA) in accordance with RA No. 4566 and its IRR in case the joint venture is already in existence;  
or  
duly notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA in the instance that the bid is successful.

**II. FINANCIAL COMPONENT ENVELOPE**

- ☐ (j) Original of duly signed and accomplished Financial Bid Form; **and**

**Other documentary requirements under RA No. 9184**

- ☐ (k) Original of duly signed Bid Prices in the Bill of Quantities; **and**  
☐ (l) Duly accomplished Detailed Estimates Form, including a summary sheet indicating the unit prices of construction materials, labor rates, and equipment rentals used in coming up with the Bid; **and**  
☐ (m) Cash Flow by Quarter.

***SECTION X***  
***BIDDING FORM***

**Bid Form for the Procurement of Infrastructure Projects***[shall be submitted with the Bid]***BID FORM**

Date : \_\_\_\_\_

Project Identification No. : \_\_\_\_\_

To: **Philippine Ports Authority**  
PPA Building, Bonifacio Drive,  
South Harbor, Port Area, Manila

Having examined the Philippine Bidding Documents (PBDs) including the Supplemental or Bid Bulletin Numbers \_\_\_\_\_, the receipt of which is hereby duly acknowledged, we, the undersigned, declare that:

- a. We have no reservation to the PBDs, including the Supplemental or Bid Bulletins, for the Procurement Project: **Dumaguít Port Expansion Project, Port of Dumaguít, New Washington, Aklan**;
- b. We offer to execute the Works for this Contract in accordance with the PBDs;
- c. The total price of our Bid in words and figures, excluding any discounts offered below is: \_\_\_\_\_;
- d. The discounts offered and the methodology for their application are: \_\_\_\_\_;
- e. The total bid price includes the cost of all taxes, such as, but not limited to: *[specify the applicable taxes, e.g. (i) value added tax (VAT), (ii) income tax, (iii) local taxes, and (iv) other fiscal levies and duties]*, which are itemized herein and reflected in the detailed estimates,
- f. Our Bid shall be valid within the period stated in the PBDs, and it shall remain binding upon us at any time before the expiration of that period;
- g. If our Bid is accepted, we commit to obtain a Performance Security in the amount of \_\_\_\_\_ percent of the Contract Price for the due performance of the Contract, or a Performance Securing Declaration in lieu of the the allowable forms of Performance Security, subject to the terms and conditions of issued GPPB guidelines<sup>1</sup> for this purpose;
- h. We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- i. We understand that this Bid, together with your written acceptance thereof

<sup>1</sup> currently based on GPPB Resolution No. 09-2020

included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and

- j. We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.
- k. We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Dumaguít Port Expansion Project, Port of Dumaguít, New Washington, Aklan of the Philippine Ports Authority**.
- l. We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: \_\_\_\_\_

Legal Capacity: \_\_\_\_\_

Signature: \_\_\_\_\_

Duly authorized to sign the Bid for and behalf of: \_\_\_\_\_

Date: \_\_\_\_\_

**STATEMENT OF THE BIDDER'S ALL ONGOING GOVERNMENT AND PRIVATE CONTRACTS, INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED**

I hereby declare that all ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid are listed below:

Name of outstanding Contracts 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Amount or Value 4]	Date of Contract and NOA 5]	Value of Outstanding Works 6]	Accomplishment (in percentage, %) 7]		Contract Duration 8]	
							Planned	Actual	Start of Project	Estimated Completion Date
A) Government Contracts i. On-going ii. Awarded but not yet started  B) Private Contracts i. On-going ii. Awarded but not yet started										

**NOTE:**

- 1] As appearing in the contract executed by the parties.
- 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
- 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso.
- 5] As appearing in the Contract and Notice of Award (NOA).
- 6] Amount or value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.
- 7] Percentage of Accomplishment as of the preceding month which should not be earlier than two (2) months from the date of bid submission.
- 8] As appearing in the Notice to Proceed and Contract.

This Statement shall be supported by:

- a) Notice of Award
- b) Notice to Proceed and Contract

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

**STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID**

Name of the completed Contract  1]	Owner's Name and Address	Scope of Work  2]	Contractor's Role and Percentage of Participation  3]	Total Contract Value At 4]			Date of Award  5]	Contract Duration 6]	
				Award	Completion	Escalated Value to Present Prices		Start	Completed

**NOTE :**

- 1] As appearing in the contract executed by the parties.
  - 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
  - 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
  - 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Attached the computation for the escalated contract value.
  - 5] As appearing in the Notice of Award.
  - 6] As appearing in the Notice to proceed and Certificate of Completion.
- A. The bidder must have an experience of having completed a SLCC that is similar to the contract to be bid equivalent to at least fifty percent (50%) of the ABC, adjusted if necessary, by the Bidder to current prices using the PSA consumer price indices. A contract is considered to be "similar" to the contract to be bid if it has the same Major Categories of Work as stated in the Bid Data Sheet (BDS).
- B. This Statement shall be supported by:
- a. Notice of Award, Notice to Proceed and Contract.
  - b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least Satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/ Constructor, 3) Name of Contract, and 4) Contract Duration.
  - c. Recapitulation or Final Bill of Quantities.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

**STATEMENT OF THE BIDDER'S EXPERIENCE ON MAJOR CATEGORIES OF WORK OF THE SLCC INCLUDING OTHER COMPLETED CONTRACTS  
SIMILAR TO THE CONTRACT TO BE BID**

Major Categories of Work 1]	Unit of Measure 1]	Quantity 1]	SLCC similar to the contract to be bid 2]	Other completed contracts similar to the contract to be bid 2]				Unit of Measure 2]	Quantity 2]
			Name of the contract	Name of the contract	Name of the contract	Name of the contract			
1. Pile Driving Works (off-shore)	l.m.	3,857							
2. Reinforced Concrete Works	cu.m.	637							
3. Rockworks (50 to 1,000 kg/pc.)	cu.m.	1,950							
4. Placing of Fill Materials	cu.m.	7,664							
5. Supply, deliver and install interlocking concrete paving blocks	sq.m.	1,513							
6. Construction of Portland Cement Concrete Pavement	sq.m.	189							

**NOTE:**

1] As stated in the Bid Data Sheet.

2] As appearing in the Recapitulation and/ or Final Bill of Quantities.

This statement shall be supported by:

a. Notice of Award, Notice to Proceed and Contract.

b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, of at least satisfactory.

The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/Constructor, 3) Name of Contract, and 4) Contract Duration.

c. Recapitulation and/ or Final Bill of Quantities.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
Signatory's Legal Capacity

\_\_\_\_\_  
Date

Revised: September 2021



## FINANCIAL DATA

- A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

- B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [ (Current assets minus current liabilities) (15) ] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = \_\_\_\_\_

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

\_\_\_\_\_  
Name of Firm/Applicant

\_\_\_\_\_  
Authorized Signing Official

Date: \_\_\_\_\_

### NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

### STATEMENT OF THE BIDDER'S KEY PERSONNEL PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following key personnel are qualified and available for the duration of the contract to be bid:

Position of Key Personnel 1]	Name	No. of Key Personnel	Similar Experience In the Position (Years) 2]	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Materials Engineer II					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "

NOTE: 1] As stated in the Bid Data Sheet

2] The number of years of experience of the key personnel shall be as indicated in the qualification and experience data or curriculum vitae.

Minimum qualification requirements: The key personnel must have a work experience that is similar in nature and complexity to the contract to be bid.

Project Manager - Five (5) years

Materials Engineer – One (1) year

Project Engineer - Three (3) years

Materials Engineer I – for projects costing up to 100M

Foreman - Five (5) years

Materials Engineer II – for projects costing more than 100M

Construction Safety and Health Officer – One (1) year

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

### STATEMENT OF THE BIDDER'S EQUIPMENT PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following equipment are in good operating condition and available for the duration of the contract to be bid:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity/ Output  1]	Owned, Leased, and/or under purchased agreement 2]	Proof of Ownership/ Leased/ Under Purchase Agreement (Mark as Annex "A.....Z") 3]	OTHER INFORMATION (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

**NOTE:**

- 1] The unit of capacity of the pledged equipment shall be as indicated in the Proof of Ownership, i.e. GW (for crane barge), DWT (for deck barge and hopper barge), Ton (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m. (for dump truck), hp (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal (for water truck with pump), amp (for welding machine), bagger (for concrete mixer). If the capacity of the pledged equipment is not indicated in the Proof of Ownership/Leased Contract/Purchased Agreement, submit other proof of capacity such as specifications, brochures or other verifiable printouts indicating the model name, model number and other details of the equipment.
- 2] Indicate if the pledged equipment are owned, leased or under purchase agreement.
- 3] If the pledged equipment is owned, it should be in the name of the bidder. Submit proof of ownership, i.e. deed of sale, sales invoice, official receipt; For owned Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt; For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

If the pledged equipment is leased/under purchased agreement, submit certification of availability of equipment from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement.

If the pledged barge/tugboat is leased/under purchase agreement, submit certification of availability of barge/tugboat from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement together with a copy of the Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

The Minimum Major Equipment Requirements are listed in Section 8, Annex 3.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

**Omnibus Sworn Statement for Sole Proprietorship**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. As the owner and sole proprietor, or authorized representative of \_\_\_\_\_, I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Dumaguil Port Expansion Project, Port of Dumaguil, New Washington, Aklan of the Philippine Ports Authority**, as shown in the attached duly notarized Special Power of Attorney;
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. **In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.**

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_ day of \_\_, 20\_\_ at \_\_\_\_\_, Philippines.

---

Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**

*[Format shall be based on the latest Rules on Notarial Practice]*

**Omnibus Sworn Statement for Partnership or Cooperative**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Dumaguít Port Expansion Project, Port of Dumaguít, New Washington, Aklan of the Philippine Ports Authority**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers and members of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_\_ day of \_\_\_, 20\_\_ at \_\_\_\_\_, Philippines.

\_\_\_\_\_  
Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**

*[Format shall be based on the latest Rules on Notarial Practice]*

**Omnibus Sworn Statement for Corporation or Joint Venture**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Dumaguít Port Expansion Project, Port of Dumaguít, New Washington, Aklan**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers, directors, and controlling stockholders of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].
9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any



form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_ day of \_\_, 20\_\_ at \_\_\_\_\_, Philippines.

---

Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**

*[Format shall be based on the latest Rules on Notarial Practice]*

**Bid Securing Declaration Form**  
*[shall be submitted with the Bid if bidder opts to provide this form of bid security]*

---

REPUBLIC OF THE PHILIPPINES)  
CITY OF \_\_\_\_\_) S.S.

**BID SECURING DECLARATION**  
**Project Identification No.:** \_\_\_\_\_

**To: Philippine Ports Authority**  
PPA Building, Bonifacio Drive,  
South Harbor, Port Area, Manila

I/We, the undersigned, declare that:

1. I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid Securing Declaration.
2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any procurement contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by the procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA No. 9184; without prejudice to other legal action the government may undertake.
3. I/We understand that this Bid Securing Declaration shall cease to be valid on the following circumstances:
  - a. Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
  - b. I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right; and
  - c. I am/we are declared the bidder with the Lowest Calculated Responsive Bid, and I/we have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this \_\_\_\_ day of [month] [year] at [place of execution].

---

Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**  
*[Format shall be based on the latest Rules on Notarial Practice]*

## CONSTRUCTION METHODOLOGY

Name of Project : \_\_\_\_\_  
Project Description : \_\_\_\_\_  
Location : \_\_\_\_\_

### MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

#### A. DEMOLITION, REMOVAL AND EXCAVATION WORKS

1. Demolish and dispose portion of existing pavement (113 sq.m.)
2. Remove existing solar lamp post for re-installation (5 set)
3. Chip-off existing R.C. Curb, flushed to deck level and smoothened with mortar (101 l.m.)
4. Chip-off existing concrete structure for the installation of construction joint (7 cu.m.)
5. Demolition of concrete revetment and stairlanding including excavation of portion of existing rock bulkhead (378 cu.m.)
6. Excavation of existing fill materials for the foundation of existing solar lamp post (5 cu.m.)

#### B. PORT OPERATIONAL AREA AND CONTINUOUS RORO RAMP

1. Supply, deliver and drive 350mm x 600mm PSC sheet piles and RC corner piles (3,346 l.m.)
2. Supply and placing of 3,500 psi concrete (785 cu.m.)
3. Supply and installation of steel reinforcement (63,676 kg.)
4. Supply and placing of 50 to 1,000 kg/pc rocks (3,900 cu.m.)
5. Supply and installation of Tie-rods (68 sets)
6. Supply and placing of geotextile fabric filter (2,749 sq.m.)
7. Supply and placing of fill materials (15,328 cu.m.)
8. Supply, place, and compact gravel bedding (59 cu.m.)
9. Supply, spread, and compact cement treated base course (454 cu.m.)
10. Supply, deliver and install interlocking concrete paving blocks (3,026 sq.m.)
11. Construct Portland Cement Concrete Pavement, 300mm thk. (377 sq.m.)
12. Supply, fabricate and install Ø100mm G.I. pipe railing (26 l.m.)
13. Supply and install of Rubber Dock Fenders V500H x 1500L (11 sets) and Mooring Bollard 50-Tons, T-head (3 sets)
14. Supply and installation of hot dipped galv. trench grate cover for lateral drainage (100 l.m.)
15. Supply and installation of hot dipped galv. trench grate cover for catch drain manhole (9 set)
16. Supply and install reinforced concrete pipe culvert (RCP) Ø 460mm for outfall (6 l.m.)
17. Construct port lighting system including all appurtenances (1 lot)
18. Re-install existing solar lamp post (5 set)

### **C. WIDENING OF EXISTING WHARF**

1. Supply, deliver and drive PSC test piles, 450mm x 450mm x 24m (2 no.)
2. Supply, deliver and drive 450mm x 450mm PSC piles (4,320 l.m.)
3. Supply and place 3,500 psi concrete for superstructures (488 cu.m.)
4. Supply and install reinforcing steel bars for superstructure (84,149 kg.)
5. Supply and install hot-dipped galvanized angle bar, 100mm x 100mm x 10mm for construction including dowel bars (279 l.m.)

#### **NOTES:**

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

## MANPOWER SCHEDULE

Name of Project : \_\_\_\_\_

Project Description : \_\_\_\_\_

Location : \_\_\_\_\_

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)																			
	M O N T H L Y																			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Project Manager																				
Project Engineer																				
Materials Engineer II																				
Construction Safety and Health Officer																				
Foreman																				
Specify other applicable positions, ie.:																				
- Carpenter																				
- Steelman																				
- Mason																				
- Electrician																				
- Rigger																				
- Others																				

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

### EQUIPMENT UTILIZATION SCHEDULE

**Name of Project :** \_\_\_\_\_

**Project Description :** \_\_\_\_\_

**Location :** \_\_\_\_\_

[illegible]

**Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)**

Revised: September 2021

## CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : \_\_\_\_\_

Project Description : \_\_\_\_\_

Location : \_\_\_\_\_

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
<b>TOTAL</b>		

### NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

## **Contract Agreement Form for the Procurement of Infrastructure Projects (Revised)**

***[not required to be submitted with the Bid, but it shall be submitted within ten (10) days after receiving the Notice of Award]***

---

### **CONTRACT AGREEMENT**

THIS AGREEMENT, made this \_\_\_\_\_ day of \_\_\_\_\_, \_\_\_\_\_ between Philippine Ports Authority with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila (hereinafter called the "Entity") and [name and address of Contractor] (hereinafter called the "Contractor").

WHEREAS, the Entity is desirous that the Contractor execute [name and identification number of contract] (hereinafter called "the Works") and the Entity has accepted the Bid for [contract price in words and figures in specified currency] by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

#### **NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:**

1. In this Agreement, words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
2. The following documents as required by the 2016 revised Implementing Rules and Regulations of Republic Act No. 9184 shall be deemed to form and be read and construed as part of this Agreement, viz.:
  - a. Philippine Bidding Documents (PBDs);
    - i. Drawings/Plans;
    - ii. Specifications;
    - iii. Bill of Quantities;
    - iv. General and Special Conditions of Contract;
    - v. Supplemental or Bid Bulletins, if any;
  - b. Winning bidder's bid, including the Eligibility requirements, Technical and Financial Proposals, and all other documents or statements submitted;  
  
Bid form, including all the documents/statements contained in the Bidder's bidding envelopes, as annexes, and all other documents submitted (e.g., Bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from the Procuring Entity's bid evaluation;
  - c. Performance Security;
  - d. Notice of Award of Contract and the Bidder's conforme thereto; and



- e. Other contract documents that may be required by existing laws and/or the Procuring Entity concerned in the PBDs. Winning bidder agrees that additional contract documents or information prescribed by the GPPB that are subsequently required for submission after the contract execution, such as the Notice to Proceed, Variation Orders, and Warranty Security, shall likewise form part of the Contract.
3. In consideration for the sum of [total contract price in words and figures] or such other sums as may be ascertained, [Named of the bidder] agrees to [state the object of the contract] in accordance with his/her/its Bid.
4. The **Philippine Ports Authority** agrees to pay the above-mentioned sum in accordance with the terms of the Bidding.

IN WITNESS whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

**JAY DANIEL R. SANTIAGO**  
General Manager

for:

**Philippine Ports Authority**

**Name of Bidder/ Authorized  
Representative  
(Signatory's Legal Capacity)**

for:

**Contractor**

**Acknowledgment**

*[Format shall be based on the latest Rules on Notarial Practice]*