

Welding of parts shall be in accordance with structural standards and the Standard Code for Arc and Gas Welding in Building Construction of AWS, and shall only be done where shown, specified, or permitted by the Engineer.

Damage to galvanized areas by welding shall be thoroughly cleaned with wire brushing and all traces of welding flux and loose or cracked zinc coating shall be removed prior to painting. The cleaned area shall be painted with two coats of zinc oxide-zinc dust paint. The paint shall be properly compounded with a suitable vehicle in the ratio of one part zinc oxide to four parts zinc dust by weight. As an alternative to the above, the Contractor may submit for approval the use of a galvanizing rod or galvanizing solder to repair damaged areas.

The welding machine shall be a stable welder, and have suitable functions for the dimension of materials to be welded. The auxiliary tools used for welding shall perform sufficiently and adequately.

The welding machine used for field welding shall be of readily adjustable for electric current.

#### 7. Shop Assembly

Structural units furnished shall be assembled in the shop. An inspection shall be made to determine that the fabrication and the matching of the component parts are correct.

Jigs shall be used for the assembly of units as much as possible to maintain appropriate position of mutual materials.

Approval of the Engineer shall be required when drilling temporary bolt holes or welding temporary support to the assembled structure.

The tolerances shall not exceed those allowed by codes and each unit assembled shall be closely checked to insure that all necessary clearances have been provided and that binding does not occur in any moving part.

In order to maintain accurate finished dimensions and shape, appropriate reverse strain or restraint shall be provided as required. Assembly and disassembly work shall be performed in the presence of the Engineer, unless waived in writing by the Engineer any errors or defects disclosed shall be immediately remedied by the Contractor.

Before disassembly for shipment, component parts of the structures shall be match marked to facilitate erection in the field.

### FABRICATION TOLERANCES

#### 1. Dimensional Tolerances for Structural Work

Dimensions shall be measured by means of an approved calibrated steel tape at the time of inspection. Unevenness of plate work shall not exceed the limitation of the standard mill practice as specified in the American Institute of Steel Construction, "Manual of Steel Construction".

#### 2. Camber

Reverse camber in any structural steel members in excess of 1/1,000 of the span length shall cause rejection. The minimum dead load camber for any structural steel member shall be as allowed by Code, or otherwise specified.

## INSPECTION AND TEST OF WELDING

### 1. Inspection of Welding

Inspection of welding shall be executed for the following work phases.

#### a. Before Welding

Scum, angle of bevel, root clearance, cleaning of surface to be welded, quality of end tab, drying of welding rod.

#### b. During Welding

Welding procedure, diameter of coil and wire, type of flux, welding current and voltage, welding speed, welding rod position, length of arc, melting, cleaning of slag of each level under surface chapping, supervision of welding rod.

#### c. After Execution of Welding

Assurance of bead surface, existence of harmful defects, treatment of crater, quality of slag removal, size of fillet, dimension of extra fill of butt welding, treatment of end tab.

### 2. Testing of Welding

Twenty percent (20%) of welds contributing in the overall strength of the structure and which will be inaccessible for the inspection in service shall be tested.

Welding shall be tested by ultrasonic test to the extent specified herein or as directed by the Engineer.

Where partial inspection is required, the ultrasonic test shall be located at random on the welds so as to indicate typical welding quality.

If ten percent (10%) of the random ultrasonic tested indicate unacceptable defect, the remaining eighty percent (80%) of the welding shall be tested. Repair welding required shall be ultrasonic tested after the repairs are made.

## CORRECTIONS

In lieu of the rejection of an entire piece or member containing welding which is unsatisfactory or which indicates inferior workmanship, corrective measures may be permitted by the Engineer whose specific approval shall be obtained for making each correction. Defective or unsound welds or base steel shall be corrected either by removing and replacing the entire weld, or as follows.

1. Excessive convexity or overlap shall be reduced by grinding.
2. Undercuts, lack of weld shall be repaired with necessary reinforcement of weld after removal of any foreign materials such as slag, dust, oil, etc.
3. Any defects such as slag inclusions, incomplete fusion, or inadequate joint penetration, shall be completely removed, cleaned and re-welded.
4. Cracks in welds or base steel, shall be removed to sound steel throughout their length and 5cm beyond each end of the crack, followed by welding. The extent of the crack, depth and length, shall be ascertained by the use of acid etching, magnetic particle

inspection or other equally positive means.

The removal of welded steel shall be done by chipping, grinding, oxygen cutting, oxygen gouging, or air carbon arc gouging and in such a manner that the remaining welded steel or base steel is not nicked or undercut. Defective portions of the welding shall be removed without substantial removal of the base steel.

## INSTALLATION

### 1. Installation Program

#### a. Prerequisite Condition

Prior to executing steel fabrication and field installation, the Contractor shall prepare a comprehensive installation program including engineering supervision organization, fabrication procedures, field installation procedures, material application, machinery applications, inspection procedure, scope and standard of quality judgment, and submit to the Engineer for approval.

#### b. Special Technical Engineering

Special technical engineering different from contract specifications can be applied upon receiving approval of the Engineer.

### 2. Installation Requirement

#### a. Setting of Anchor Bolt and Others

- a. 1. Anchor bolts shall be set in accurate position by using templates.
- a. 2. The setting method shall be proposed to the Engineer for his approval before setting starts.
- a. 3. The threads of bolt shall be cured with an appropriate method against rust and/or any damage before tightening.
- a. 4. Non-shrink mortar shall be placed under base plates, well cured to obtain the sufficient strength before bearing loads are applied to base plates.

#### b. Temporary Bracing

- b. 1. Temporary bracing shall be installed as necessary to stay assemblies and assume loads against forces due to transport, erection operations or other work.
- b. 2. Temporary bracing shall be maintained in place until permanent work is properly connected and other construction installed as necessary for support, bracing or staying of permanent work.
- b. 3. Extent and quality of temporary bracing shall be as necessary against wind and other loads, including seismic loads not less than those for which the permanent structure is designed to resist.

#### c. Adequacy of Temporary Connections

During erection, temporary connection work shall be securely made by bolting and/or

welding for all dead load, wind and erection stresses.

d. Alignment

No permanent bolting or welding shall be done until the alignment of all parts with respect to each other shall be true within the respective tolerances required.

e. Field Welding

e. 1. Any shop paint or surfaces adjacent to joints where field welding is to be executed shall be wire brushed to remove paint/primer.

e. 2. Field welding shall conform to the requirements specified herein, except as approved by the Engineer.

f. High Strength Bolts

Final tightening of high strength bolts shall be done by using manufacturer's power operated equipment without any overstress to the threads.

g. Correction of Errors

g. 1. Corrections of minor misfits by use of drift pins, and reaming, chipping or cutting will be permitted and shall be provided as part of erection work.

g. 2. Any errors to be corrected or adjusted, preventing proper assembly, shall be immediately reported to the Engineer, and such corrections or adjustments shall be made as necessary and approved by the Engineer.

g. 3. Cutting or alterations other than as approved will not be permitted.

h. Erection

h. 1. Erection and installation shall be as per approved shop drawings.

h. 2. Each structural unit shall be accurately aligned by the use of steel shims, or other approved methods so that no binding in any moving parts or distortion of any members occurs before it is finally fastened in place.

h. 3. Operations, procedures of erection and bracing shall not cause any damage to works previously placed nor make overstress to any of the building parts or components. Damage caused by such operations shall be repaired as directed by the Engineer at no extra cost to the Employer.

## **GALVANIZING**

### **PREPARATION**

All mild steel parts exposed to weather shall be hot-dipped galvanized after fabrication in accordance with the requirements of ASTM A 123 or ASTM A 153. Prior to galvanizing, the surfaces shall be cleaned of dirt, weld splatter, grease, slag, oil, paint or other deleterious matters. The steel surfaces shall be chemically de-scaled and cleaned with the same abrasive blast or other suitable method as approved by the Engineer.

### **COATING**

The zinc coating shall consist of uniform layers of commercially pure zinc free from abrasions, cracks blisters, chemical spots or other imperfections, and shall adhere firmly to the surface of the steel. The weight of zinc coating per square meter of actual surface shall not be less than 550 grams. Any surface damaged subsequent to galvanizing shall be given two coats of approved zinc rich paints.

## **PAINTING**

This work shall consist of the preparation of the metal surfaces, the application, protection and drying of the painted surfaces, and supplying of all tools, tackle, scaffolding, labor and materials necessary for the entire work. Painting shall be applied in the field or shop as approved by the Engineer.

Unless otherwise specified or approved, all painting work for structural steel shall comply with the requirements of this Section.

### **SHOP PAINTING**

All structural steel shall be given a shop primer after fabrication and cleaning before delivery to the site.

All steel work shall be thoroughly dried and cleaned of all loose mill scale, rust and foreign matters by means of sand blasting or other suitable methods approved by the Engineer before shop painting shall be applied. Each individual piece shall be painted prior to assembly. Portions where field welding or field contact with concrete is required shall not be painted.

Except for galvanized surfaces and items to be encased in concrete, clean ferrous metal surfaces shall be given one coat of Amerlock 400 Epoxy Primer at 100 Microns or approved equal. Additional coat shall be applied to surfaces that will be concealed or inaccessible for finish painting by Amerlock 400, Top Coat at 150 Microns with color or equivalent.

### **FIELD PAINTING**

After erection, the Contractor shall thoroughly prepare and clean the entire surface of all structural steel from all dirt, grease, rust or other foreign matters. The entire surface of all members shall then be field painted.

## **MATERIALS**

### **1. Structural Steel Work**

- a. After surface preparation, steelwork shall be given one coat of approved prefabricating primer.
- b. Before final assembly of steelwork at the fabricator's shop, two shop coats of special red lead primer shall be applied to the surface of sections to be in permanent contact, meeting faces and all other concealed surfaces. After final assembly, but before delivery to the project site, the steelwork shall likewise be given two shop coats of special red lead primer.

### **2. Galvanized Steelwork**

All galvanized steelwork shall be treated with zinc chromate two-pack etch primer followed by one coat of non-etch zinc chromate primer.

3. Miscellaneous Metal Work

Unless otherwise specified in other Sections of the Specifications or shown on the drawing, miscellaneous metal works such as ladders, structural steel ladder rungs, etc. shall be given two shop coats of epoxy primer and two coats of epoxy enamel.

CONSTRUCTION METHODS

1. Cleaning of Surfaces

Surfaces of metal to be painted shall be thoroughly cleaned; removing rust, loose mill scale, dirt, oil or grease, and other foreign substances. Unless cleaning is to be done by sand blasting, all weld areas, before cleaning is started, shall be neutralized with a proper chemical, after which they shall be thoroughly rinsed with water.

Three methods of cleaning are provided herein. The particular method to be used shall be as directed by the Engineer.

2. Hand Cleaning

The removal of rust, scale, and dirt shall be done by the use of metal brushes, scrapers, chisels, hammers or other effective means. Oil and grease shall be removed by the use of gasoline or benzene.

Bristle or wood fiber brushes shall be used for removing loose dirt.

3. Sandblasting

All steel shall be cleaned by sandblasting. The sandblasting shall remove all loose mill scale and other substances. Special attention shall be given to cleaning of corners and re-entrant angles. Before painting, sand adhering to the steel in corners and elsewhere shall be removed. The cleaning shall be approved by the Engineer prior to any painting which shall be done as soon as possible before rust forms.

4. Flame Cleaning

All metal, except surface inside boxed members and other surfaces which shall be inaccessible to the flame cleaning operation after the member is assembled, shall be flame cleaned in accordance with the following operations.

- a. Oil, grease, and similar adherent matter shall be removed by washing with a suitable solvent. Excess solvent shall be wiped from the work before processing with subsequent operations.
- b. The surface to be painted shall be cleaned and dehydrated (free from occluded moisture) by the passage of oxyacetylene flames which have an oxygen to acetylene ratio of at least 1.0. The oxyacetylene flames shall be applied to the surfaces of the steel in such a manner and at such speed that the surfaces are dehydrated; dirt, rust loose scale in the form of blisters or scabs, and similar foreign matters are freed by the rapid, intense heating by the flames. The number arrangement and manipulation of the flames shall be such that all parts of the surfaces to be painted are adequately cleaned and dehydrated.
- c. Promptly after the application of the flames, the surfaces of the steel shall be wire brushed, hand scraped wherever necessary, and then swept and dusted to remove all free materials and foreign particles.

- d. Paint shall be applied promptly after the steel has been cleaned and while the temperature of the steel is still above that of the surrounding atmosphere.

5. Weather Conditions

- a. Exterior Coatings

Coatings to surface shall not be applied during foggy or rainy weather, or under the following surface temperature conditions: below 4°C, or over 35°C, unless approved by the Engineer.

- b. Interior Coatings

Coatings shall be applied when surfaces to be painted are dry and the following surface temperatures can be maintained: between 18 to 35°C during the application.

6. Application

- a. Paint shall be factory tinted and mixed. All paint shall be field mixed before applying in order to keep the pigments in uniform suspension.

- b. Field Painting

When the erection work is complete, including all bolting and straightening of bent metal, all adhering rust, scale, dirt, grease or other foreign materials shall be removed as specified above.

As soon as the Engineer has examined and approved each steel and metal works structures, all field bolts, all welds, and any surfaces from which the top or first coat of paint has become worn off, or has otherwise come defective shall be cleaned and thoroughly covered with one coat of paint.

Surfaces to be bolted and surfaces which shall be in contact with concrete, shall not be painted. Surfaces which shall be inaccessible after erection shall be painted with such field coats as are required. When the paint applied for retouching the shop coat has thoroughly dried, and the field cleaning has been satisfactorily completed, such field coats as are required shall be applied. In no case shall a succeeding coat be applied until the previous coat is dry throughout the full thickness of the paint film. All small cracks and cavities which were not sealed in a watertight manner by the first field coat shall be filled with a pasty mixture of red lead and linseed oil before the second coat is applied.

The following provision shall apply to the application of both coats. To secure a maximum coating on edges of plates or shapes, bolt heads and other parts subjected to special wear and attack, the edges shall first be striped with a longitudinal motion and the bolt heads with a rotary motion of the brush, followed immediately by the general painting of the whole surface, including the edges and bolt heads.

The application of the second field coat shall be deferred until adjoining concrete work has been placed and finished. If concreting operations have damaged the paint, the surface shall be re-cleaned and repainted.

- c. General Manners

Painting shall be done in a neat and workmanlike manner. Paint may be applied with hand brushes or by spraying, except aluminum paint which preferably shall be applied by spraying. By either method the coating of paint applied shall be smoothly and uniformly spread so that no excess paint shall collect at any point. If the work done by spraying is not satisfactory to the Engineer hand brushing shall be required.

d. Brushing

When brushes are used, the paint shall be so manipulated under the brush as to produce a smooth, uniform, even coating in close contact with the metal or with previously applied paint, and shall be worked into all corners and crevices.

e. Spraying

Power spraying equipment shall be used to apply the paint in a fine spray. Without the addition of any paint, the sprayed area shall be immediately followed by brushing, when necessary, to secure uniform coverage and to eliminate wrinkling, blistering and air holes.

f. Removal of Paint

If the painting is unsatisfactory to the Engineer the paint shall be removed and the metal thoroughly cleaned and repainted.



**ITEM 10 : Floor Finishes**

**GENERAL**

General Requirements contain provisions and requirements essential to these Specifications; and apply to this section, whether or not referred to herein.

**SCOPE OF WORK**

This section covers all works required in connection with wall and floor finishes on concrete surfaces in accordance with this Specification and as shown in the Plans.

**MATERIAL REQUIREMENT**

**Tile Works**

1. Floor Tiles - Tiles shall be standard grade, unglazed vitrified tiles, and 6 mm thick. Color and pattern shall be as specified in the drawings or as approved by the Engineer.
2. Ceramic Tiles - It shall be of the standard good quality grade, gloss smooth finish; color, texture and size code should be strictly adhered as shown in the Plans.
3. Tile Adhesive - Tile adhesive (tile bonding agent) shall be used as the dry set mortar to install tiles on walls and floors employing the thin-set method conforming to ANSI A108.16

**SUBMITTAL**

1. Shop drawings for all gang chair for the building shall be submitted in advance to allow twenty-eight days for review and approval. Shop drawings shall indicate materials and details of finishing works. The Contractor shall be responsible for all errors of detailing and fabrication, and for the correct finishing work items shown on the shop drawings.
2. The Contractor, before placing order for the supply shall submit to the Engineer for approval representative samples of finishing materials. No placing of orders for material for finishing works shall be made without his approval.

**STORAGE AND DELIVERY**

Cement and lime shall be stored off the ground under watertight cover, and away from damp walls and surfaces until ready for use. Damaged or deteriorated materials shall be removed from the premises immediately. Manufactured materials shall be delivered in the original unbroken packages or containers that are labeled plainly with the manufacturer's names and brand. Container for tiles shall be grade-sealed. Materials shall be handled in a manner that will prevent the intrusion of deleterious materials that will affect its quality and appearance.

## EXECUTION

### Tileworks

#### 1. General

The work consist of furnishing all materials, labor and performing all operations in connection with tile finishing of floors and walls, complete including mortar beds for the tile. Tileworks shall not be started until roughing-ins for plumbing and electrical work has been completed and tested. The work of all other trades in the area where the work is to be done shall be protected from damage in a workmanship manner as directed by the Engineer.

#### 2. Mortar for Tiles

A scratch coat for wall tile shall be ABC or approved equivalent. Scratch coat shall have a minimum thickness of 9mm. The buttering mortar for setting wall tiles and mortar setting bed for floor tiles shall have the same material as that of scratch coat

#### 3. Floor Tiling

##### a) Preparation of Surfaces

Before tile is applied with a dry-set mortar bed, the structural floor shall be tested for levelness or uniformity of slope by flooding it with water. Areas with water ponds shall be filled, levelled and retested before the setting bed is applied. The slab shall be soaked thoroughly with clean water on the day before the setting bed is applied. Immediately preceding the application of the setting bed, the slab shall again be wetted thoroughly but no free water shall be permitted to remain on the surface. A skim coat of ABC cement mortar shall then be applied not more than 1.5 mm thick. The mortar shall be spread until its surface is true and even, and thoroughly compacted, either level or sloped uniformly for drainage, where required. A setting bed, as far as can be covered with the tile before the mortar shall have reached its initial set, must be placed in one(1) operation, but in the event that more setting mortar has been placed than can be covered, the unfinished portion shall be removed and cut back to a clean levelled edge.

##### b) Installation of Floor Tile

All tiles shall be soaked in clean water to a minimum of one (1) hour before they are installed. Absorptive mounted tile shall be damped by placing tile on a wetted cloth in a shallow pan before installing. Before the initial set has taken place in the setting bed, a skim of ABC cement mortar .75 mm to 1.5 mm thick shall be troweled or brushed over the setting. The tiles shall then be pressed firmly upon the setting bed, and carefully tapped into the mortar until true and even with the place of the finished floor base. Tapping and levelling shall be completed within one (1) our after placing tiles. Borders and defined lines shall be laid before the field or body of the floor. Where floor drain is provided, the floor shall be sloped properly to the drains. Cutting of tiles, where necessary, shall be done along the outer edges of tile against trim, base, thresholds, pipes, built-in fixtures, and similar surfaces and shall be geared and joined carefully. Tiles shall be secured firmly in place, and loose tiles or tiles sounding hollow shall be removed and replaced to the satisfaction of the Engineer. All lines shall be kept straight, parallel and true and all finished surface brought to true and even planes.

4. Jointing

Joints shall be parallel and uniform in width, plumb, level and in alignment. End joints in broken-joint shall be made, as far as practicable, on the center line of the adjoining tiles. Joint widths shall be uniform and measured to accommodate the tiles in the given spaces with a minimum cutting.

5. Grouting

Grouting shall be done as soon as the mortar beds have sufficiently set. All cement shall be Portland cement, colored or white, as required. Where light colored mortar is required in joints, a mixture of white cement and non-fading mineral oxide shall be used to produce the desired colors. The quantity of mineral oxides shall not exceed 10% of the volume of cement in any case.

6. Cleaning

Upon completion of grouting, the tile shall be thoroughly cleaned and maintained in this condition until completion of the contract.

## INSPECTION

1. All works and materials supplied under this Specification shall be subject to inspection by the Project-In-Charged.
2. The Contractor shall correct such works or replace such materials found defective under these Specifications at his own expense.

## ITEM 11 : ROLL UP DOOR

### GENERAL

General Requirements contain provisions and requirements essential to these Specifications; and apply to this section, whether or not referred to herein.

### SCOPE OF WORK

The work shall cover the fabrication, delivery and complete installation of doors including glazing for the building. The works shall consist of furnishing all labor, materials, tools, equipment and other incidentals necessary for the complete installation of the above mentioned doors, including glazing, as shown on the drawings and in accordance with this specifications or as directed by the Engineer.

### MATERIAL REQUIREMENT

#### ROLL-UP DOOR

1. Roll up door shutters shall be made of cold rolled pre-painted, galvanized steel or black Iron and must be of structural section to withstand all conditions of stresses to which it may be subjected during opening and closing operations and wind pressure of 196 kg/m. Roll-up door shall be ball bearing mounted to suspend the heavy rotating members. Full door weight shall be carried by side guides.
2. Guides shall consist of steel structural shapes or formed steel not less than 50mm deep and 1.2mm to 1.4mm thick (Pre-painted galvanized steel/black iron) Guide shall be securely attached to wall or column by 10mm diameter by 83mm hexagonal bolts with expansion shield spaced at 600mm on center. Pre-painted and galvanized side guides shall be installed with PVC reinforcement as sound reducer.
3. Curts shall be formed by interlocking steel slots, roll formed from 0.80mm to 1.20mm, depending on the requirements, pre-painted, galvanized steel or B Iron sheets. Windlocks shall be provided as required by door size and shall withstand wind pressure of 196 kg/m. Windlocks shall be galvanized malleable cast iron and fastened to curtains slats with three or more zinc-plated steel rivets per lock.
4. Bottom bar of the curtain will be reinforced with two (2) pieces of angular bars of not less than 44mm x 44mm x 1.60mm thick pre-painted, galvanized steel or black iron. Compressible and replaceable rubber vinyl weather strip shall be attached on the bottom rail
5. Brackets shall be fabricated of heavy cast iron or steel, designed to close the end of the roller shaft housing and to form a supporting ring or hood. Bracket hubs or shaft plugs shall be equipped with pre-lubricated ball bearings, shielded or sealed. Endlocks made of malleable cast iron, galvanized and fastened to alternating slats shall be installed to prevent slats from wearing at the surface coming in contact with the side guides. Roller shaft shall be constructed of steel pipe or commercial steel tubing of proper diameter and thickness for the size of the curtain. Deflection shall not exceed 0.030 inch per foot of span. End of roller shall be closed with cast iron plugs machine to fit the pipe.
6. Rubber bumpers shall be installed to protect the base of the roll-up doors even when ample pressure is applied on pushing the door up. The bumpers shall also minimize the load, clashing sound when the doors are lifted.

**SUBMITTAL**

The Contractor shall submit the shop drawings for the fabrication of the doors and windows to the Engineer for approval, twenty eight days before the start of works.

The shop drawings shall indicate the following:

1. Elevations for each type;
2. Details for each type;
3. Location in the building for each item;
4. Typical and special details of construction; and
5. Location and installation requirements for hardware.

**STORAGE AND DELIVERY**

All doors and windows and door frames shall be delivered, stored and handled so as not to be damaged or deformed. All doors and windows and door frames stored at the site before installation shall be stocked vertically on non-absorptive strips or wood platforms and covered with suitable covering to provide weathertight protection and proper air circulation.

**EXECUTION****WOOD DOORS**

Wood panel doors shall be of the designs, sizes and thickness as shown on the drawings. Frames shall be set plumbed and true and braced to prevent distortion.

Frames in concrete and masonry walls shall be secured by anchor bolts or as shown on the drawings or as directed by the Engineer.

1. Wood panel doors shall be of the types, sizes and thicknesses as shown on the drawings. Top and bottom edges of all interior and exterior doors shall be given a coat of lead and oil priming paint or a coat of water-resistant spar varnish after cutting, fitting and prior to installation in the work. Doors shall be glazed as indicated. Doors shall be primed before glazing
2. Flush wood doors shall be fabricated such that the entire core and frame assembly shall be bonded to the face veneers with approved type of water resistant adhesives, and cured under controlled heat and pressure. Facing shall be waterproofed plywood or ordinary plywood as shown on the drawings. Items of finishing hardware specified in other sections of the specifications shall be fitted carefully and attached securely. Care shall be exercised so as not to mar or injure the work.
3. Hinged doors shall be plumbed and fitted accurately allowing 1.5 mm clearance at the jambs and heads and 3.0 mm over thresholds. Clearance at the bottom of the door having no thresholds shall be 9.5 mm. Lock stiles of door 44.5 mm thick and thicker shall be beveled 3 mm. Knob locks and latches shall be installed 1.75 mm from the finished floor to the center of the locks.

**STEEL DOOR**

The installation of steel door and frames shall be performed by the Contractor under the supervision of the manufacturer. Frames shall be prepared to receive standard hardware, provided with anchors for building into masonry, and shall extend 63 mm (2-1/2") below finished floor lines.

All steel doors shall be checked for warps and when installed shall be hung plumb and true and when closed shall contact the joint over its entire length

## ALUMINUM DOORS AND WINDOWS

### 1. Fabrication

All frames shall be factory prefabricated in accordance to the designs and dimensions indicated in the Drawings. Minimum metal wall thickness shall be 3mm except glazing beads, moldings, and trim which shall not be less than 1.5mm. Frames that are to receive fixed glass shall have removable glass stops and glazing beads.

Cut, join and fit rails and stiles to hairline joints securely reinforced and joined by means of concealed fastening wherever possible.

**Protective Coating:** Clean all surfaces and apply a protective coating of clear, water-white methacrylate-type lacquer, resistant to alkaline mortar and plaster immediately after fabrication. Covering shall not chip, peel or flake due to temperature or weather, and shall protect against discoloration and surface damage from transportation, storage, and construction activities. Covering shall be readily removable without affecting the finish. Covering shall either be adhesive paper, waterproof tape, or strippable plastic and may not be removed even after completion of installation.

### 2. Installation

Set and anchor frames as shown in details and in approved shop drawings.

Set frames plumb and square and brace where necessary to prevent distortion. Set frames without springing, forcing or distorting the product.

Secure frames in accordance with the manufacturer's instructions.

Wedge clear of masonry all frames set in prepared openings 4.76 mm (3/16) to 6.35 mm (1/4") to allow for caulking. Aluminum louvers can be installed flush-mounted to fit masonry or as free standing barriers or screens.

**Protection of aluminum from dissimilar materials:**

**Aluminum to dissimilar metals:** where aluminum surfaces come in contact with metals other than stainless steel, zinc or white bronze of small area, keep aluminum surfaces from direct contact with incompatible metals by the following methods:

**Painting the dissimilar metal with one coat of heavy-bodied bituminous paint.**

- Applying good quality caulking materials between the aluminum and the dissimilar metal.

**Drainage from dissimilar metals:** Paint dissimilar metals used in location where drainage from them passes over aluminum as specified above, to prevent staining of aluminum.

**Aluminum to masonry and concrete:** Give aluminum surfaces in contact with mortar, concrete, or other masonry materials one coat of heavy-bodied bituminous paint.

Adjust all frames and attach hardware before glazing.

Secure all windows and doors to be watertight and all hardware operating free and easy.

Upon completion and installation, thoroughly clean surfaces of doors and frames in accordance with the recommended procedure of the manufacturer. Do not use abrasive, caustic or acid cleaning agents.

## PVC DOORS

#### **1. Fabrication**

Fabricate frames and panels with mitered and fusion welded corners and joints. Trim and finish corners and welds to match adjacent surfaces.

Provide concealed metal reinforcement in sash frame for attaching lock mechanism.

#### **2. Examination**

- a) Examine openings in which doors will be installed.
- b) Verify that fasteners in framed walls are fully driven and will not interfere with door installation.
- c) Verify that sill is flat and level.

#### **3. Installation**

Install doors in framed walls in accordance with manufacturer's installation instructions.

#### **4. Adjusting**

Adjust operating panels and hardware for smooth operation and tight fit with weatherstripping.

#### **5. Cleaning**

Clean soiled surfaces using a mild detergent and warm water solution with soft, clean cloths.

### **TOILET DOORS AND PARTITIONS**

- 1. Install toilet partitions on the locations and heights indicated on the drawings and according to manufacturer's recommended instructions.
- 2. Hardware shall be checked and adjusted for smooth operation after installation.

### **ADJUSTMENTS**

- 1. Adjust all frames and attach hardware before glazing.
- 2. Secure all windows and doors to be watertight and all hardware operating free and easy.

### **CLEANING**

Upon completion and installation, thoroughly clean surfaces of doors and frames in accordance with the recommended procedure of the manufacturer. Do not use abrasive, caustic or acid cleaning agents.

**ITEM 12 : PLUMBING AND SANITARY WORKS****SCOPE OF WORK**

The work covered for this section shall consist of furnishing all labor, tools, equipment, materials and incidentals necessary for the complete installation, testing and operation of the plumbing and sanitary system within the buildings and premises in accordance with these Specifications and as shown on the drawings or as directed by the Engineer. The septic tank and their effluent and discharge pipelines shall be part of other section of these specifications.

**MATERIAL REQUIREMENTS****SUBMITTAL**

1. The Contractor shall submit his work method statement with necessary shop drawings to the Engineer for approval twenty eight (28) days before the start of the works.

Shop drawings shall be dated and shall contain the name of the project and location of the subject item in the shop drawing which is to be installed.

The Engineer will review and approve or return for correction all shop drawings with reasonable promptness. The Contractor shall make any corrections required and file with the Engineer three (3) corrected copies of the shop drawings.

2. The drawings shall indicate the general arrangement of all pipings, however, where actual conditions necessitate re-arrangement in opinion of the Contractor and/or the Engineer, the Contractor shall prepare and submit to the Engineer for approval, twenty eight (28) days before placing the order for materials, shop drawings of the proposed re-arrangement. Because of the small scale of the drawings, shop drawings to indicate all offsets, fittings and accessories shall be prepared. The Contractor shall carefully examine the drawings and shall carefully investigate actual structural and finish conditions affecting all his work.
3. The Contractor shall be responsible for the proper fitting of materials, equipment and accessories without substantial alteration and at no cost to the Employer.
4. The Contractor shall be responsible for the proper coordination of the work and shall provide all necessary clearance where necessary.

**STANDARDS**

Use of materials shall further be governed by other requirement imposed on other sections of these Specifications. Materials shall be subject to tests necessary to ascertain their fitness if the Engineer so requires. All works shall comply with the pertinent provisions of the Plumbing Code of the concerned city or town, the Code on Sanitation of the Philippines, and/or the National Plumbing Code of the Philippines.

**MATERIALS**

1. Identification of Materials

Each length of pipe, fittings, traps, fixtures and devices used in the plumbing work shall have cast, stamped or indelibly marked on it, the approved manufacturer's trademark or name, the weight, type and class of product when so required by the standards mentioned



above.

**2. Alternative Materials**

Use of any material not specified in this Specification may be allowed provided such alternate has been approved by the Engineer and provided further that a test, if required, shall be done by an approved agency in accordance with generally accepted standards.

**3. Soil, Waste, Drain, Vent Pipes and Fittings**

Soil, waste and vent pipes shall be unplasticized Polyvinyl Chloride (uPVC) pipes. Diameter shall be as indicated on the Drawings. It shall conform to ASTM D 1784 or ASTM D 2729.

Drainage pipes shall be reinforced concrete pipes (RCP), diameter shall be as indicated on the Drawings.

**4. Jointing Material**

The joint material for uPVC pipes shall be PVC solvent cement as recommended by the approved pipe manufacturer.

**5. Water Supply Pipes**

Water supply pipes shall be polypropylene random-80 (PPR-80) pipes PN 20 conforming to DIN Standards DIN 1988/DIN 8078, German made. Jointing shall be fusion welded.

**6. Cleanouts, Plugs and Tee**

Cleanouts shall be of the same material as the pipe to be fitted. Cleanouts installed in connection with uPVC hubs and spigot pipes shall consist of a long sweep quarter bend of  $\frac{1}{4}$  as shown on the drawings.

**7. Pipe Sleeves**

Pipe sleeves shall be installed and properly secured in place at all points where pipes passes through masonry or concrete. Pipe sleeves shall be uPVC pipe, Schedule 40.

**8. Downspout**

All downspout shall be unplasticized polyvinyl chloride (uPVC) pipe class DWV conforming to ASTM D2729 or ASTM D1784 for sanitary pipes, Series 1000.

**9. Splash Block**

Provide splash blocks at the outlet of downspout emptying at grade which shall be made of pre-cast concrete, with smooth finished counter sunk dishes sloped to drain away from the building. Dimensions as shown on the Drawings.

**10. Roof Strainers**

The Contractor shall provide fittings and install 100mm G.I. mesh wire strainers where shown or indicated on the drawings and/or where the Engineer directs. Each strainer shall fit the size of the corresponding downspout which is to be installed.

**11. Shower, Floor and Urinal Drain**

Shower and floor drains shall be made of stainless steel non-tilting grate, perforated or slotted. Urinal drains shall be cast iron dome type drain.

**12. Pipe hangers, Inserts and Support**

- a. Pipe hangers shall be wrought iron, malleable iron pipe hangers spaced not over 1.5meters apart for uPVC pipes and 3.0meters apart for iron pipes. Chain straps, perforated bars or wire hangers will not be permitted.

Hangers shall have short turnbuckles or other approved means of adjustment. Turnbuckles may be omitted on hangers where space does not permit their use. Trapeze hangers may be used in lieu of separate hangers for pipes running parallel to each other and close together.

- b. Inserts shall be of cast iron or cast steel and shall be of a type to receive a machine bolt head or nut after installation.

- c. Wrought iron clamps or collars shall be used to support vertical runs of pipes.

**13. Unions**

Union pipe 50mmØ and smaller shall be malleable iron. Union on water piping 63mmØ and larger shall be flanged pattern and shall be of galvanized (zinc coated) cast iron. Gaskets for flange unions shall be of best quality fiber plastic or leather.

**14. Valves**

Valves shall be cast bronze or brass body. Chrome plated finish for all fixture taps and faucets and natural finish for all others, like hose bibbs, gate valves and which are not tapped directly to a plumbing fixture. Concrete valve boxes shall be installed where required and will be of sufficient size for operating the valve.

**15. Fixtures****a. Water Closets**

All water closets for toilets as shown on the drawings shall be TANK TYPE, white with complete fittings and mounting accessories.

**b. Lavatories****b. 1. Lavatory (Wall Hung)**

Shall be vitreous china, wall hung lavatory with rear overflow holes, fitting ledge suitable for single faucet holes on centers complete with faucet, standard fittings, trap and lavatory brackets and other accessories.

**b. 2. Lavatory (Countertop Lavatory)**

Shall be vitreous china, oval or round shaped countertop lavatory with front overflow hole, complete with faucet, supply valve and fittings with P-trap.

Fitting ledge suitable for single hole on center.

c. Urinals

- c. 1. Urinals for all comfort buildings shall be built-in urinal trough as shown on the drawings.
- c. 2. Urinals shall be vitreous china, wall-hung washout urinal, flushing rim, integral trap, 19mm top and shall be provided with water saving flush system.

d. Service Sinks

Service sinks where indicated or shown on the Drawings shall be stainless steel, with single bowl and with complete U.S. or Japan imported fittings.

e. Slope Sinks

Slop sink shall be 24"x20" acid resisting enamel on Cast-Iron with concealed hanger and faucet.

Hose bibb shall be of brass finish.

f. Soap Holder

Soap holder and toilet paper holder shall be vitreous china, wall mounted. All toilet/bath rooms will be provided with soap holder, toilet paper holder and chrome plated towel racks.

g. Faucet for lavatory

Faucet for lavatory shall be in chrome-finish.

h. Bath and shower fitting

Bath and shower fitting shall be chrome-finish.

i. Towel Rail

Towel rail shall be tubular stainless steel, 2.7mmØ, and 0.54m long or as specified in the drawings.

j. Curtain rod

Curtain rod shall be tubular stainless steel, 19mmØ or as specified in the drawings.

k. Grab Bar

Grab bar shall be tubular stainless steel, 25mmØ or as specified in the drawings.

l. Bidet Spray Combination

Installed in every cubicle near on the water closet, colored white or its equivalent

16. Concrete, Reinforcing Steel, Pipe and Steel Plate

Materials for wash pits, catch basins and manholes shall conform to the requirements as follows:

- a. Concrete materials shall conform with the requirements in "Concrete Works" and shall be Class C concrete with a 28-day minimum compressive strength of 21 MPa (3,000 psi).
- b. Reinforcing steel shall be as shown on the drawings and shall conform with the requirements of reinforcing steel bars in "Concrete Works."
- c. Pipes shall be as shown on the drawings and shall comply with the relevant item of the particular pipe.
- d. Steel plates shall be as shown on the Drawings and shall comply with Section "Steel and Metal Works".

#### 17. Non-reinforced Concrete Pipe

Non-reinforced concrete pipe shall be as shown on the Drawings and shall conform with the requirements of non-reinforced concrete pipes AIC latest edition. Concrete shall be with a 28-day minimum compressive strength of 20.7 MPa.

#### 18. Valve for Drinking Fountain

Valve where drinking fountain will be connected shall be polished brass pipe and shall have red enameled handle.

### EXECUTION

All installation works shall be in conformity with the National Plumbing Code of the Philippines (NPCP).

#### EXCAVATION, TRENCHES AND BACKFILLING

1. Trenches for all underground pipelines shall be excavated to the required depth. The bottom of trenches shall be tamped hard and graded to secure the required fill. Bell holes shall be excavated so that pipes will rest on solid ground for their entire length.

Rocks where encountered, shall be excavated to a depth of 150mm below the bottom of the pipe and before the pipe is laid, the space between the bottom of the pipe and the rock shall be filled with sand. Sewer and water pipes shall be laid in separate trenches.

2. After pipelines have been tested, inspected and approved by the Engineer and prior to backfilling, all forms shall be removed and the excavation shall be cleaned of all trash and debris.

Materials for backfilling shall consist of acceptable excavated soil, borrow of sand, gravel or other materials approved by the Engineer and shall be free from trash, lumber or other debris. Backfilling shall be placed in horizontal layers not exceeding 150 mm in thickness and properly moistened to approximate optimum requirements. Each layer shall be compacted by hand or machine tamper or by other suitable equipment to a density that will prevent excessive settlement or shrinkage.

Backfilling shall be brought to a suitable elevation above grade to provide for anticipated settlement and shrinkage thereof.

Water pipes shall have a sand cushion 150mm below and above the pipes.

## INSTALLATION OF SOIL, WASTE DRAINS OR VENT PIPES

### 1. Horizontal Drainage Pipe and Vent Piping

Horizontal waste pipes 75mmØ and smaller shall have a minimum grade of 6.5mm per 0.30m and for 100mmØ and larger, 3.2mm per 0.30m. All main vertical soil and waste stacks shall be extended full size above the roof line as vents, except where otherwise specifically shown.

Where practicable, two (2) or more vent pipes shall be connected together and extended as one pipe through the roof. Vent pipes in roof spaces shall be run as close as possible to the underside of roof with horizontal piping pitched to stacks using fittings as required without forming traps in pipes.

Vertical pipe vents may be connected to a vent line carrying other fixtures. The connection shall be at least 1.20m above the floor on which the fixtures are located to prevent the use of vent lines as waste. Horizontal waste lines receiving the discharge from two (2) or more fixtures shall be provided with vents, unless separate venting of fixtures is noted.

### 2. Fittings

All changes in pipe sizes on soil waste lines shall be made with reducing fittings or recessed reducers. All changes in direction shall be made by the appropriate use of forty five (45) degree wyes. Long sweep quarter bends or elbows may be used in soil and waste lines where the change in direction of flow is from the horizontal to the vertical and on the discharge from water closets.

Where it becomes necessary to use short radius fittings in any location, the approval of the Engineer shall be obtained before they are installed.

### 3. Joints

#### a. PVC Soil Pipe

All joints in uPVC soils, waste and vent pipe shall be accomplished by the use of PVC solvent cement.

b. All joints for uPVC shall be accomplished by applying the manufacturer's recommended solvent before connection to the pipe.

### 4. Cleanouts

Cleanouts at the bottom of each soil stack, waste stack and where else indicated shall be the same size at the pipe.

Cleanouts on floors shall be by uPVC plug adapter fit into the hub and fitted with uPVC screw plugged flush with the floor.

Cleanout shall be provided at every change in direction greater than 45 degrees.

### 5. Flashings

All pipes passing through the roof shall be provided with lead flashings. All flashings shall be built to 40 lbs. bituminous felts and shall extend up to the pipe and down-over to top of pipe at least 150mm and along the roof not less than 300mm and shall lap over flashing to

make a weatherproof joint.

**6. Traps**

Each fixture and piece of equipment requiring connections to the drainage system, except fixtures with continuous waste shall be equipped with a trap. Traps shall be specified to be supplied with the fixtures. Each trap shall be placed as near to the fixtures as possible. Traps installed on threaded pipes shall be recessed drainage pattern.

**7. Pipe Sleeves, Hangers and Supports**

Pipe sleeves shall be installed and properly secured in place at all points where pipes pass through masonry or concrete except unframed floors on earth.

Pipes shall not be permitted to pass through footings or beams unless noted on the drawings.

Pipe sleeves in floors shall extend not less than 25mm and not more than 50mm above the finished floor. After installation of the pipe, the space around the pipe shall be packed with plastic material and made watertight. Flashing shields for sleeves passing through waterproofing membrane shall be thoroughly mopped into the membrane. The space between the pipe and sleeves shall be made watertight by inserting approved sealing and caulking materials.

**INSTALLATION OF WATER PIPES, FITTINGS AND CONNECTIONS**

**1. Gate Valves and Outlets**

Gate valves shall be installed close to the point of connection to the existing service line outside the building. The piping shall be extended to all fixture outlets and equipment from the gate valves. Outlets where indicated shall be capped or plugged and left ready for future connections.

**2. Mains, Branches and Runouts**

All runs of piping shall be installed as shown on the drawings. The piping shall be cut accurately to measurements, and installed at the building site by the Contractor and shall be worked into place without springing or forcing. Care shall be taken not to weaken the structural portions of the buildings.

All pipes above ground shall be run parallel with the lines of the building unless otherwise shown on the drawings. Branch pipes from service lines may be taken off on top of mains, bottom of mains or side of mains, using such cross over fittings as may be required by structural or installation conditions.

All service pipes, valves and fittings shall be kept at sufficient distance from the other work to permit finished covering not less than 6.5mm from such other work and not less than 13mm between finished covering on different services. No water piping shall be buried in floors unless specifically indicated on the drawings or approved. Changes in pipe sizes shall be made with reducing fittings.

The use of long screws and bushings is prohibited.

**3. Joints**

Joints and connections in the plumbing system shall be gas-tight and watertight for the pressures required by test.

After cutting and before threading all pipes shall be reamed and shall have burrs removed. All screwed joints shall be applied with an approved graphite compound or TEFLON tape to facilitate connections. Threads shall be full cut and not more than three threads on the pipe shall remain exposed.

Caulking of threaded joints or top to prevent leaks shall not be permitted.

Unions shall be provided where required for disconnection. Threaded swing bolts shall be used for branch connections to risers and mains.

#### 4. Unions

Where required unions shall not be concealed in walls, ceilings or partitions.

#### 5. Tests

The following tests shall be conducted by the Contractor at his expense under the supervision of the Engineer.

##### a. Tests for Drainage and Venting System

The entire drainage and venting system shall have necessary openings plugged to permit the entire system to be filled with water to the level of the highest vent stack above the roof. The system shall hold the water for 30 minutes with a drop not greater than 100mm.

##### b. Sterilization

The entire water supply piping system shall be sterilized with a solution containing not less than fifty (50) parts per million of available chlorine, either liquid chlorine or a solution of sodium hypochlorite. The sterilizing solution shall remain in the system for a period of not less than 8 hours during which time all valves and faucets shall be opened and closed several times. After sterilization, the solution shall be flushed from the system with clean water until the residual chloride content is not more than 0.2 parts per million.

##### c. Pressure Test for Water Lines

1. After the pipe have been installed, the joints completed and with joints exposed for examination, all newly installed pipe or any valve section, thereof, shall be subjected to hydrostatic pressure one and one half (1½) the designed working pressure of the system or as specified by the Engineer.
2. The duration of each pressure test shall be at least 20 minutes unless otherwise specified by the Engineer.
3. Each section of pipeline shall be slowly filled with water and the specified test pressure, measured at the point of lowest elevation, shall be applied by means of a pump connected to the pipe in a manner satisfactory to the Engineer. During the filling of the pipe and before applying the test pressure, all air shall be expelled from the pipeline. To accomplish this, tap shall be made if necessary, at the highest point of the pipe under test and after completion of the test, the taps shall be tightly plugged unless otherwise specified. During the test, all exposed pipes, fittings, valves, joint and

couplings will be carefully examined. If found to be cracked or defective, they shall be removed and replaced by the Contractor with sound materials at his expense. The test shall then be repeated until satisfactory results are obtained.

**d. Leakage Test for Water Lines**

1. Leakage test shall be conducted after satisfactory completion of the pressure test and shall consist of an examination of all exposed joints for leakage as well as an overall leakage test of the completed pipeline.
2. The pressure to be maintained during the test shall be the designed working pressure of the system.
3. Leakage test shall be made only after a minimum of 24 hours after the pipe to be tested has been filled with water.
4. The duration of each leakage test shall be two hours unless otherwise specified by the Engineer.
5. Each section of pipeline shall be slowly filled with water and the specified test pressure, measured at the point of lowest elevation shall be applied by means of a positive displacement type pump and reservoir connected to the pipe in a manner satisfactory to the Engineer.
6. Before starting the leakage test, all air shall be expelled from the pipe. All exposed pipes, fittings, valves and joints shall be examined for leakage during the test.
7. Allowable leakage rate per 100 joints per inch of Pipe Diameter at Pressure Stipulated.

PRESSURE		LEAKAGE RATE	
psi	kg/cm <sup>2</sup>	liters/hr.	liters/2 hrs.
50	3.50	1.45	2.90
75	5.30	1.75	3.50
100	7.00	2.05	4.10
125	8.80	2.30	4.60
150	10.50	2.50	5.00
200	14.00	2.90	5.80

**e. Defective Work**

1. If the inspection or test shows any defect, such defective work or material shall be replaced and the test shall be repeated until satisfactory to the Engineer.
2. All repairs to piping shall be made with new materials at the expense of the Contractor.
3. No caulking of screwed joints or holes will be accepted.

**ASSEMBLY, INSTALLATION AND CONNECTION OF FIXTURES**

Fixtures shall be supported and fastened in a satisfactory manner. Where secured to concrete or masonry work walls, fixtures and equipment shall be fastened with brass bolts or machine screws in



lead-sleeve type anchorage units or with brass expansion bolts. Expansion bolts shall enter 7.5 cm into solid concrete or masonry works and shall be fitted with loose tubing or sleeves of proper length to bring expansion sleeves into the solid concrete masonry walls.

Where wood screws are used, screws shall go into solid pieces set between studs. Where through-bolts are used, bolts shall be provided with plates or washers at back set, so that they will be concealed by plaster. Bolts and nuts shall be hexagonal and exposed nuts, cap nuts, and screw heads shall be provided with chromium plated brass washers.

## PROTECTION OF FIXTURES

Pipe openings shall be closed with caps or plugs during installation. Fixtures shall be tightly covered and protected against dirt, water and chemical injury. At the completion of all works, all fixtures shall be thoroughly cleaned and delivered in a condition satisfactory to the Engineer.

## FIXTURES AND FASTENING

All fixtures shall be supported and fastened in a satisfactory manner as follows:

1. Where secured to concrete or concrete hollow block walls, they shall be fastened with one quarter inch brass bolts with twenty threads to the inch and of sufficient length to extend at least 7.5 cm into solid concrete or hollow block work, fitted with loose tubing or sleeve insert and shall be securely anchored and installed flush with the finished wall and shall be completely concealed when the fixtures are installed.
2. Where through-bolts are used, they shall be provided with plates or washers back set so that heads, nuts and washers will be concealed by plaster. Bolts and nuts shall be hexagonal. Exposed bolts, nuts, capnuts and screw heads shall be provided with chromium plated brass washers.

## GUARANTEE

Upon completion and before final acceptance of the equipment installation, the Contractor shall furnish the Engineer a written guarantee stating that all equipment installed under this Section free from defects. The guarantee shall be for a period of one (1) year from the date of final acceptance of the work. Any part of the equipment that becomes defective during the term of the guarantee shall be replaced, renewed and/or made good by the Contractor, at his own expense and in a manner satisfactory to the Engineer.

Guarantees made by the approved manufacturers or suppliers beyond one year, shall be transferred to PPA without any expense on his part.

## CLEANING UP

Upon completion of the work, all parts of the installation shall be thoroughly cleaned of grease, metal cuttings and sludge which may have accumulated during the testing operation.

## PLUMBING, FIXTURES AND TOILET ACCESSORIES INSTALLATION

All installation works shall be as shown on the drawings and shall conform to the applicable standards set forth by the Philippine National Plumbing Code. All fixtures shall be fastened and/or supported in accordance with the given requirements.

## **ITEM 13 : CONCRETE WATERPROOFING**

### **GENERAL**

General Requirements contain provisions and requirements essential to these specifications and apply to this Section, whether or not referred to herein.

### **SCOPE OF WORK**

The work shall cover the waterproofing requirements for building as shown on the drawings.

The work shall consist of furnishing all labor, materials, equipment and other incidentals necessary for the integral waterproofing works where required as shown on the drawings and in accordance with the requirements of these specifications as directed by the Project - In -Charged.

### **SUBMITTAL**

1. Material description and physical properties, application details, and recommendations regarding shelf life, application procedures, and precautions on flammability and toxicity.
2. Samples for each waterproofing type.

### **DELIVERY AND STORAGE**

Deliver manufactured waterproofing materials in manufacturer's original, unopened containers, with labels intact and legible. Containers of materials covered by referenced specification number shall bear the specification number, type, and class of the contents. Store and protect materials in accordance with the manufacturer's instructions, and use within their indicated shelf life. Promptly remove from the site materials or incomplete work adversely affected by exposure to moisture. Use pallets and canvas tarpaulins to cover stored materials top to bottom.

### **PRODUCTS**

#### **I. DEEP PENETRATING SEALER**

Deep Penetrating Sealer ( DPS ) is an environmentally friendly, non-toxic, odorless, clear, water-soluble liquid compound, which is safe and easy to use.

Deep Penetrating Sealer (DPS) penetrates below the surface and chemically reacts with the alkali and lime found in concrete. This reaction creates a silica gel membrane within the pores and capillaries of the concrete, permanently sealing it against the ingress of moisture yet allowing the concrete to breathe. Over a period of time, the silica gel membrane hydrates and solidifies into a crystalline structure, increasing the hardness and strength of both new and old concrete while reducing moisture vapor emissions and permanently stopping the penetration

and flow of water and water-borne contaminants such as chlorides and acids, both on the positive or negative side forging a waterproofed and preserved concrete structure.

## EXECUTION

- All existing dirt and other surface contaminants adhering on the surface must be thoroughly removed. Apply Concrete Neutralizer using sufficient coats to completely neutralize the surface. Do not wash off. When sufficiently dry, dust lightly to remove crystalline deposits.
- Mix thoroughly the product mixture as per manufacturer's instruction. Any change from the recommended proportion will affect its quality. Scrape the bottoms, sides and corners of the container to ensure complete and full blending. Prepare only enough quantities that can be used within the pot-life period. Do not delay application. Apply DPS by brush or roller or by using an airless spray.
- Allow to cure overnight prior to application of topcoat.

## II. FLEXIBLE MODIFIED CEMENTITIOUS

Flexible Modified Cementitious (FMC) is a two-component latex modified cementitious coating. It can be simply achieved by mixing the pre-packed dry-mixing powder with the formulated flexible latex admixture, and subsequent brushing the slurry on various substrates. It protects a wide range of buildings and structural concrete components with excellent resistance to water, aggressive chemicals, long-term weathering, and scratching. It is applicable for those structures subjected to long-term water immersion.

1. Free surfaces from dirt or foreign materials. For the waterproofing to work best, manufacturers recommend the surfaces be sand blasted, bush-hammered or acid-etched.
2. Apply 2 coats of the cementitious waterproofing. The first coat could include the manufacturer's materials only. The second coating will include a cement-sand mixture and also have chemical and metallic elements too. If supplementary waterproofing is required, then a third coat may be required. This typically includes sand and cement for that extra protection.

### Methods of Application

#### Trowel

Application of the coating is done using the handheld trowel, by simply applying and spreading the coating using the trowel.

#### Spray

This method uses spraying equipment like the ones used in painting vehicles. It is preferred due to its precise finish and efficiency. It is also faster to use the spray than the trowel method.

**Brush**

Use a typical brush similar to roll brushes that are used in painting houses. It also has a uniform finish and is faster to use compared to the trowel.

It is good to note that different surfaces will dictate the method of application.

## ITEM 14 : REPAINTING WORKS

### GENERAL

General Requirements contain provisions and requirements essential to these Specifications; and apply to this section, whether or not referred to herein.

### SCOPE OF WORK

This Section covers the surface preparation, coating materials and application of coatings systems required for the Works.

The work shall consist of furnishing of all labor, materials, equipment and other incidentals necessary for the supply of painting materials and the complete painting of surfaces as shown on the drawings in accordance with this Specification and as directed by the Project-In-Charged.

The term paint as hereinafter used includes emulsion paints, varnishes, oils, pigments, thinner and dryers.

All exposed metal surfaces, except metal surfaces embedded in concrete, shall be painted unless otherwise specified.

### STANDARD

The following publications listed below, but referred to thereafter by basic designation only, forms a part of these Specifications to the extent indicated by the reference thereto:

Steel Structures Painting Council (SSPC) U.S. Specification JIS K 5628 Red-lead Zinc Chromate Anti-Corrosive Paint.

### SUBMITTAL

1. The Contractor shall submit work method statements with lists of materials to the Project-In-Charged for approval twenty eight days before the starting of works. This statement shall include following items:
  - a. Type of paint and manufacturer
  - b. Manufacturer's specifications
  - c. Storage and delivery of materials
  - d. Surface preparation
  - e. Finish painting and drying
  - f. Touch-up painting, if any
  - g. Equipment
2. The Contractor, before placing order for the painting materials, shall submit to the Project-In-Charged for approval samples of materials. No placing of orders for material shall be made without his approval.

### STORAGE AND DELIVERY

1. The Contractor shall deliver all material to the site in the original labeled sealed cans and containers, with labels intact and seal unbroken.
  - a. Seals shall remain unbroken until after inspection and acceptance of material by the Project-In-Charged.

- b. The Contractor shall deliver materials in ample quantities sufficiently in advance of the need to avoid any delay or interruptions in the works.
2. Paint in thinner shall be stored in accordance with the approved manufacturer's instructions.
  - a. All regulations required for storage of paint shall be observed and all necessary safety signs required by governing codes shall be posted.
  - b. Any damage caused by failure to exercise proper precautions in paint storage shall be repaired.

## MATERIAL REQUIREMENTS

### PAINT

Paints for the protective coating system shall be the product of a manufacturer approved by the Project-In-Charged.

Paints for exterior finish must be with tile like durability and elegance, fast drying, solvent based acrylic, highly suitable for coastal or polluted areas with excellent anti-fungus properties and alkali resistance.

100% Acrylic, water based, quick-drying, easy to clean-up and environmentally friendly, resist dirt, stains, alkali, water, humidity, algae, mold and mildew growth and highly durable paint for interior finish.

An all-purpose synthetic quick dry paint for all types of wood and metal surfaces. It has high gloss, good color retention and outstanding durability.

For pipes, valves and equipment, galvanized and ungalvanized ferrous metal, use a 100% acrylic gloss paint, has excellent resistance to ultraviolet rays and resists chalking, cracking and color fading, dries fast and environmentally friendly.

### SCHEDULE OF PAINTING

Architectural Items	
a. Exterior Finishes	
1. On Concrete Walls	
Three Coats, Concrete Masonry Paint	Elastomeric Paint or approved equal
2. Unprimed Ferrous Metal	
First Coat	Red Oxide Primer, #310 or approved equal
Second & Third Coat	Quick Dry Enamel or approved equal
3. On Concrete Block Wall	
Masonry Neutralizer	Masonry Neutralizer #44 or approved equal
Three Coats Concrete Masonry Paint	Elastomeric Paint or approved equal

<b>4. On Wood</b>	
First Coat Exterior Wood Primer	Flatwall Enamel or approved equal
Second & Third Coat Exterior enamel	Quick Drying Enamel or approved equal
<b>b. Interior Finishes</b> Location of the various finishes are listed in the Finish Schedule on the drawings or else will be confirmed by PPA	
1. On primer and coated metal two coats of interior semi-gloss enamel or as indicated in the Schedule finish	Red Oxide Primer #310, Quick Dry Enamel or approved equal
<b>2. On Plaster</b>	
First Coat	Masonry Neutralizer #44 or approved equal
Three Coats	Elastomeric Paint or approved equal
<b>3. On Wood</b>	
First Coat Enamel undercoater	Flatwall Enamel or approved equal
Second & Third Coat Exterior enamel	Quick Drying Enamel or approved equal
<b>4. Wood Stain Finish</b>	
First Coat Second & Third Coats Fourth & Fifth Coats	Oil Wood Stain , Lacquer Sanding Sealer #1254 Clear Gloss Lacquer #1250 or approved equal
<b>c. Non – Architectural Items</b> (Piping, valves, equipment, etc.)	
1. Piping, valves, equipment etc. in rooms are to be painted	
2. Galvanized pipes and ducts	
Primer – one coat	Red Oxide Primer, #310 or approved equal
Finish – one coat	Quick Dry Enamel or approved equal
<b>3. Black steel pipes</b>	
Primer – one coat	Red Oxide Primer, #310 or approved equal
Finish – one coat	Quick Dry Enamel or approved equal
<b>4. Mechanical Items</b>	
a. Ungalvanized ferrous metal Primer – one coat	Red Oxide Primer, #310 or approved equal
Finish – one coat	Quick Dry Enamel or approved equal or approved equal

b. Galvanized ferrous metal Primer – one coat  Finish – one coat	Red Oxide Primer, #310 or approved equal Quick Dry Enamel or approved equal or approved equal
c. Submerged galvanized ferrous metal Primer – one coat	Red Oxide Primer, #310 or approved equal
d. Buried miscellaneous ferrous surface valves, & flanged joints (excl. pipe) Primer – one coat	Red Oxide Primer, #310 or approved equal

## EXECUTION

### SURFACE PREPARATION OF STEEL

1. Steel surfaces shall be cleaned as follows:
  - a. All round welds, burrs and sharp surface projections shall be ground smooth and all weld splatter shall be removed prior to blast cleaning.
  - b. Sand abrasives, if used, shall be clean, and free from salt and extraneous matter. The sand shall pass through a 2.0mm test sieve, and be substantially retained on a 0.18mm test sieve, with at least 25 percent retained on a 0.355mm test sieve.
  - c. Metallic abrasive, if used, shall be sharp, hard and free from dust, and shall pass through a 1.8 mm test sieve.
  - d. Blast cleaning operations shall not be conducted on surfaces that will be wet after blasting and before coating, or when the surfaces are less than 10°C above degree points, or when the relative humidity of the air is greater than 95 percent.
  - e. Any oil, grease, soil, dust or other foreign matter deposited on the cleaned surfaces shall be removed prior to painting. In the event that rusting occurs after completion of the surface preparation, the surfaces shall be cleaned again in accordance with the specified method.
  - f. Particular care shall be taken to prevent the contamination of other corrosive chemicals before the application of the paint. Such contamination shall be removed from the cleaned surface by flash blasting and the paint applied immediately.
  - g. Care shall be taken to prevent contamination of cleaned and painted surfaces by cleaning operations in an adjacent area.
  - h. Surfaces not to be painted shall be suitably protected from the effects of cleaning and painting operations.



## **SURFACE PREPARATION OF WOOD**

1. Wood surfaces shall be sanded to a fresh surface. Surface mould where present, shall be removed by washing, rubbing down and burning off as necessary. Resinous exudation and large knots shall be removed and replaced with filler or other materials approved by the Project-In-Charged.
2. Parts of timber to be enclosed in walls shall always be primed unless already impregnated. Priming shall be brushed on and a minimum of two coats applied to end grain. When the priming paint is hard, all cracks, holds, open joints, etc. shall be made good with hard stopping and rubbed down with fine abrasive paper. Priming of joinery shall be applied only on site after the Project-In-Charged has approved such joinery and before it is fixed. For internal surfaces primer coats shall be carefully flatted.

## **SURFACE PREPARATION OF CONCRETE AND PLASTER**

Concrete and cement plaster surfaces to be painted shall be prepared by removing efflorescence, dust, dirt, grease, oil, asphalt, tar, excessive mortar and mortar dropping and by roughening to remove glaze. A zinc sulfate solution shall be applied before prime coat.

## **SURFACE PREPARATION FOR FIBER CEMENT SURFACES**

Shall be dry and clean prior to application of the specified first-coat material. Oil, grease, or rust stains shall be carefully removed by the use of suitable solvent. Wire brushing will not be permitted. After the first coat has become dry and prior to application of finish coats, touch-up coats shall be applied to suction spots.

## **ALUMINUM FRAMES FOR DOORS AND WINDOWS**

All metal surfaces shall undergo pre-treatment process which includes: desmutting, water-rinsing, degreasing/etching, water rinsing, zinc phosphating, water rinsing and acid rinsing.

Powder coating application, shall be factory applied and shall be done in one operation using an electro-static powder gun. The materials to be coated should be well connected to earth. Coating thickness should be kept to a minimum of 60 microns for exposed areas. On details which are to be treated mechanically after coating (drilling, sawing, etc.), the coating film must not exceed 100 microns.

The powder coating shall be oven cured in the range of 20 minutes at 220° C (metal temperature measured on the area with greatest metal thickness). The temperature variation in the oven should not exceed +/- 10° C.

### **Handling**

Coated items should be cooled to no less than 40° Centigrade before handling. Precautions should be taken to avoid damages on the finished coating during stacking, storing and transportation.

### **Storage and Delivery**

Inspect materials delivered to the site for damage. Unload and store with minimum handling. Provide storage space in dry location with adequate ventilation, free from dust or water and easily accessible for inspection and handling. Store materials neatly on the floor, properly stacked on non-absorptive strips or wood platforms. Protect finished surfaces during shipping and handling using manufacturer's standard method.

## WOOD REPAIR

Badly decayed areas shall be removed and repaired. Areas and pieces decayed beyond repair shall be replaced with new pieces that match originals in all respects. Moderately decayed areas, weathered, or gouged wood shall be patched with approved patching compounds, and shall be sanded smooth. The source or cause of wood decay shall be identified and corrected prior to application of patching materials. Wet wood shall be completely dried to a moisture content not exceeding 12 percent, as measured by a moisture meter, to its full depth before patching, unless otherwise authorized. Wood that is to be patched shall be clean of dust, grease, and loose paint.

### 1. Epoxy Wood Repair

Epoxy wood repair materials shall be applied in accordance with manufacturer's written instructions. Health and safety instructions shall be followed in accordance with the manufacturer's instructions. Clean mixing equipment shall be used to avoid contamination. Mix and proportions shall be as directed by the manufacturer. Batches shall be only large enough to complete the specific job intended. Patching materials shall be completely cured before painting or reinstallation of patched pieces.

### 2. Epoxy Consolidant and Epoxy Paste

Epoxy liquid wood consolidant shall be used:

1. To penetrate and impregnate deteriorated wood sections in order to reinforce wood fibers that have become softened or absorbent.
2. As a primer for areas that are to receive epoxy paste filler. Epoxy paste shall be used to fill areas where portions of wood are missing such as holes, cracks, gaps, gouges, and other voids.

## MIXING AND THINNING

Mixing and thinning of paint shall be done in accordance with the approved manufacturer's printed instructions. The pot life of each paint as stated by the manufacturer shall not be exceeded.

## WEATHER CONDITION

The paint shall not be applied when the relative humidity is above 85 percent. The paint shall not be applied in rain, wind, fog, dust or mist.

## APPLICATION

Workmanship shall be first class in every respect. All work shall be done in a workmanship manner so that the finished surfaces shall be free from runs, chop, ridges, waves, laps and unnecessary brush marks. All coats shall be applied in such manner as to produce an even film of uniform thickness. Edges, corners, crevices, welds and rivets shall receive special attention to ensure that they receive an adequate thickness of paint.

All painting shall be done by thoroughly experienced workmen.

Safety regulations shall be adhered to at all times, including the wearing of respirators by persons engaged on assisting in spray painting. Adjacent areas and installation shall be protected by the use of cloths or other approved precautionary measures.

Plain enamel and varnish shall be applied carefully with good clean brushes or approved spraying equipment, except that the initial coat on any surface shall be applied with brush. Sufficient time shall be allowed between coats to assure thorough drying and each coat shall be in proper condition before receiving the next coat.

Sanding and dusting as required shall be performed between coats in varnishing work. Finish coat shall be smooth and free from runs, sags, and other defects. Exterior paint shall not be applied during rainy days.

All paint when applied shall provide a satisfactory film and smooth, even surface. Paint shall be thoroughly stirred and kept at a uniform consistency during application. Powdered metallic pigments added at the time of use shall be mixed by adding the powder in small increments to about one-third of the base paint or vehicle, with thorough mixing to obtain a smooth paste. The remainder of the base paint shall then be thoroughly stirred in.

Different brands of emulsion paints shall not be mixed prior to application of the materials.

Where necessary to suit conditions of surface temperature, weather and method of application, the package paint may be thinned immediately prior to application in accordance with the approved manufacturer's directions, but not in excess of 125 cc of suitable thinner per liter (one pint per gallon). Before using, the paint shall be mixed to a uniform consistency and shall be stirred frequently during application.

Paints other than water-thinned paints shall be applied only to surfaces which are completely free of moisture as determined by sight or touch and only such combinations of humidity to be painted as will cause evaporation rather than condensation.

Surfaces which have been cleaned, pretreated and/or otherwise been prepared for painting shall be primed or painted with one coat of finish paint as soon as practicable after such preparation has been completed, but in any event prior to any deterioration of the prepared surfaces.

The first coat of paint on all exterior surfaces shall be applied by brush. Interior prime coats and all other subsequent coats on either exterior or interior surfaces may be applied by brush or spray. Whenever spraying is permitted all areas inaccessible to spray painting shall be coated by brushing or other suitable means. Brushes to be used for application of water-emulsions shall be soaked in water for a period of 2 hours prior to use.

All cloths and cotton waste which might constitute a fire hazard shall be placed in closed metal containers or destroyed at the end of each day.

Upon completion of the work, all staging, scaffolding, and containers shall be removed from the site or destroyed in a manner approved by the Project-In-Charged. Paint spots, or stains upon adjacent surfaces shall be removed and the entire job left clean and acceptable to the Project-In-Charged.

No smoking shall be permitted in the vicinity where painting is going on.

#### TOUCH-UP PAINTING

Touch-up painting shall be done with the same paint as used for the original coat. The resulting minimum dry film shall be the same as for the original coat.

Touch-up painting shall include cleaning and painting of field connections, welds and all damaged or defective paint and rusted areas.

During touch-up painting, only loose, cracked, brittle or non-adherent paint shall be removed during cleaning. All exposed edges shall be feathered. Touch-up painting shall be performed in a manner which will minimize damage to sound paint. Rust spots shall be thoroughly cleaned and edges of the existing paint shall be scraped back to sound material.

#### DRYING

1. No primer or paint shall be forced to be dried under conditions which will cause cracking, wrinkling, blistering, formation of pores which would detrimentally affect the condition of the paint.
2. No drier shall be added to the paint unless specified in the approved manufacturer's instructions.
3. Painted surfaces shall be protected from dust, dirt, and the elements of the weather until dry to the fullest extent practicable.
4. After drying, any areas of paint damaged from any cause shall be removed, the surface again prepared and then touched-up with the same paint and to the same thickness as the undamaged areas as specified in sub-section 4.14.3.7 above.

#### HANDLING

1. Precautions shall be taken to minimize damage to paint films resulting from stacking for drying.
2. Paint which is damaged in handling shall be scraped off and touched-up with the same paint and in the same thickness as was previously applied to the damaged area at Contractor's expense.

#### INSPECTION

1. All works and materials supplied under this Specification shall be subject to inspection by the Project-In-Charged.
2. The Contractor shall correct such works or replace such materials found defective under these Specifications at his own expense.


**ITEM 15 : PROJECT BILLBOARD****SPECIFICATION**


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.

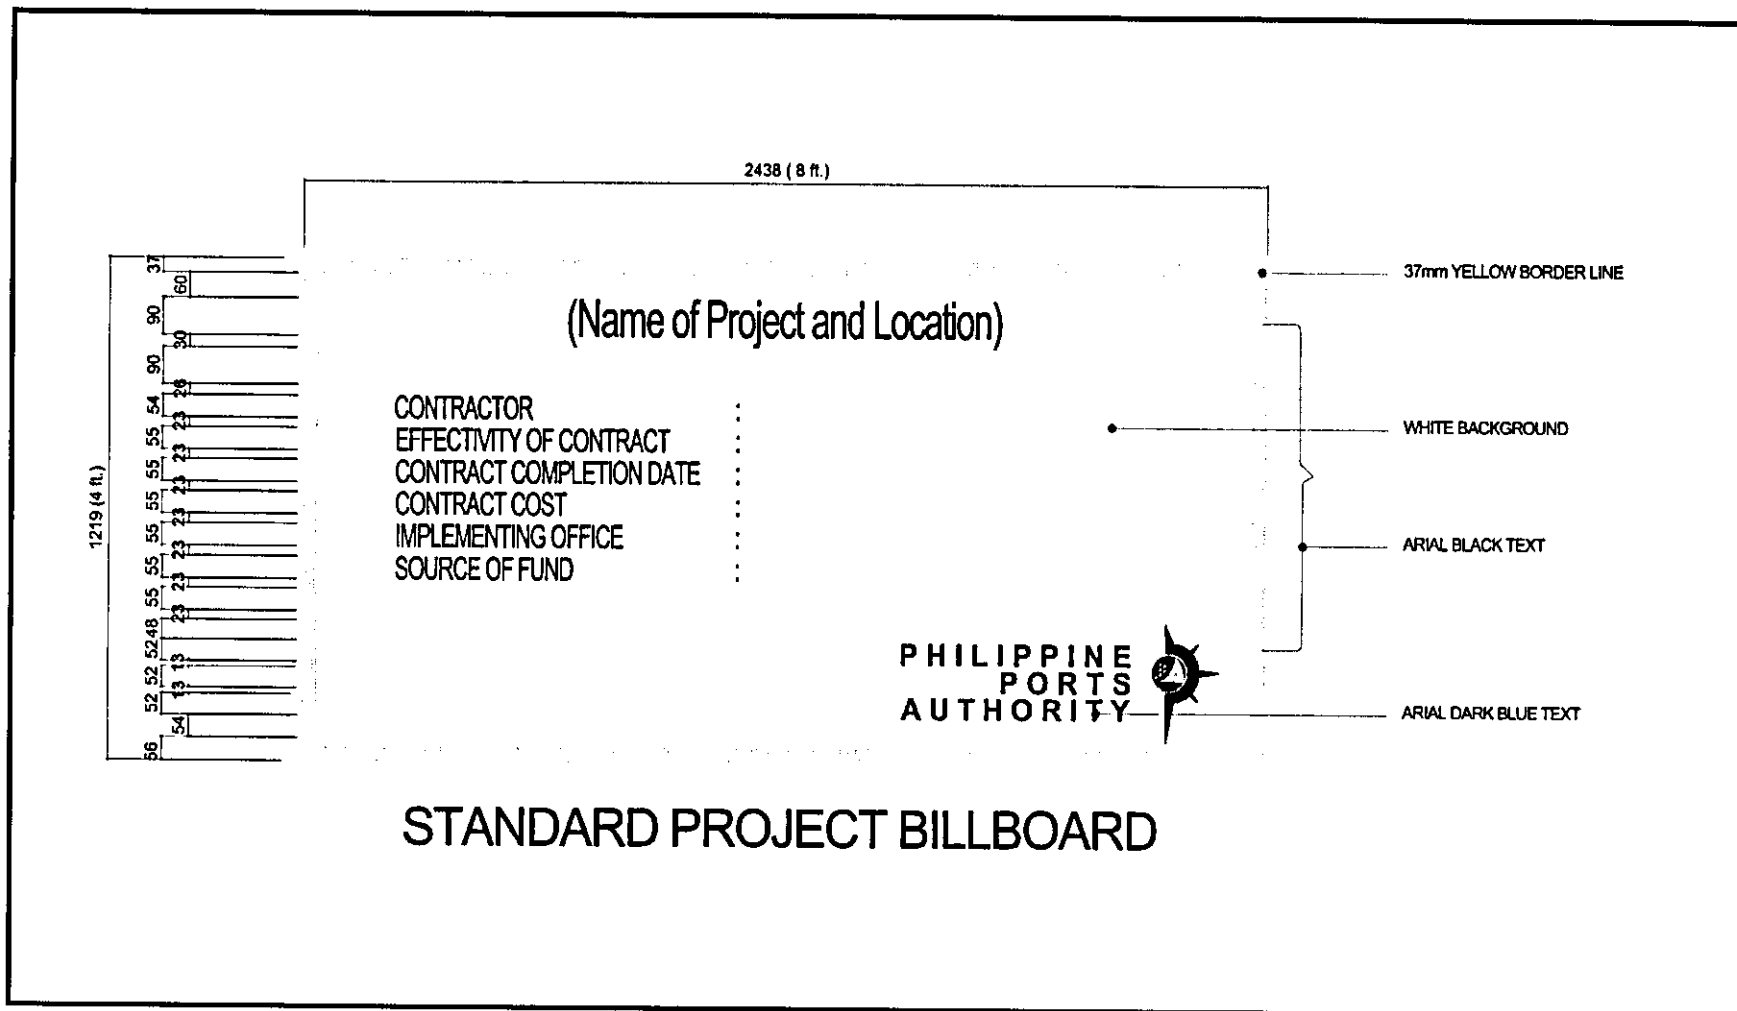

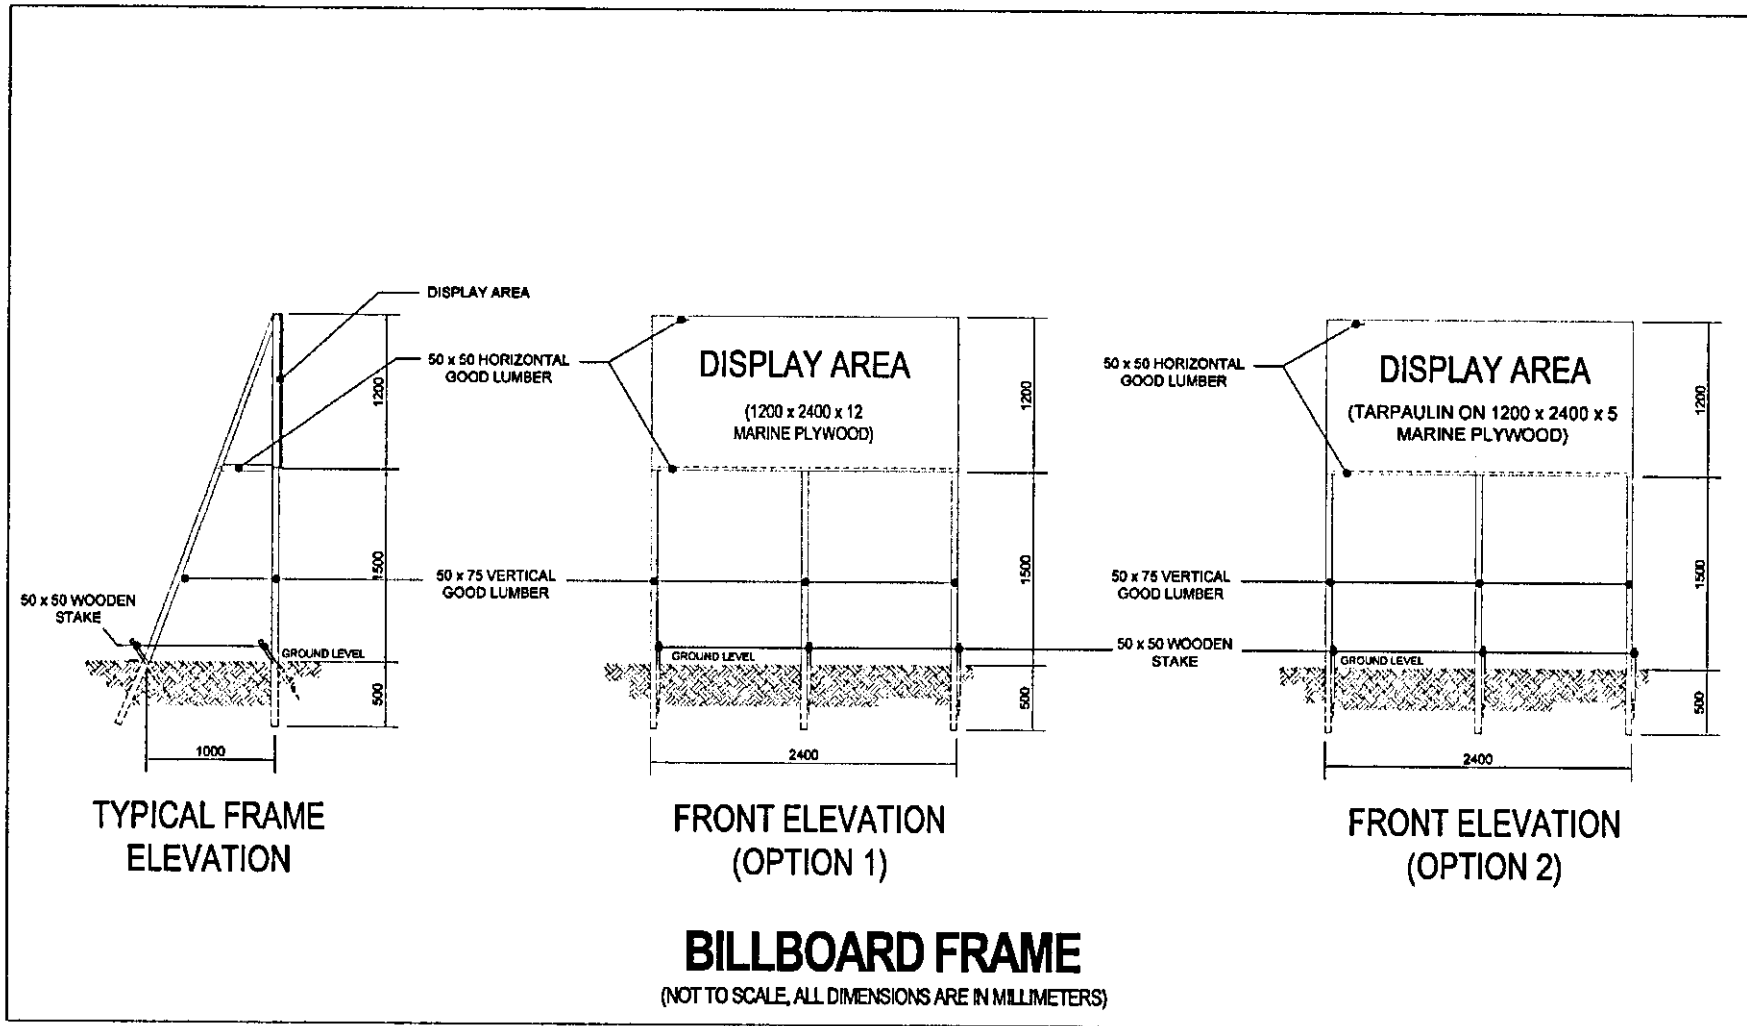

## ITEM 14 : SAFETY SIGNAGES AND BARRICADES

### DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


### SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2-2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



## STANDARD PLAN FOR SIGNAGES AND BARRICADES



*SECTION VII*

*DRAWINGS  
(APPROVED PLANS)*

# SECTION VII

## DRAWINGS AND APPROVED PLANS

(SEE ISSUED APPROVED PLANS)

### LIST OF DRAWINGS:

- 1 of 8 - Location Plan
- 2 of 8 - Pavement Layout Plan and Pavement Sectional Detail
- 3 of 8 - Location of Lane Markers / Traffic Scheme
- 4 of 8 - Schedule of Doors and Louvers
- 5 of 8 - Typical Foundation Plan & Detail of Column and Wall Footing
- 6 of 8 - Roof Beam Plan, Roof Beam Slab and Roof Slab Detail
- 7 of 8 - Stall Plumbing Layout & Typical Sanitary Layout, Typical CWL Layout
- 8 of 8 - Lighting and Power Layout


**PHILIPPINE  
PORTS  
AUTHORITY**

PMO - BATANGAS



# **RESTORATION OF DILAPIDATED CONCRETE PAVEMENT AND IMPROVEMENT OF VENDOR STALL**

## **PORT OF CALATAGAN**

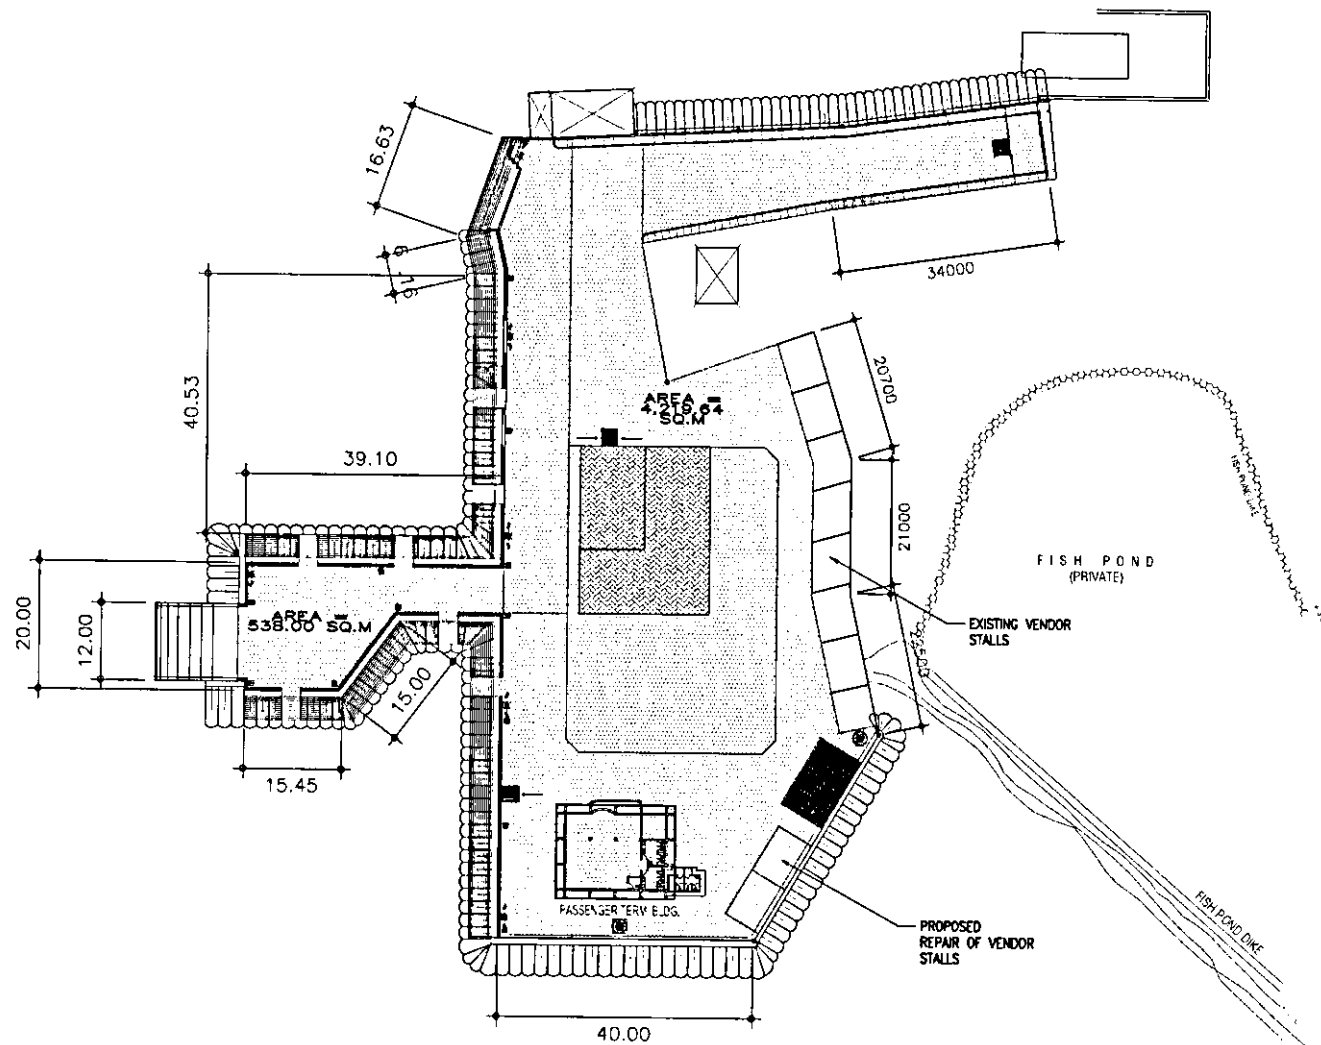

- AREA OF PAVEMENT TO BE REPAIRED = (4,970.00 SQ.M.)
- AREA OF PAVEMENT NOT INCLUDED IN THE REPAIR = (3,131.73 SQ.M.)
- REPAIR OF TWO (2) UNITS VENDOR STALLS

**LOCATION PLAN**  
 SCALE: 1:800

**PHILIPPINE  
PORTS  
AUTHORITY**  
 PMO - BATANGAS



PROJECT TITLE:

**RESTORATION OF DILAPIDATED CONCRETE PAVEMENT  
AND IMPROVEMENT OF VENDOR STALL**

LOCATION: PORT OF CALATAGAN

CAD BY:

**D. A. ALEGRE**  
ENGINEERING ASSISTANT

PREPARED BY:

**V.A. AGUIRRE**  
ACTG. SUPERVISING ENGINEER

REVIEWED BY:

**C. B. GUCE**  
ESD MANAGER

APPROVED:

**JOSELITO O. SINOCRUZ PhD**  
PORT MANAGER

SHEET CONTENTS:


AS-SHOWN

SHEET NO.:


**01 08**

DATE:



JUNE 2023

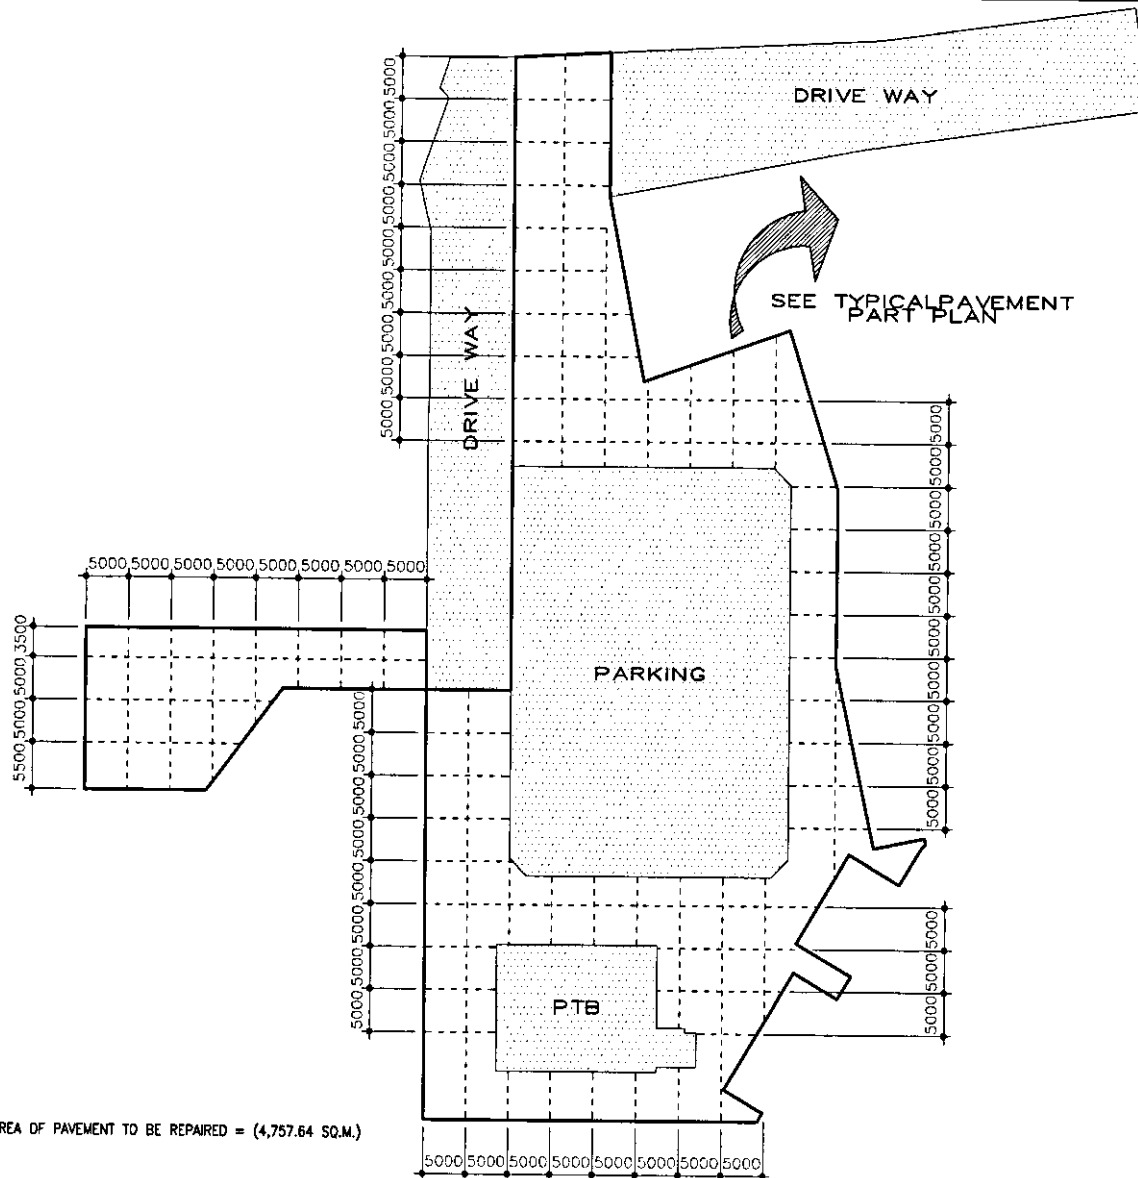

**PAVEMENT LAYOUT PLAN**  
SCALE: 1:600



**PAVEMENT TYPICAL PART PLAN**  
SCALE: 1:500



**PAVEMENT SECTIONAL DETAIL**  
SCALE: 1:15

PHILIPPINE  
PORTS  
AUTHORITY  
PMO - BATANGAS



PROJECT TITLE:  
**RESTORATION OF DILAPIDATED CONCRETE PAVEMENT  
AND IMPROVEMENT OF VENDOR STALL**

LOCATION: PORT OF CALATAGAN

CAD BY:  
**D. A. ALEGRE**  
ENGINEERING ASSISTANT





PREPARED BY:  
**V. A. AGUIRRE**  
ACTG. SUPERVISING ENGINEER

REVIEWED BY:  
**C. B. GUCE**  
ESD MANAGER

APPROVED:  
**JOSELITO O. SINOCRUZ PhD**  
PORT MANAGER



SHEET CONTENTS:  
AS-SHOWN

SHEET NO:  
**02 08**  
DATE:  
JUNE 2023

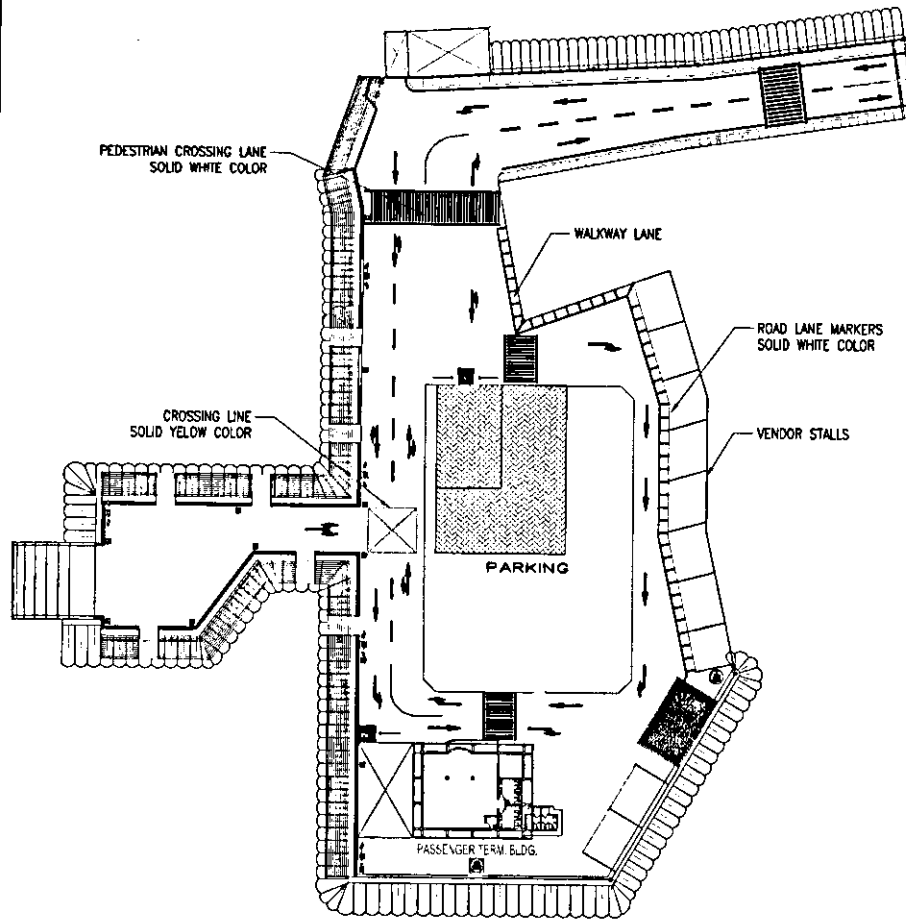

PEDESTRIAN LANE  
3 SETS

CROSSING LINE



CROSSING LINE



# LOCATION OF LANE MARKERS/TRAFFIC SCHEME

SCALE:

1:800

PHILIPPINE  
PORTS  
AUTHORITY  
PMO - BATANGAS



PROJECT TITLE:

RESTORATION OF DILAPIDATED CONCRETE PAVEMENT  
AND IMPROVEMENT OF VENDOR STALL

LOCATION: PORT OF CALATAGAN

CAD BY:

D. A. ALEGRE  
ENGINEERING ASSISTANT

PREPARED BY:

V. A. AGUIRRE  
ACTG. SUPERVISING ENGINEER

REVIEWED BY:

C. B. GUCE  
ESD MANAGER

APPROVED:

JOSELITO O. SINOCRUZ PhD  
PORT MANAGER

SHEET CONTENTS:


AS-SHOWN

SHEET NO.:


03 08

DATE:


JUNE 2023




**FLOOR PLAN (ONE UNIT)**  
SCALE: 1:100




**FRONT ELEVATION (ONE UNIT)**  
SCALE: 1:75



**RIGHT SIDE ELEVATION**  
SCALE: 1:75

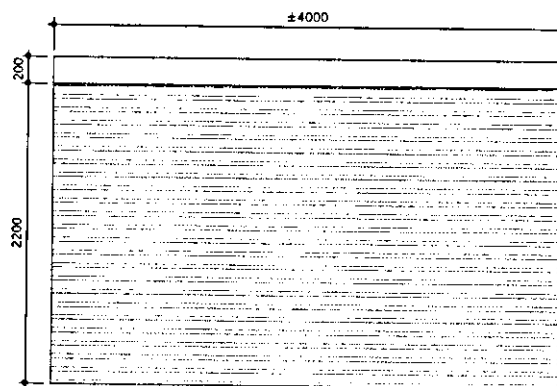

**D**  
1



**L**  
1

### SCHEDULE OF DOORS & LOUVERS

MARK	DESCRIPTION	LOCATION	QTY./SETS
<b>D</b> 1	ROLL-UP DOOR	STALL	16
<b>L</b> 1	500 x 2000 CONCRETE LOUVER		16

PHILIPPINE  
PORTS  
AUTHORITY  
PMO - BATANGAS



PROJECT TITLE:

**RESTORATION OF DILAPIDATED CONCRETE PAVEMENT  
AND IMPROVEMENT OF VENDOR STALL**

LOCATION: PORT OF CALATAGAN

CAD BY:

**D. A. ALEGRE**  
ENGINEERING ASSISTANT

PREPARED BY:

**V. A. AGUIRRE**  
ACT'G. SUPERVISING ENGINEER

REVIEWED BY:

**C. B. GUCE**  
ESD MANAGER

APPROVED:

**JOSELITO O. SINOCRUZ PhD**  
PORT MANAGER

SHEET CONTENTS:


AS-SHOWN

SHEET NO:


**04 08**

DATE:



JUNE 2023



**TYPICAL FOUNDATION PLAN (ONE UNIT)**  
SCALE: 1:75




**ROOF BEAM DETAIL**  
SCALE: 1:40




**DETAIL OF COLUMN & WALL FOOTING**  
SCALE: 1:30






**ROOF BEAM PLAN (ONE UNIT)**  
SCALE: 1:75




**ROOF SLAB DETAIL**  
SCALE: 1:75




**ROOF SLAB SECTION**  
SCALE: 1:40




PROJECT TITLE:	CAO BY:	PREPARED BY:	REVIEWED BY:	APPROVED:	SHEET CONTENTS:	SHEET NO:
RESTORATION OF DILAPIDATED CONCRETE PAVEMENT AND IMPROVEMENT OF VENDOR STALL					AS-SHOWN	06 08
LOCATION: PORT OF CALATAGAN	D. A. ALEGRE ENGINEERING ASSISTANT	V. A. AGUIRRE ACTG. SUPERVISING ENGINEER	C. B. GUCE ESD MANAGER	JOSELITO O. SINOCRUZ PhD PORT MANAGER		DATE: JUNE 2023




**STALL PLUMBING LAYOUT (TWO UNITS)**  
SCALE: 1:50




**TYPICAL SANITARY LAYOUT (ONE UNIT)**  
SCALE: 1:75



**TYPICAL CWL LAYOUT (ONE UNIT)**  
SCALE: 1:75



**TYPICAL ISOMETRIC CWL LAYOUT**  
SCALE: 1:40



**DETAIL OF STEEL GRATING**



PROJECT TITLE:  
**RESTORATION OF DILAPIDATED CONCRETE PAVEMENT  
AND IMPROVEMENT OF VENDOR STALL**  
LOCATION: PORT OF CALATAGAN

CAD BY:  
**D. A. ALEGRE**  
ENGINEERING ASSISTANT


PREPARED BY:  
**V.A. AGUIRRE**  
ACTG. SUPERVISING ENGINEER

REVIEWED BY:  
**C. B. GUCE**  
ESD MANAGER



APPROVED:  
**JOSELITO O. SINOCRUZ PhD**  
PORT MANAGER

SHEET CONTENTS:  
AS-SHOWN

SHEET NO:  
**07 08**  
DATE:  
JUNE 2023



**LIGHTING AND POWER LAYOUT (ONE UNIT)**  
SCALE: 1:75



**SYMBOLS:**

- FLOURESCENT LAMP
- CONVENIENCE OUTLET
- TO METER
- AMPERES
- POWER METER
- PANEL BOARD
- GROUNDING

**SCHEDULE OF LOADS: (TYPICAL 1-10)**

CKT No.	LOAD DESCRIPTION	WATTS	AMPERES	PROTECTION	SIZE OF WIRE & CONDUIT
1	MAIN BREAKER			30A	USE 2-8.0MM² THHN WIRE @ 25MMØ UPVC
2	LIGHTING OUTLET	600	2.73	15A	USE 2-3.5MM² THHN WIRE @ 20MMØ UPVC
3	CONVINIENCE OUTLET	1080	4.91	20A	USE 2-3.5MM² THHN WIRE @ 20MMØ UPVC
4	S P A R E	3000	13.64	20A	PROVISION PIPE GOING TO CEILING

USE: 2-8.0MM² THHN WIRE @ 25MMØ UPVC

IT=21.28A

*SECTION VIII*

*BILL OF QUANTITIES*  
*and*  
*ATTACHMENTS*

## BID SUMMARY

Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall  
Port of Calatagan, Batangas

NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1	General Expenses	
BILL NO. 2	Restoration Of Dilapidated Pavement	
BILL NO. 3	Improvement Of Vendor Stall	
TOTAL BID PRICE		

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

**BILL OF QUANTITIES**  
RESTORATION OF DILAPIDATED CONCRETE PAVEMENT AND IMPROVEMENT OF VENDOR STALL  
PORT OF CALATAGAN, BATANGAS

**ITEM NO. I**      General Expenses

Item No.	Description	Unit	Quantity	Unit Price ( Pesos )	Amount
1.01	Mobilization and Demobilization	l.s	1		
1.02	Provide environmental safety and health	mos.	8		
				Total For Item No. I	P

Submitted by :

\_\_\_\_\_  
( Name & Signature of Representative of the Bidder )

\_\_\_\_\_  
Date

\_\_\_\_\_  
( Position )

\_\_\_\_\_  
Name of the Bidder

**BILL OF QUANTITIES**  
 RESTORATION OF DILAPIDATED CONCRETE PAVEMENT AND IMPROVEMENT OF VENDOR STALL  
 PORT OF CALATAGAN, BATANGAS

**ITEM NO. II** Restoration Of Dilapidated Pavement

Item No.	Description	Unit	Quantity	Unit Price ( Pesos )	Amount
2.01	Demolition and Excavation of Damaged Pavement	sq. m.	4,970		
2.02	Supply, Spread and Compact 200mm thk Sub-base Course Materials	cu.m.	994		
2.03	Replacement of Electrical Fixtures Including Supply Line Gravel Base Course Material	cu.m.	994		
2.04	Supply and Place 3000 psi Concrete for Pavement	cu.m.	994		
2.05	Supply & Place Yellow Thermoplastic Paint on Intersection Lines	sq. m.	90		
2.06	Supply & Place White Thermoplastic Paint on Pedestrian Lane, Stopping, Border and Lane Lines	sq. m.	452		
Total For Item No. II				P	

Submitted by :

\_\_\_\_\_  
( Name & Signature of Representative of the Bidder )\_\_\_\_\_  
Date\_\_\_\_\_  
( Position )\_\_\_\_\_  
Name of the Bidder

**BILL OF QUANTITIES**  
 RESTORATION OF DILAPIDATED CONCRETE PAVEMENT AND IMPROVEMENT OF VENDOR STALL  
 PORT OF CALATAGAN, BATANGAS

**ITEM NO. III**      Improvement Of Vendor Stall

Item No.	Description	Unit	Quantity	Unit Price ( Pesos )	Amount
3.01	Excavation, Backfilling and Compaction	lot	1		
3.02	Supply and Place Gravel Bedding	cu.m.	9.60		
3.03	Repair of Electrical System	lot	1		
3.04	Concrete Works	cu.m.	12		
3.05	Masonry Works	sq.m.	114.63		
3.06	Steel Reinforcement	kgs.	8,625		
3.07	Floor Finishes	sq.m.	96		
3.08	Supply and Install Roll-Up Door	sets	4		
3.09	Repair of Plumbing System, Storm Drain incl Fixtures & acc	lot	1		
3.10	Water Proofing	sq.m.	96		
3.11	Repainting Works	lot	1		
Total For Item No. III				P	

Submitted by :

\_\_\_\_\_  
 ( Name & Signature of Representative of the Bidder )

\_\_\_\_\_  
 Date

\_\_\_\_\_  
 ( Position )

\_\_\_\_\_  
 Name of the Bidder



**S**  
**BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL**

The work items included in the proposal and the basis of payments are as follows:

**BILL NO. 1**

**GENERAL EXPENSES**

**Item 1.01      Mobilization and Demobilization**

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

**Item 1.02      Provide environmental safety and Health Program in the execution of the project**

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the implementation of the Environmental Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

**BILL NO. 2**

**RESTORATION OF DILAPIDATED PAVEMENT**

**Item 2.01      Demolition and Excavation of Damaged Pavement**

The quantity to be paid for shall be the actual volume in cubic meter of damaged pavement to be demolished and excavated in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.02      Supply, Spread and Compact 200 mm thick Sub-Base Course Materials**

The quantity to be paid for shall be the actual volume in cubic meter of 20 mm thick subbase course materials to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing and compacting of aggregate subbase course rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.03      Replacement of Electrical Fixtures Including Supply Line Gravel Base Course Material**

The quantity to be paid for shall be the actual volume in cubic meter of electrical fixtures including supply line gravel base course material to be replaced accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.04      Supply and Place 3000 psi Concrete for Pavement**

The quantity to be paid for shall be the actual volume in cubic meter of 3,000 psi concrete for pavement to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.05      Supply and Place of Yellow Thermoplastic Paint on Intersection Lines**

The quantity to be paid for shall be the actual area in square meter of yellow thermoplastic paint on intersection lines to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 2.06      Supply and Place White Thermoplastic Paint on Pedestrian Lane, Stopping, Border and Lane Lines**

The quantity to be paid for shall be the actual area in square meter of white thermoplastic paint on pedestrian lane, stopping, border and lane lines to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**BILL NO. 3**

**IMPROVEMENT OF VENDOR STALL**

**Item 3.01      Excavation, Backfilling and Compaction**

The quantity to be paid for shall be the actual lot to be excavated, backfilled and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.02      Supply and Place Gravel Bedding**

The quantity to be paid for shall be the actual volume in cubic meter of gravel bedding to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.03      Repair of Electrical System**

The quantity to be paid for shall be the actual lot of electrical system to be repaired in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.04      Concrete Works**

The quantity to be paid for shall be the actual volume in cubic meter of concrete works to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.05      Masonry Works**

The quantity to be paid for shall be the actual area in square meter of masonry works to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.06      Steel Reinforcement**

The quantity to be paid for shall be the actual weight in kilograms steel to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.07      Floor Finishes**

The quantity to be paid for shall be the actual area in square meter of floor finishes to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.08      Supply and Install Roll-Up Door**

The quantity to be paid for shall be the actual sets of Roll Up Doors to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.09      Repair of Plumbing System, Storm Drain incl. Fixtures and Accessories**

The quantity to be paid for shall be the actual lot of plumbing system, storm drain including fixtures and accessories to be repaired in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.06      Water Proofing**

The quantity to be paid for shall be the actual area in square meter of water proofing works to be supplied and applied in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**Item 3.07      Repainting Works**

The quantity to be paid for shall be the actual lot to be repainted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

**MINIMUM MAJOR EQUIPMENT REQUIREMENTS**

1	unit/s	Air Compressor (250 cfm, minimum), owned
1	unit/s	Backhoe (0.40 cu.m., 94.30hp, minimum), owned
2	unit/s	Bar Bender (electric, 25mm dia min.), owned
2	unit/s	Bar Cutter (electric, 25mm dia min.), owned
1	unit/s	Breaker Attachment, owned
1	unit/s	Concrete Cutter, owned
2	unit/s	Concrete Mixer, One bagger, owned
2	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Dump Truck (8 cu.m., minimum), owned
4	unit/s	Electric Drill, owned
2	unit/s	Electric Drill(Portable), owned
1	unit/s	Gen Set with consumables, owned
2	unit/s	Jackhammer, owned
1	unit/s	Kneading Machine, owned
1	unit/s	Plate Compactor (5 hp, minimum), owned
2	unit/s	Portable Grinder, owned
2	unit/s	PPR Fusion Machine, owned
1	unit/s	Road Grader (125 hp, minimum), owned
1	unit/s	Road Roller (12MT/110HP, vibratory, minimum), owned
1	unit/s	Stake Truck, owned
1	unit/s	Steel Scaffolding, owned
1	unit/s	Steel Scaffolding(movable),owned
2	unit/s	Tile Cutter, owned
1	unit/s	Thermoplastic Applicator, owned
1	unit/s	Traffic Safety Devices, owned
1	unit/s	Water Trailer
1	unit/s	Water Truck Wagon (1,000 L, minimum), owned
1	unit/s	Welding Machine (400 amp., minimum), owned

## CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

### LABOR

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

### EQUIPMENT / MATERIALS

#### Personnel Protective Equipment

50	pcs.	Hard Hats
80	pairs	Gloves (rubberized)
50	pcs.	Safety Glasses/Goggles (clear)
50	pcs.	Long sleeve T-shirt
5	pc.	Aprons
50	pairs	Safety Shoes

#### Safety Devices

1	lot	Barricades
1	lot	Warning signs
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System	-	Eight (8) mos.
Temporary shelter for workers	-	1 lot

### NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 1 of 10

### REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

<i>Materials/Items of Work</i>	<i>Required Tests</i>	<i>Minimum Incremental Frequency of Tests</i>
<b>I. Construction of Pier/Wharf, Platform and Ramp</b>		
<b>Structural Concrete (SC)</b>		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mill Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
<b>Piling (P)</b>		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 2 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
4 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
5 Fine Aggregates	Same Test as for SC (B)	Same frequency as SC (B)
B Steel Pipe Piles	Fabrication Report, Mill Certificate and Quality Test for Chemical and Mechanical properties	One per fabrication
1 Steel	Chemical Composition (refer below) <ul style="list-style-type: none"> <li>- Under 14" (355 60mm) Outside Diameter</li> <li>- 14" to 36" (355 6 to 914mm) Outside Dia</li> <li>- Over 36" (914mm) Outside Diameter</li> </ul> Mechanical/Tensile	2 from 200 pipe or fraction thereof 2 from 100 pipe or fraction thereof 2 from 3000ft (914m) or fraction thereof One (1) tension test shall be made on one length or fraction thereof of each size, or one piece of skelp representing each lot of 200 lengths or fraction thereof of each size
2 Polyurethane Coating	Mill Certificate and Quality Test	One per fabrication
3 Concrete	Same test as for SC (F)	Same frequency as SC (F)
4 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
6 Steel Bars	Same Test as SC (E)	Same frequency as SC (E)
7 Water	Same Test as SC (D)	Same frequency as SC (D)
Rubber Dock Fenders (RDF)	Physical Test Performance Test for Energy Absorption and Reaction Force	All units All units
Accessories Washer and Fixing Bolt, Anchor Bolt	Physical Test Quality Test for Chemical Composition and Mechanical Properties	All units One per fabrication



PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 3 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
Mooring Bollard (MB) and Accessories (Hexagon Nuts, Plain Washer, Anchor Ring and Anchor Bolt)	Physical Test  Quality Test for Chemical Composition and Mechanical Properties	All Units  One per fabrication
<b>II. Construction of Back-Up Area, Causeway and Pavement</b>		
Sheet Piling (SP)		
A Concrete Sheet Piles		
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strands	Same test as for P (A 3)	Same frequency as P (A 3)
4 Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
B Steel Pipe Piles		
1 Steel	Same test as for P (B1)	Same frequency as P (B1)
2 Concrete	Same test as for SC (F)	Same frequency as SC (F)
3 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
4 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 4 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
Rocks	Test for Apparent Specific Gravity and Abrasion	For every 1,500 cubic meter or fraction thereof
Geotextile Filter	Physical and Mechanical Test Mill Certificate	One per batch One per batch
Sand and Gravel Fill	Quality Test for Organic Impurities and Grading	For every 1,500 cubic meter or fraction thereof
Selected Fill	Quality Test for Grading, Plasticity and Laboratory Compaction Test  Laboratory California Bearing Ratio (CBR)  Field Density Test	For every 1,500 cubic meter or fraction thereof  For every 2,500 cubic meter or fraction thereof  For every layer of 150mm of compacted depth at least one group of three In-situ density test for every 500 sq m or fraction thereof
Aggregate Base Course	Quality Test for Grading and Plasticity  Quality Test for Grading, Plasticity, Abrasion and Laboratory Compaction Test  Laboratory California Bearing Ratio (CBR) Field Density Test	For every 300 cubic meter or fraction thereof  For every 1,500 cubic meter or fraction thereof  Same frequency as Selected Fill Same frequency as Selected Fill
Portland Cement Concrete Pavement (PCCP)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars (Dowels)	Same test as for SC (E)	Same frequency as SC (E)
F Joint Filler	Quality Test	One (1) per shipment

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 5 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
G Admixture and Concrete Curing Material	Same test as for SC (G)	Same frequency as SC (G)
H Concrete	Same test as for SC (F) Flexural Test	Same frequency as SC (F) 3 beam samples for every 330 sq m or fraction thereof
I Completed Pavement	Core Test	1 set (3 specimen) for every 2,500 sq m and fraction thereof
Interlocking Concrete Blocks		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Admixture & Concrete Curing Materials	Same test as for SC (G)	Same frequency as SC (G)
F Completed Blocks	Physical Test and Compressive Strength	6 blocks per day of fabrication
Cement Treated Base Course (CTB)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine & Coarse Aggregates	Quality Test for Grading, Abrasion and Soundness	For every 1,500 cubic meter or fraction thereof
C Water	Same test as for SC (D)	Same frequency as SC (D)
D Completed CTB	Field Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
Retaining Wall/Coping Wall/RC Curb/RC Ditch/Shear Key/Concrete Blocks/Lean Concrete		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 6 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
F Admixture and Concrete Curing	Same test as for SC (G)	Same frequency as SC (G)
G Concrete	Same test as for SC (F)	Same frequency as SC (F)
Tie Rod		
A Steel	Same test as for SC (E)	One per batch
B Assembly	Performance Test (Tension)	One per batch
Tie Bars and Dowels	Same test as for SC (E)	For every 10,000 kg or fraction thereof per Tie bars and Dowels
Pipe Culverts and Storm Drains		
A Pipes	Test for Strength, Absorption and Physical	For every 50 pieces
B Mortar or Joint	Same Test as for SC (A,B and D) Alternative Test Same test as for SC (F) and Inspection Report	For every 25 pieces
Concrete Hollow Blocks		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Water	Same test as for SC (D)	Same frequency as SC (C)
D Concrete	Same test as for SC (F)	Same frequency as SC (F)
E Completed CHB	Quality Test	One for every 500 pieces or fraction thereof
Construction Joints (CJ)		
A Angle Bars	Test for Physical and Mechanical Properties	One per batch
B Steel Bars	Same test as for SC (E)	One per batch
C Zinc (Hot Dip Galvanizing) Coatings	Physical Test for Appearance, Stripping, Weighing, Adherence and Adhesion  Coating Thickness Magnetic Thickness Measurement	All units   1 set (3 specimen) for every 100,000 sq mm or fraction thereof

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment

Page 7 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
<b>Sacked Concrete</b>		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Sack (jute)	Physical Test	One for every 50 pieces
<b>Rubble Concrete</b>		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Rocks	Same test as for ROCKS	Same frequency as ROCKS
<b>Earthworks</b>		
A Sub-grade preparation	Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test  Density Test	For every 1,500 cubic meter or fraction thereof  For every layer of 150mm of compacted depth at least one group of three In-situ density test every 500 sq m or fraction thereof
B Structure Excavation	If excavated materials shall be used as Backfill Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test  Density Test	For every 1,500 cubic meter or fraction thereof  For every layer of 150mm of compacted depth at least one group of three In-situ density test every 500 sq m or fraction thereof

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 8 of 10

<b>Materials/Items of Work</b>	<b>Required Tests</b>	<b>Minimum Incremental Frequency of Tests</b>
<b>III Port Operations Building/Passenger Terminal Building/Transit Shed/Warehouse</b>		
<b>STRUCTURAL WORKS</b>		
Refer to Structural Concrete (SC) and Piling Works (P)		
<b>ARCHITECTURAL WORKS</b>		
Ceramic – Filled Liquid Membrane / Water Proofing, Hydrophobic Poreblocking Ingredients with Superplasticizer	Physical Property, Mechanical and Chemical Property, Leak Test / Flood Test	One per shipment
Paint	Quality Test	One 4-L can for every 100 cans or fraction thereof
Ceramic Tile	Inspection and Evaluation Report from the Engineer	One per shipment
Stainless Steel	Inspection and Evaluation Report from the Engineer	One per shipment
Roofing Materials	Inspection and Evaluation Report from the Engineer	One per shipment
Ceiling Materials	Inspection and Evaluation Report from the Engineer	One per shipment
<b>ELECTRICAL AND MECHANICAL WORKS</b>		
Wires / Cables	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Electrical Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Fire Alarm System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Wiring Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment

PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment  
Page 9 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Protective Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Telephone System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CCTV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CATV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Background Music and Paging System	Inspection and Evaluation Report from the Engineer, Testing and Commissioning	One per item
Air Conditioning Units & Ventilation	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Conduit Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Lighting Fixtures	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
<b>PLUMBING WORKS</b>		
Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item


PPA MEMORANDUM CIRCULAR  
No. 02  
Series of 2016  
Attachment


Page 10 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Fixtures	Inspection and Evaluation Report from the Engineer  Testing and Commissioning	One per item
Pipe Culverts	Compression Strength  Inspection and Evaluation Report from the Engineer	For every size not more than 25 pipes cast in the field
<b>IV Miscellaneous Materials</b> Fencing A Barbed Wire, Cyclone Wire Mesh, Chain Link B Concrete Post	Physical Test (Dimensions and Coatings)  Refer to Superstructure (SC)	One per Batch  Refer to Superstructure (SC)
Lamp Post A Structural Steel B Zinc (Hot Dip Galvanizing) Coatings	Physical Test (Dimensions) Same test as for SC (E)  Same test as for CJ (C)	All units  One per batch
Drainage Steel Grating	Same test as for SC (E)  Inspection Report	One (1) batch
Metal Pipe (Cast Iron Galvanized, etc )	Physical Test (Dimensions and Coatings)	1 per delivery
Welding Works	Destructive and Non Destructive Test	One (1) per lot

- NOTES**
1. Testing of RDF shall be performed only by an independent Testing Laboratory duly accredited by BRS, DOST and PPA
  2. Testing of other materials shall be performed only by an independent Testing Laboratory duly accredited by BRS and PPA.
  3. All other issuances which are otherwise inconsistent herewith are hereby revoked or otherwise amended.

Approved

  
**RAUL T. SANTOS**  
Officer-In-Charge,  
Office of the General Manager





## *SECTION IX*

# *CHECKLIST OF TECHNICAL AND FINANCIAL DOCUMENTS*

# Checklist of Technical and Financial Documents

## I. TECHNICAL COMPONENT ENVELOPE

### *Class "A" Documents*

#### Legal Documents

- ☐ (a) Valid PhilGEPS Registration Certificate (Platinum Membership) (all pages)

#### Technical Documents

- ☐ (b) Statement of the prospective bidder of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid; **and**
- ☐ (c) Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, except under conditions provided under the rules; **and**
- ☐ (d) Special PCAB License in case of Joint Ventures; **and** registration for the type and cost of the contract to be bid; **and**
- ☐ (e) Original copy of Bid Security. If in the form of a Surety Bond, submit also a certification issued by the Insurance Commission;  
**or**  
Original copy of Notarized Bid Securing Declaration; **and**
- ☐ (f) Project Requirements, which shall include the following:
  - ☐ a. Organizational chart for the contract to be bid;
  - ☐ b. List of contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen), to be assigned to the contract to be bid, with their complete qualification and experience data;
  - ☐ c. List of contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership or certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be; **and**
- ☐ (g) Original duly signed Omnibus Sworn Statement (OSS); **and** if applicable, Original Notarized Secretary's Certificate in case of a corporation, partnership, or cooperative; or Original Special Power of Attorney of all members of the joint venture giving full power and authority to its officer to sign the OSS and do acts to represent the Bidder.

**Financial Documents**

- ☐ (h) The prospective bidder's computation of Net Financial Contracting Capacity (NFCC).

***Class "B" Documents***

- ☐ (i) If applicable, duly signed joint venture agreement (JVA) in accordance with RA No. 4566 and its IRR in case the joint venture is already in existence;  
or  
duly notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA in the instance that the bid is successful.

**II. FINANCIAL COMPONENT ENVELOPE**

- ☐ (j) Original of duly signed and accomplished Financial Bid Form; **and**

***Other documentary requirements under RA No. 9184***

- ☐ (k) Original of duly signed Bid Prices in the Bill of Quantities; **and**  
☐ (l) Duly accomplished Detailed Estimates Form, including a summary sheet indicating the unit prices of construction materials, labor rates, and equipment rentals used in coming up with the Bid; **and**  
☐ (m) Cash Flow by Quarter.

*SECTION X*

*BIDDING FORM*

## Bid Form for the Procurement of Infrastructure Projects

*[shall be submitted with the Bid]*

---

### BID FORM

Date : \_\_\_\_\_  
Project Identification No. : \_\_\_\_\_

To: **Philippine Ports Authority**  
PPA Building, Bonifacio Drive,  
South Harbor, Port Area, Manila

Having examined the Philippine Bidding Documents (PBDs) including the Supplemental or Bid Bulletin Numbers \_\_\_\_\_, the receipt of which is hereby duly acknowledged, we, the undersigned, declare that:

- a. We have no reservation to the PBDs, including the Supplemental or Bid Bulletins, for the Procurement Project: **Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall, Port of Calatagan, Batangas;**
- b. We offer to execute the Works for this Contract in accordance with the PBDs;
- c. The total price of our Bid in words and figures, excluding any discounts offered below is: \_\_\_\_\_;
- d. The discounts offered and the methodology for their application are: \_\_\_\_\_;
- e. The total bid price includes the cost of all taxes, such as, but not limited to: *[specify the applicable taxes, e.g. (i) value added tax (VAT), (ii) income tax, (iii) local taxes, and (iv) other fiscal levies and duties]*, which are itemized herein and reflected in the detailed estimates,
- f. Our Bid shall be valid within the period stated in the PBDs, and it shall remain binding upon us at any time before the expiration of that period;
- g. If our Bid is accepted, we commit to obtain a Performance Security in the amount of \_\_\_\_\_ percent of the Contract Price for the due performance of the Contract, or a Performance Securing Declaration in lieu of the the allowable forms of Performance Security, subject to the terms and conditions of issued GPPB guidelines<sup>1</sup> for this purpose;
- h. We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- i. We understand that this Bid, together with your written acceptance thereof

---

<sup>1</sup> currently based on GPPB Resolution No. 09-2020

included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and

- j. We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.
- k. We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall, Port of Calatagan, Batangas** of the **Philippine Ports Authority**.
- l. We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: \_\_\_\_\_

Legal Capacity: \_\_\_\_\_

Signature: \_\_\_\_\_

Duly authorized to sign the Bid for and behalf of: \_\_\_\_\_

Date: \_\_\_\_\_

# STATEMENT OF THE BIDDER'S ALL ONGOING GOVERNMENT AND PRIVATE CONTRACTS, INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED

I hereby declare that all ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid are listed below:

Name of outstanding Contracts 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Amount or Value 4]	Date of Contract and NOA 5]	Value of Outstanding Works 6]	Accomplishment (in percentage, %) 7]		Contract Duration 8]	
							Planned	Actual	Start of Project	Estimated Completion Date
A) Government Contracts i. On-going ii. Awarded but not yet started  B) Private Contracts i. On-going ii. Awarded but not yet started										

## NOTE:

- 1] As appearing in the contract executed by the parties.
- 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
- 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso.
- 5] As appearing in the Contract and Notice of Award (NOA).
- 6] Amount or value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.
- 7] Percentage of Accomplishment as of the preceding month which should not be earlier than two (2) months from the date of bid submission.
- 8] As appearing in the Notice to Proceed and Contract.

This Statement shall be supported by:

- a) Notice of Award
- b) Notice to Proceed and Contract

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

**STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID**

Name of the completed Contract 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Value At 4]			Date of Award 5]	Contract Duration 6]	
				Award	Completion	Escalated Value to Present Prices		Start	Completed

**NOTE :**

- 1] As appearing in the contract executed by the parties.
  - 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
  - 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
  - 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Attached the computation for the escalated contract value.
  - 5] As appearing in the Notice of Award.
  - 6] As appearing in the Notice to proceed and Certificate of Completion.
- A. The bidder must have an experience of having completed a SLCC that is similar to the contract to be bid equivalent to at least fifty percent (50%) of the ABC, adjusted if necessary, by the Bidder to current prices using the PSA consumer price indices. A contract is considered to be "similar" to the contract to be bid if it has the same Major Categories of Work as stated in the Bid Data Sheet (BDS).
  - B. This Statement shall be supported by:
    - a. Notice of Award, Notice to Proceed and Contract.
    - b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least Satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/ Constructor, 3) Name of Contract, and 4) Contract Duration.
    - c. Recapitulation or Final Bill of Quantities.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021



**STATEMENT OF THE BIDDER'S EXPERIENCE ON MAJOR CATEGORIES OF WORK OF THE SLCC INCLUDING OTHER COMPLETED CONTRACTS  
SIMILAR TO THE CONTRACT TO BE BID**

Major Categories of Work 1]	Unit of Measure 1]	Quantity 1]	SLCC similar to the contract to be bid 2]	Other completed contracts similar to the contract to be bid 2]			Unit of Measure 2]	Quantity 2]
			Name of the contract	Name of the contract	Name of the contract	Name of the contract		
1. Supply and Place Portland Cement Concrete Pavement (PCCP)	sq.m.	497						
2. Supply and Place Thermoplastic Paint	sq.m.	271						

**NOTE:**

1] As stated in the Bid Data Sheet.

2] As appearing in the Recapitulation and/ or Final Bill of Quantities.

This statement shall be supported by:

a. Notice of Award, Notice to Proceed and Contract.

b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, of at least satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/Constructor, 3) Name of Contract, and 4) Contract Duration.

c. Recapitulation and/ or Final Bill of Quantities.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
Signatory's Legal Capacity

\_\_\_\_\_  
Date

Revised: September 2021

## FINANCIAL DATA

- A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

- B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [ (Current assets minus current liabilities) (15) ] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = \_\_\_\_\_

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

\_\_\_\_\_  
Name of Firm/Applicant

\_\_\_\_\_  
Authorized Signing Official

Date: \_\_\_\_\_

### NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

### STATEMENT OF THE BIDDER'S KEY PERSONNEL PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following key personnel are qualified and available for the duration of the contract to be bid:

Position of Key Personnel 1]	Name	No. of Key Personnel	Similar Experience in the Position (Years) 2]	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Materials Engineer I					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex " _ "

**NOTE:** 1] As stated in the Bid Data Sheet

2] The number of years of experience of the key personnel shall be as indicated in the qualification and experience data or curriculum vitae.

Minimum qualification requirements: The key personnel must have a work experience that is similar in nature and complexity to the contract to be bid.

Project Manager - Five (5) years

Materials Engineer – One (1) year

Project Engineer - Three (3) years

Materials Engineer I – for projects costing up to 100M

Foreman - Five (5) years

Materials Engineer II – for projects costing more than 100M

Construction Safety and Health Officer – One (1) year

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

# STATEMENT OF THE BIDDER'S EQUIPMENT PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following equipment are in good operating condition and available for the duration of the contract to be bid:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity/ Output  1]	Owned, Leased, and/or under purchased agreement 2]	Proof of Ownership/ Leased/ Under Purchase Agreement (Mark as Annex "A.....Z") 3]	OTHER INFORMATION (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

## NOTE:

- 1] The unit of capacity of the pledged equipment shall be as indicated in the Proof of Ownership, i.e. GW (for crane barge), DWT (for deck barge and hopper barge), Ton (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m. (for dump truck), hp (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal (for water truck with pump), amp (for welding machine), bagger (for concrete mixer). If the capacity of the pledged equipment is not indicated in the Proof of Ownership/Leased Contract/Purchased Agreement, submit other proof of capacity such as specifications, brochures or other verifiable printouts indicating the model name, model number and other details of the equipment.
- 2] Indicate if the pledged equipment are owned, leased or under purchase agreement.
- 3] If the pledged equipment is owned, it should be in the name of the bidder. Submit proof of ownership, i.e. deed of sale, sales invoice, official receipt; For owned Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt; For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

If the pledged equipment is leased/under purchased agreement, submit certification of availability of equipment from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement.

If the pledged barge/tugboat is leased/under purchase agreement, submit certification of availability of barge/tugboat from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement together with a copy of the Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

The Minimum Major Equipment Requirements are listed in Section 8, Annex 3.

\_\_\_\_\_  
Name of Firm

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

\_\_\_\_\_  
Date

Revised: September 2021

**Omnibus Sworn Statement for Sole Proprietorship**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. As the owner and sole proprietor, or authorized representative of \_\_\_\_\_, I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall, Port of Calatagan, Batangas of the Philippine Ports Authority**, as shown in the attached duly notarized Special Power of Attorney;
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_ day of \_\_, 20\_\_ at \_\_\_\_\_, Philippines.

\_\_\_\_\_  
Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**  
*[Format shall be based on the latest Rules on Notarial Practice]*

**Omnibus Sworn Statement for Partnership or Cooperative**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall, Port of Calatagan, Batangas of the Philippine Ports Authority**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers and members of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_\_ day of \_\_\_, 20\_\_ at \_\_\_\_\_, Philippines.

\_\_\_\_\_  
Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**  
*[Format shall be based on the latest Rules on Notarial Practice]*



**Omnibus Sworn Statement for Corporation or Joint Venture**  
*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES )  
CITY/MUNICIPALITY OF \_\_\_\_\_ ) S.S.

**AFFIDAVIT**

I, \_\_\_\_\_, of legal age, [Civil Status], [Nationality], and residing at \_\_\_\_\_, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of \_\_\_\_\_ with office address at \_\_\_\_\_;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Restoration of Dilapidated Concrete Pavement and Improvement of Vendor Stall, Port of Calatagan, Batangas**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers, directors, and controlling stockholders of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
  - a. Carefully examining all of the Bidding Documents;
  - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
  - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
  - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].
9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any

form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this \_\_ day of \_\_, 20\_\_ at \_\_\_\_\_, Philippines.

---

Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**

*[Format shall be based on the latest Rules on Notarial Practice]*

### **Bid Securing Declaration Form**

*[shall be submitted with the Bid if bidder opts to provide this form of bid security]*

REPUBLIC OF THE PHILIPPINES)  
CITY OF \_\_\_\_\_) S.S.

#### **BID SECURING DECLARATION**

**Project Identification No.:** \_\_\_\_\_

**To: Philippine Ports Authority**  
PPA Building, Bonifacio Drive,  
South Harbor, Port Area, Manila

I/We, the undersigned, declare that:

1. I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid Securing Declaration.
2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any procurement contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by the procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA No. 9184; without prejudice to other legal action the government may undertake.
3. I/We understand that this Bid Securing Declaration shall cease to be valid on the following circumstances:
  - a. Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
  - b. I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right; and
  - c. I am/we are declared the bidder with the Lowest Calculated Responsive Bid, and I/we have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this \_\_\_\_ day of [month] [year] at [place of execution].

\_\_\_\_\_  
Name of Bidder/ Authorized Representative  
(Signatory's Legal Capacity)  
AFFIANT

**[Jurat]**

*[Format shall be based on the latest Rules on Notarial Practice]*

## CONSTRUCTION METHODOLOGY

Name of Project : \_\_\_\_\_  
Project Description : \_\_\_\_\_  
Location : \_\_\_\_\_

### MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

#### A. RESTORATION OF DILAPIDATED PAVEMENT

1. Demolish and excavate damaged pavement;
2. Supply, spread and compact 200 mm thick sub-base course materials (994 cu.m.);
3. Replace electrical fixtures (994 cu.m.) including supply line gravel base course material;
4. Supply and place 3,000 psi concrete (994 cu.m.) for pavement;
5. Supply and place yellow thermoplastic paint (90 sq.m) on intersection lines; and
6. Supply and place white thermoplastic paint (450 sq.m.) on pedestrian lane, stopping, border and lane lines.

#### B. IMPROVEMENT OF VENDOR STALL

1. Excavate, backfill and compact;
2. Supply and place gravel bedding
3. Repair electrical system
4. Supply and place concrete (12 cu.m)
5. Work on masonry (115 sq.m)
6. Reinforce steel bars (8,625 kg of various sizes) for vendor stall
7. Floor finishes
8. Supply and install Roll Up Doors (4 sets)
9. Repair plumbing system, storm drain including fixtures and accessories
10. Conduct waterproofing
11. Repaint any areas that requires repainting

**NOTES:**

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

## MANPOWER SCHEDULE

Name of Project : \_\_\_\_\_

Project Description : \_\_\_\_\_

Location : \_\_\_\_\_

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)							
	M O N T H L Y							
	1	2	3	4	5	6	7	8
Project Manager								
Project Engineer								
Materials Engineer II								
Construction Safety and Health Officer								
Foreman								
- Carpenter								
- Steelman								
- Mason								
- Electrician								
- Rigger								
- Others								

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

### EQUIPMENT UTILIZATION SCHEDULE

Name of Project : \_\_\_\_\_

Project Description : \_\_\_\_\_

Location : \_\_\_\_\_

Equipment	No. of Units	CONTRACT DURATION (_____ Calendar Days)							
		M O N T H L Y							
		1	2	3	4	5	6	7	8

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021

## CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : \_\_\_\_\_

Project Description : \_\_\_\_\_

Location : \_\_\_\_\_

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
<b>TOTAL</b>		

### NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

\_\_\_\_\_  
Name of Bidder/Authorized Representative  
(Signatory's Legal Capacity)

Revised: September 2021



**Contract Agreement Form for the  
Procurement of Infrastructure Projects (Revised)**  
*[not required to be submitted with the Bid, but it shall be submitted within ten (10) days after receiving  
the Notice of Award]*

---

**CONTRACT AGREEMENT**

THIS AGREEMENT, made this \_\_\_\_\_ day of \_\_\_\_\_, \_\_\_\_\_ between **Philippine Ports Authority** with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila (hereinafter called the "Entity") and **[name and address of Contractor]** (hereinafter called the "Contractor").

WHEREAS, the Entity is desirous that the Contractor execute **[name and identification number of contract]** (hereinafter called "the Works") and the Entity has accepted the Bid for **[contract price in words and figures in specified currency]** by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

1. In this Agreement, words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
2. The following documents as required by the 2016 revised Implementing Rules and Regulations of Republic Act No. 9184 shall be deemed to form and be read and construed as part of this Agreement, viz.:
  - a. Philippine Bidding Documents (PBDs);
    - i. Drawings/Plans;
    - ii. Specifications;
    - iii. Bill of Quantities;
    - iv. General and Special Conditions of Contract;
    - v. Supplemental or Bid Bulletins, if any;
  - b. Winning bidder's bid, including the Eligibility requirements, Technical and Financial Proposals, and all other documents or statements submitted;

Bid form, including all the documents/statements contained in the Bidder's bidding envelopes, as annexes, and all other documents submitted (e.g., Bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from the Procuring Entity's bid evaluation;

- c. Performance Security;
- d. Notice of Award of Contract and the Bidder's conforme thereto; and

- e. Other contract documents that may be required by existing laws and/or the Procuring Entity concerned in the PBDs. **Winning bidder agrees that additional contract documents or information prescribed by the GPPB that are subsequently required for submission after the contract execution, such as the Notice to Proceed, Variation Orders, and Warranty Security, shall likewise form part of the Contract.**
3. In consideration for the sum of [total contract price in words and figures] or such other sums as may be ascertained, [Named of the bidder] agrees to [state the object of the contract] in accordance with his/her/its Bid.
4. The **Philippine Ports Authority** agrees to pay the above-mentioned sum in accordance with the terms of the Bidding.

IN WITNESS whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

**JAY DANIEL R. SANTIAGO**  
General Manager

**Name of Bidder/ Authorized  
Representative  
(Signatory's Legal Capacity)**

for:

for:

**Philippine Ports Authority**

**Contractor**

### **Acknowledgment**

*[Format shall be based on the latest Rules on Notarial Practice]*